



Asset Management

Best Practice Guidelines

Version 2.0

SolarPower
Europe

Supported by:



DEMONSTRATE YOUR EXCELLENCE

with the Solar Best Practices Mark



**Solar O&M
Best Practices Mark**
solarbestpractices.com



**Solar Monitoring
Best Practices Mark**
solarbestpractices.com



**Solar Aerial Thermography
Best Practices Mark**
solarbestpractices.com



**Solar Asset Management
Best Practices Mark**
solarbestpractices.com

Your Benefits



Excellence

Verify your level of excellence using the interactive checklist and follow best practice recommendations.



Credibility

Strengthen your company's credibility by offering access on request to your checklist and technical dossier.



Visibility

Get listed in the Companies Directory and display the Solar Best Practices Mark on your website and publications.



Graphic toolkit

Use the toolkit to make the most out of the Mark's value for your company.

visit solarbestpractices.com

Registration is free of charge for SolarPower Europe members.

FEATURED SUPPORTERS



The Solar Best Practices Mark was created and is powered by SolarPower Europe.

SolarPower Europe – Leading the Energy Transition

SolarPower Europe is a member-led association that aims to ensure that more energy is generated by solar than any other energy source by 2030.
www.solarpowereurope.org



SolarPower Europe

Foreword

Welcome to Version 2.0 of SolarPower Europe's Asset Management Best Practice Guidelines. Building on a successful Version 1.0 published in December 2019, this update incorporates even more industry experience, delivering a forward-looking vision for the solar Asset Management segment.

While Operation and Maintenance (O&M) service providers take care of the solar power plant on a technical level, Asset Managers are responsible for the commercial and financial management of a solar investment, and the supervision and control of technical activities. They manage a company or portfolio rather than a power plant, often across different geographies, dealing with a variety of regulatory frameworks and business models. Asset management is also defined as the coordinated activities of an organisation to generate value from its assets (ISO 55000).

With the professionalisation and globalisation of solar investors and investment portfolios, service quality expectations have risen steadily, putting increasing requirements on Asset Managers who are expected to continuously improve the return on investment via various processes, including revenue optimisation, cost reduction, financial restructuring, contractual renegotiation, and technology adaptation. To achieve this, Asset Managers are expected to transition from simple tools, such as self-made spreadsheets, to advanced digital Asset Management Platforms, which enable efficient and effective management of wide and diverse solar portfolios.

SolarPower Europe published Version 1.0 of the Asset Management Best Practice Guidelines to support the solar industry in achieving these goals. Version 2.0 aims to build on the success of the first edition by incorporating even more industry experience from two dozen leading solar experts, including Asset Managers as well as O&M providers, asset owners, technical advisors, digital solutions providers and more. Over the course of the past year, existing chapters of the first version have been extensively discussed, enhanced, and refined in the Lifecycle Quality Workstream. Version 2.0 features a new, dedicated chapter on risk management in the operational phase, and a useful skills matrix for Asset Managers in the annex. Reflecting the latest market and technology trends, we have added several new sections in the existing chapters covering topics such as lifecycle best practices, value-added services, revamping & repowering, management of unsubsidised projects, challenges in multi-jurisdictional and global portfolios, data format and aggregation, and digital twins. Finally, we have also developed the Asset Management Best Practice Mark, a voluntary quality label for Asset Management providers that comes with a useful self-assessment checklist, available at www.solarbestpractices.com.

This past year was a milestone for our Workstream on multiple fronts. The former "O&M Task Force" became the "Lifecycle Quality Workstream" to reflect its broadening scope, and the Workstream successfully developed the Engineering, Procurement and Construction (EPC) Best Practice Guidelines; in the future we have the ambition to develop best practices for more segments across the project lifecycle. The dissemination of best practices around the world has also continued: we published the French-language Tunisian edition of the O&M Best Practice Guidelines and we are working on Indian and African editions.

We thank our members for their extraordinary engagement and support. We will continue the work in 2021 and invite interested stakeholders to join us in our endeavour to develop and disseminate best practices across the solar project lifecycle.



ADELE ARA
Head of Global
Business Operations at
Lightsource bp
Chair of the Lifecycle
Quality Workstream



**PROF. DR. RALPH
GOTTSCHALG**
Director, Fraunhofer CSP
Vice-Chair of the Lifecycle
Quality Workstream



ALDEN LEE
Head of Solar
Procurement, Logistics
and Quality,
ABO Wind
Vice-Chair of the Lifecycle



**WALBURGA
HEMETSBERGER**
Chief Executive Officer,
SolarPower Europe



Chair of the SolarPower Europe Lifecycle Quality Workstream: Adele Ara, Lightsource bp.

Vice-Chairs of the SolarPower Lifecycle Quality Workstream: Ralph Gottschalg, Fraunhofer CSP; Alden Lee, ABO Wind.

Coordinator of the SolarPower Europe Lifecycle Quality Workstream: Máté Heisz, SolarPower Europe.

Contact: info@solarpowereurope.org.

Contributors of Version 2.0: Adele Ara, Lightsource bp; Walter Barbarotto, BayWa r.e.; Giuseppina Casanova, BayWa r.e.; Paolo V. Chiantore, BayWa r.e.; Juan Fernandez, Sonnedix; Vincenzo Giorgio, Bird & Bird; Ralph Gottschalg, Fraunhofer CSP; Máté Heisz, SolarPower Europe; Grant Hilti, Heliospekt; Will Hitchcock, Above Surveying; Edmee Kelsey, 3megawatt; Thomas Lebreuilly, Akuo Energy; Etienne Lecompte, Powerhub; Alden Lee, ABO Wind; David Lewis, Akuo Energy; Pierpaolo Mastromarini, Bird & Bird; David Moser, Eurac Research; Esther Munoz, Iberdrola; Constantinos Peonides, Alectris; Martina Pianta, 3E; Eliane Pohl, Greenbyte; Ali Rahmati, Fronius; Pedro Rocha, Voltaia; Wolfgang Rosenberg, TCO Solar; Maria Sabella, Relight Energy Services; Thomas Sauer, EXXERGY; Aleksis Schäfer, greentech; Claire Schön, Alteso; Elaine Teo, Heliospekt; Filipa Ximenes, Voltaia.

Supported by: the Solar Trade Association (STA).

Acknowledgements: SolarPower Europe would like to extend a special thanks to all members that contributed with their knowledge and experience to this report. This would never have been possible without their continuous support.

Project Information: The SolarPower Europe O&M Task Force officially started its work in April 2015, and it became the Lifecycle Quality Workstream in 2020, to cover O&M, Asset Management and EPC. It operates through frequent exchanges and meetings. The Workstream's flagship reports are the O&M Best Practice Guidelines, the Asset Management Best Practice Guidelines and the EPC Best Practice Guidelines, which reflect the experience and views of a considerable share of the European solar industry today. There has been no external funding or sponsorship for these reports.

Disclaimer: This report has been prepared by SolarPower Europe. It is provided to recipients for general information only. Nothing in it should be interpreted as an offer or recommendation of any products, services or financial products. This report does not constitute technical, investment, legal, tax or any other advice. Recipients should consult with their own technical, financial, legal, tax or other advisors as needed. This report is based on sources believed to be accurate. However, SolarPower Europe does not warrant the accuracy or completeness of any information contained in this report. SolarPower Europe assumes no obligation to update any information contained herein. SolarPower Europe will not be held liable for any direct or indirect damage incurred by the use of the information provided and will not provide any indemnities.

Design: Onehemisphere, Sweden.

ISBN: 9789464073423.

Published: November 2020.

SolarPower Europe would like to thank the members of the Lifecycle Quality Workstream that contributed to this report including:



Sponsor members of SolarPower Europe:

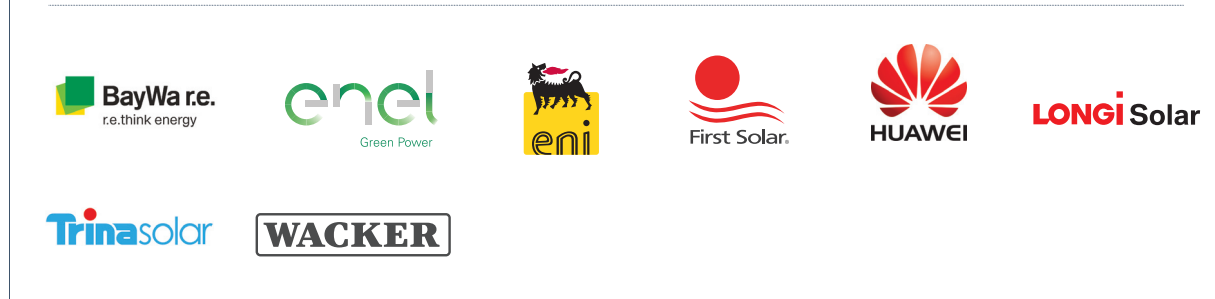


Table of contents

Foreword	3	5 Handover of solar assets	38
Table of contents	6	5.1. Site data and information	38
List of tables and figures	8	5.2. Documents acquisition and management	39
List of abbreviations	9	5.3. System and tools	41
Executive summary	10	6 Technical asset management	42
1 Introduction	12	6.1. Technical reporting	42
1.1. Rationale, aim and scope	12	6.2. Site visits and non-intrusive inspections	44
1.2. What is asset management?	13	6.3. Management of ancillary service providers	44
1.2.1. Overview	13	6.4. Interface with local energy authorities & regulatory compliance	44
1.2.2. Asset management key targets	16	6.5. Warranty management	45
1.2.3. Asset management commitments and policies	17	6.6. Insurance claims	47
1.2.4. Value-added services	18	6.7. Contract management (operational contracts)	47
1.2.5. Stakeholders and roles	20	6.8. Asset optimisation (technical)	48
1.3. How to benefit from this document	21	6.9. Revamping & repowering	48
2 Definitions	22	6.10. Environmental management	50
3 Lifecycle project management	27	6.11. Health & safety management	51
3.1. The key stages of a project	27	6.12. Challenges of multi-jurisdictional and global portfolios	51
3.2. Overview of the role of asset manager through the lifecycle of the project	27	7 Commercial and financial asset management	53
3.3. Core competencies needed for lifecycle project management	28	7.1. Financial reporting	53
3.4. Activities at key stages	29	7.2. Strategy management	54
3.5. Lifecycle lessons learnt and feedback loop	31	7.3. Management of unsubsidised projects	54
4 Risk management in the operational phase	32	7.4. Corporate administrative services	55
4.1. Definition of risk and risk management	32	7.5. Accounting	55
4.2. Financial risk factors	33	7.6. Customer relationship	55
4.3. Regulatory and policy risk factors	34	7.7. Accounting assistance	56
4.4. Contractual risk factors	35	7.8. Invoicing/billing and payments	57
4.5. Technical risk factors	35	7.9. Revenue Control	57
4.6. Commercial risks	36	7.10. Cash flow management	57
4.7. Risk transfer	36	7.11. Working capital reconciliation	58
4.8. Sector reputational risks	37	7.12. Financial control	58
		7.13. Contract management (financial contracts)	58
		7.14. Suppliers account management	58
		7.15. Supplier penalties invoicing	62
		7.16. Interface with banks and investors	62
		7.17. Equity/debt financing management	63
		7.18. Tax preparation, filing and administration	63
		7.19. Challenges of multi-jurisdictional and global portfolios	64

Table of contents

8	Procurement	66	11	Key Performance Indicators	86
8.1.	Main supplier requirements	67	11.1.	Asset manager experience	86
8.2.	Supplier selection and evaluation	68	11.2.	Quality of service based on periodic asset owner surveys	86
8.3.	Further considerations to be taken into account in the selection process	69	11.3.	Reports Compliance Rate (RCR)	87
8.4.	Supply account control	70	11.4.	Invoicing Compliance Rate (ICR)	87
8.5.	Supply chain control	71	11.5.	Contracts Optimisation Rate (COR)	87
			11.6.	Requests treated	87
9	People and skills	73	11.7.	Timely Response Rate (TRR)	88
			11.8.	Quality of the tender proces	88
			11.9.	O&M contractor compliance	88
10	Data management and high-level monitoring	75	12	Contractual framework	89
10.1.	Asset Management Platform functionalities	76	12.1.	Scope of the asset management contract	89
10.1.1.	Reporting	76	12.2.	Asset management contract fee	89
10.1.2.	Site construction due diligence	78	12.3.	Contractual guarantees	89
10.1.3.	Optimisation of energy production	78	12.4.	Service standards	89
10.1.4.	Regular updates and software reliability	78	12.5.	Limitation on authority	90
10.1.5.	Lifecycle data collection	78	12.6.	Responsibility and accountability	91
10.1.6.	Operational risk management	79	12.7.	Subcontracting	91
10.1.7.	Procurement process management	79	12.8.	Reporting	91
10.1.8.	Deadlines management	79	12.9.	Continuity of operation and termination	91
10.1.9.	Health & safety records	79	12.10.	Force Majeure	91
10.1.10.	Incidents records	79	12.11.	Direct agreement	91
10.2.	Types of data collected through the Asset Management Platform	79	12.12.	Personnel	91
10.2.1.	Technical data	80	Annex A		92
10.2.2.	Operational data	80	References		93
10.2.3.	Financial & commercial data	80			
10.2.4.	Contractual & regulatory data	80			
10.2.5.	Third-party data	81			
10.3.	Data format	81			
10.4.	Aggregating data	81			
10.5.	Interoperability	82			
10.6.	Cybersecurity	82			
10.7.	Data portability, backup and disaster recovery	84			
10.8.	Handover of data and documents	85			

List of tables

Table 1:	Key stages of project lifecycle	28
Table 2:	Definition of risk	32
Table 3:	Financial risk factors	34
Table 4:	Regulatory risk factors	34
Table 5:	Technical risk factors	35
Table 6:	Commercial risks	36
Table 7:	Risk transfer	37
Table 8:	Key categories of site information to be collected by incoming asset manager	39
Table 9:	Key documents to be collected as part of a project handover	40
Table 10:	Proposed indicators/values required for the reporting	43
Table 11:	Definition of revamping and repowering	49
Table 12:	Technical asset management: challenges of multi-jurisdictional and global portfolios	51
Table 13:	Commercial and financial asset management: challenges of multi-jurisdictional and global portfolios	64
Table 14:	Key criteria for the selection of the various suppliers	69
Table 15:	Key performance indicators for relevant suppliers	71
Table 16:	Supply chain risks and mitigation measures	72
Table 17:	Frequency of key data provision	77
Table 18:	Examples of data integration options	82
Table 19:	Data backup minimum requirements and best practices	85

List of figures

Figure 1:	Disciplines to be mastered by asset management service providers	14
Figure 2:	Roles and responsibilities by different stakeholders in the field of asset management and O&M	15
Figure 3:	Steps to agree strategic approach to increased profitability	16
Figure 4:	Drivers of operational asset management services	17
Figure 5:	Integrated approach to maximise risk-adjusted returns	18
Figure 6:	Example of handover documentation and process at the start of the construction phase	30
Figure 7:	Lesson learnt and feedback loop process	31
Figure 8:	Risk management strategy chart	33
Figure 9:	Insurance solutions oriented to the purpose of insurance	37
Figure 10:	New requirements driven by new risk allocation and critical importance of data management	54
Figure 11:	Kraljic matrix of main suppliers involved in solar power plant operation	66
Figure 12:	Overview of the analytical hierarchy process methodology – analysis produced for each supplier	68
Figure 13:	Management of concentration risks	70
Figure 14:	Traditional linear asset management approach and asset-centric information-based approach with three key stakeholders of asset management	77
Figure 15:	Types of data collected along the lifecycle of the project	78
Figure 16:	Scope of the asset management contract	90

List of abbreviations

AC	Alternating current	IRENA	International Renewable Energy Agency
AHP	Analytical Hierarchy Process	KPI	Key Performance Indicator
AM	Asset Management	kW	kilowatt
AMP	Annual Maintenance Plan	kWh	kilowatt-hour
AMR	Automatic Meter Reading	kWp	kilowatt-peak
AMS	Annual Maintenance Schedule	LAN	Local Area Network
API	Application Programming Interface	LCOE	Levelised Cost of Electricity
CAD	Computer-aided design	LTE-M	Long Term Evolution, category M1
CCTV	Closed Circuit Television	LPWAN	Long-power Wide-area Network
CMMS	Computerised Maintenance Management System	LV	Low Voltage
COD	Commercial Operation Date	MAE	Mean Absolute Error
CSMS	Cybersecurity Management System	MIT	Minimum Irradiance Threshold
DC	Direct Current	MPPT	Maximum Power Point Tracking
DMS	Document Management System	MV	Medium Voltage
DOR	Division of Responsibility	MW	Megawatt
DSCR	Debt Service Coverage Ratio	O&M	Operation and Maintenance
DSL	Digital Subscriber Line	OEM	Original Equipment Manufacturer
EH&S	Environment, Health and Safety	OS	Operating System
EMS	Energy Management System	PAC	Provisional Acceptance Certificate
EPC	Engineering, Procurement, Construction	POA	Plane of Array
EPI	Energy Performance Index	PPA	Power Purchase Agreement
ERP	Enterprise Resource Planning System	PPE	Personal Protective Equipment
ESS	Energy Storage System	PR	Performance Ratio
FAC	Final Acceptance Certificate	PV	Photovoltaic
FIT	Feed-in Tariff	RMSE	Root Mean Square Error
FTP	File Transfer Protocol	ROI	Return on Investment
GPRS	General Packet Radio Service	RPAS	Remotely Piloted Aircraft System (drone)
H&S	Health and Safety	SCADA	Supervisory Control And Data Acquisition
HV	High Voltage	SLA	Service-level Agreement
IEC	International Electrotechnical Commission	SPV	Special Purpose Vehicle
IGBT	Insulated-Gate Bipolar Transistors	STC	Standard Test Conditions (1000 W/m ² , 25°C)
IPP	Independent Power Producer	UPS	Uninterruptible Power Supply
IR	Infrared		

Executive summary

With the professionalisation and globalisation of solar investors and investment portfolios and service quality expectations rising steadily there are increasing requirements of Asset Managers. Expected to continuously improve the return on investment via various processes including revenue optimisation, cost reduction, financial restructuring, contractual renegotiation and technology adaptation, Asset Managers are relying increasingly on advanced digital platforms. The latter enable efficient and effective management of wide and diverse solar portfolios. The present Guidelines are intended for Asset Managers as well as for investors, asset owners, financiers, software solutions providers, O&M contractors, technical consultants, and all stakeholders in Europe and beyond interested in improving solar Asset Management services.

This document starts by contextualising Asset Management, defining the roles and responsibilities of various stakeholders such as the Asset Manager, the Operations Service Provider and the Maintenance Provider and presenting an overview of technical and contractual terms to achieve a common understanding of the subject. It then walks the reader through the different business areas and other key activities of solar Asset Management, identifying for each segment “minimum requirements”, “best practices” and “recommendations”.

Lifecycle project management

Asset Managers can be involved in all phases of the solar power plant's lifecycle: from development through Engineering, Procurement and Construction (EPC) and Operation and Maintenance (O&M) to decommissioning and disposal. The document focuses largely on Asset Management during the operational phase – the longest phase of the project lifecycle – but this chapter presents an overview of lifecycle Asset Management with roles and tasks in all project phases. Key competencies related to lifecycle Asset Management include stage-gate management, documentation management, lifecycle risk management and warranty management (in relation to the EPC warranty). Being involved along the lifecycle of the projects represents also a significant learning opportunity from a technical, contractual and financial perspective (feedback loop).

Risk management in the operational phase

This chapter focuses on the risks emerging from the commercial operation date (COD), under the operational phase. It defines the terms risk (“effect of uncertainty on objectives”) and risk management (risk avoidance, risk reduction, risk control, risk transfer, residual risk) and gives an overview of financial, regulatory, contractual, technical, commercial and sector reputational risk factors.

Handover of solar assets

The journey of an Asset Manager starts with a handover (or on-boarding) process. This chapter addresses the importance of the handover process when an operational asset is transferred from an Asset Manager to another or when an asset owner decides to internalise the AM services. It presents the categories of site information and data to be handed over (such as real estate, power plant design and construction, production data, EPC and O&M contractor information), as well as the key documents to be collected and reviewed in the on-boarding process (such as the O&M manual, permits, contracts in place, warranties etc). It also underlines the importance of interoperability and compatibility between systems in case data needs to be migrated.

Technical asset management

Technical Asset Management (TAM) encompasses *support activities to ensure the best operation of a solar power plant or a portfolio* (i.e. to maximise energy production, minimise downtime and reduce costs). In many cases, the O&M contractor assumes some technical Asset Management tasks such as planning and reporting on Key Performance Indicators (KPIs) to the asset owner. However, in cases where the Technical Asset Manager and the O&M contractor are separate entities, close coordination and information sharing between the two is indispensable. TAM also includes ensuring that the operation of the PV plant complies with national and local regulations and contracts, and advising the asset owner on technical asset optimisation via, for instance, repowering investments.

Commercial and financial asset management

Commercial and Financial Asset Management encompasses *support activities for the best operation of a business*, including accounting, cash flow management, contract management, equity/debt financing management, tax management, as well as liaising with key stakeholders such as investors and banks. Financial reporting is an important component of Commercial and Financial Asset Management and involves regularly providing the asset owner with financial statements, capital structure analyses, profitability analyses, cash flow and debt compliance overviews. Financial asset optimisation activities that should be performed by Asset Managers include cost reduction, financial restructuring and contractual renegotiation.

Procurement

Procurement involves identifying and selecting key suppliers involved in the operation of the solar businesses and solar power plants, such as O&M contractors, insurance and IT solutions providers, security service contractors and in some cases providers of ancillary services such as electricity, panel cleaning and vegetation control. The Asset Manager should identify the right trade-off between price, quality of services and key contractual terms and constantly balance them in line with market conditions. For example, in order to evaluate and select O&M contractors, Asset Managers are recommended to use SolarPower Europe's O&M best practices checklist, which can be downloaded from www.solarbestpractices.com.

People and skills

It is important that all personnel from Asset Management companies have the relevant experience and qualifications necessary to perform the work in a safe, responsible and accountable manner. The annex of these Guidelines contain a useful skills matrix for technical, commercial and financial Asset Management.

Data management and high-level monitoring


Asset Managers should rely on a specialised Asset Management Platform to store, manage and, ideally, analyse technical and non-technical data and information collected from and relating to the solar asset, portfolio or SPV. Such a platform makes it possible for the solar industry to transition to an asset-centric information-based management approach, which addresses three key challenges: (1) loss of generation and income; (2) loss of time; and (3) lack of transparency, which is in contrast to the traditional linear Asset Management approach, where information flows from the asset through the O&M contractor to the Asset Manager and ultimately to the asset owner, with relatively little delving into the data and information extracted.

Key performance indicators

A close monitoring of Asset Management procedures is required to ensure implementation effectiveness. This can be achieved through the definition of clear and objective Key Performance Indicators (KPIs), which need to be continuously assessed. KPIs used to measure Asset Management service quality include Reports Compliance Rate, Invoicing Compliance Rate, Contracts Optimisation Rate, Requests Treated and Timely Response Rate. In general, one of the most important indicators is the track record of the Asset Manager.

Contractual framework

The scope of a full-service Asset Management agreement corresponds to the structure of this document, with the main business areas being Technical, Commercial and Financial Asset Management, and procurement and lifecycle project management. Asset managers do not provide any contractual guarantees comparable to the "availability guarantee" provided by O&M contractors, however the Asset Manager is obliged to provide the services in accordance with all laws, authorisations, good industry practices and current market standards.

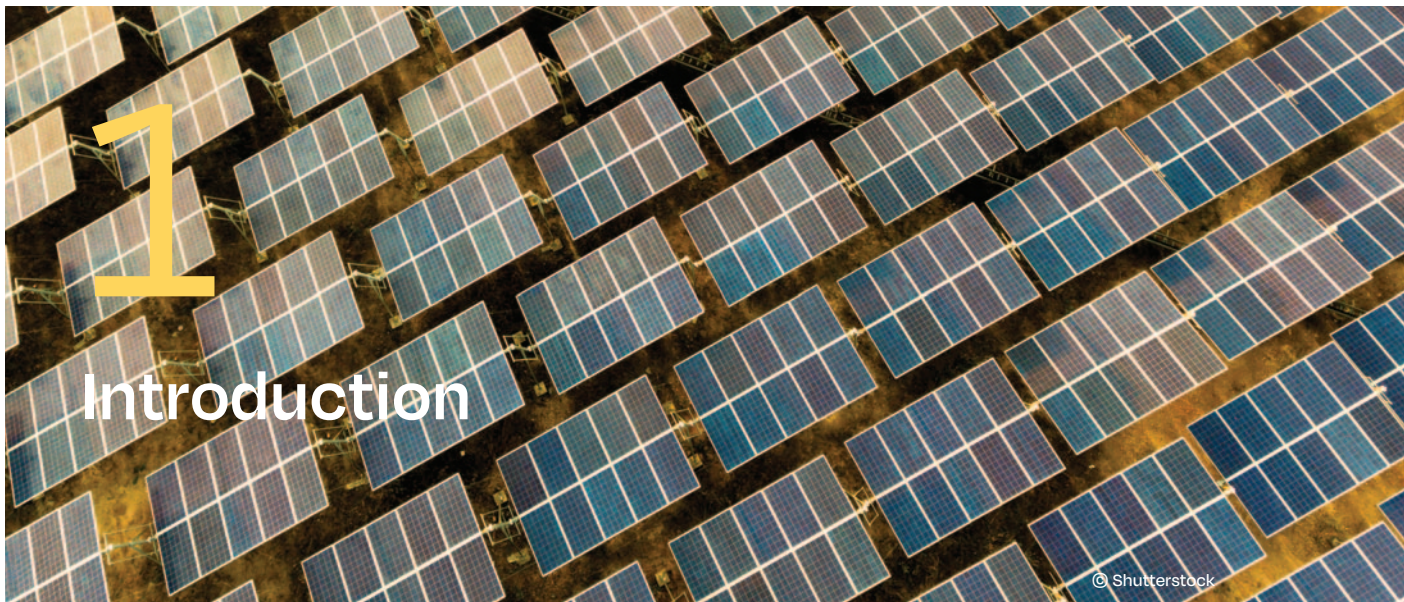

1.1. Rationale, aim, and scope

A professional and dedicated Asset Management (AM) service package ensures that photovoltaic (PV) plants, individually and as part of a wider portfolio, achieve their maximum potential from both technical and financial perspectives.

Owners, investors and lenders in the solar PV industry have increasingly acknowledged that AM services are not limited to basic day-to-day administrative tasks. Instead, the role of a competent and multidisciplinary AM service provider is crucial to minimising operational and interface risk whilst maximising the return on investment of solar PV assets.

Asset managers can be involved in all phases of the solar power plant's lifecycle from development to decommissioning, however these Guidelines focus on AM during operation – the longest phase of the project lifecycle. (For more information on lifecycle project management, see *Chapter 3*.)

- Development (typically 1-3 years)
- Construction (a few months, size-dependent)
- Operation (typically 30+ years)
- Decommissioning and disposal (a few months)

The in-depth knowledge of the assets developed during the operational phase of the PV lifecycle puts Asset Managers in a key position to influence the performance of the sites and their longevity. Asset Managers also provide vital feedback to the stakeholders involved in development and construction with the aim of optimising further the ROI of solar investments from the earliest stages of the lifecycle.

Although the solar PV industry is still developing, it already presents a wide range of well-established practices and approaches for Asset Management. This facilitates the creation of innovation niches for example in the field of digitalisation, however it also generates the lack of clarity as to what is a widely acceptable level of AM service fulfilling the main requirements of stakeholders, specifically owners, investors, lenders and other funding authorities, as well as local communities.

While a variety of international technical standards have been developed, the current level of standardization in AM remains insufficient. The typical AM scope of work varies significantly, and so does the use of advanced digital tools, both of which aspects are important factors in determining the efficiency and effectiveness of AM services.

The aim of these Guidelines is to identify the requirements for high quality AM services and promote best industry practices. The importance of Asset Management grows steadily, as the industry finds itself at an inflection point with subsidies continuously being reduced and subsidy-free PV assets requiring even tighter management to ensure that owners and investors meet their objectives.

In line with SolarPower Europe's Operation & Maintenance (O&M) Best Practice Guidelines, the value proposition of this report is its industry-led nature, gathering the knowledge and experience of well-established and leading companies in the field of project development and construction (EPC), Asset Management, O&M, utilities, manufacturers and monitoring tool providers. The scope of the current

edition includes the utility scale segment and more specifically, systems above 1MW. The Guidelines are based on the experience of companies operating globally (with a concentration in Europe), and identify high-level requirements that can be applied worldwide for the most performant AM services. Specific national considerations such as legal requirements are not included and should therefore be considered separately if the Guidelines are to be used in specific countries. The Guidelines refer to AM services as provided by a third-party service contractor - differences in approach between third-party and in-house AM are highlighted where materially relevant.

The content covers technical and non-technical requirements, classifying them when possible into the following:

- 1. Minimum requirements**, below which the AM service is considered as poor or insufficient, and which form a minimum quality threshold for a professional and bankable service provider;
- 2. Best practices**, which are methods considered state of-the-art, producing optimal results by balancing the technical as well as the financial side;
- 3. Recommendations**, which can add to the quality of the service, but whose implementation depends on the considerations of the asset owner, such as the available budget.

As for the terminology used in this document to differentiate between these three categories, verbs such as "should" indicate minimum requirements, unless specified explicitly otherwise, as in, "should, as a best practice".

1.2. What is asset management?

1.2.1. Overview

Over the past 30 years, Asset Management (AM) has evolved to become a standalone discipline. The PAS 55 ("Specification for the optimised management of physical assets"), published in 2004 by the British Standards Institution, was the first attempt at clarifying and standardising the meaning of physical AM systems. Industries such as mining, manufacturing, utilities and transport widely adopted PAS 55 and as a result the standard was accepted as a platform to develop the ISO 55000 series of international standards on "Asset Management" that

was published in January 2014 and supersedes the PAS 55 documents.

The Global Forum on Maintenance and Asset Management (GFMAM), consisting of a number of maintenance and AM organisations around the globe, was established in 2010 with the objective of aligning the Asset Management Body of Knowledge (AMBOK) through a collaborative process. The GFMAM published the first Asset Management Landscape document in November 2011, which is an attempt to build a common perspective or collective view on the discipline of AM (GFMAM 2011; IAM 2015b; Saunders, C. 2016).

AM concepts have developed over time and stem from the financial services industry that has been using the term for decades to describe the management of risk and reward within financial portfolios.

Many definitions of AM exist within literature and in practice and ISO 55000 intentionally provides a very general definition to allow the Asset Manager to apply the principles to whatever form the asset takes and determine how to derive value (IAM, 2014a). ISO 55000 defines AM as:

"the coordinated activity of an organisation to realise value from assets"

The definition provided by ISO 55000 is then qualified by the following notes:

- Realisation of value will normally involve a balancing of costs, risks, opportunities and performance benefits.
- Activity can also refer to the application of the elements of the Asset Management system.
- The term "activity" has a broad meaning and can include, for example, the approach, the planning, the plans and their implementation.

Considering the sections above, this document is a first attempt aiming at defining AM best practices in the scope of the solar industry.

Asset Managers provide a variety of services relying on multiple disciplines and skills to asset owners, investors and funders. Services provided range from technical management and site optimisation to contract and financial management. The nature of the services is multidisciplinary, as shown in Figure 1 and the best performance results are achieved through a wide and comprehensive range of services.

1 Introduction / continued

While the depth of services rendered to owners and investors varies depending on the risk attitude of the stakeholders, good quality service providers should be able to undertake responsibilities covering the business areas summarised in Figure 2. The scope illustrated in Figure 2 is in line with the structure of this document (and the structure of the O&M Best Practice Guidelines) and reflects the experience of the solar industry specifically.

The interaction with O&M service providers forms a critical part of the services rendered by Asset Managers. There is a component of oversight and control of the O&M providers performed by the Asset Manager on behalf of owners to ensure that the contractual obligations are successfully fulfilled by both parties, as well as that the PV plant is properly maintained in order to increase its performance. There are however a series of potential overlaps between the two service providers particularly in relation to Technical Asset Management and performance analysis.


These overlaps may create duplications of workload and analysis conducted by the two service providers, which is a situation that owners who perform AM in-house might be able to avoid and exploit. This generally occurs when performance analysis is carried out not only in terms of basic key performance indicators (KPIs) calculations,¹ but also in terms of root cause analysis and subsequent warranty and/or insurance claim management. Well-established O&M contractors with significant market scale tend to extend their services to cover these Technical Asset Management tasks. How these tasks are contractually allocated to the service providers is ultimately a function of an owner's operational risk policy, as well as corporate governance requirements. However, an AM provider should be able to perform a complete assessment of the technical health of a site, not only for reporting purposes, but also to comply with its general oversight responsibilities.

FIGURE 1 DISCIPLINES TO BE MASTERED BY ASSET MANAGEMENT SERVICE PROVIDERS



¹ For detailed information on PV power plant KPIs and O&M Contractor KPIs, see chapter 11. *Key Performance Indicators of the O&M Best Practice Guidelines*.

FIGURE 2 ROLES AND RESPONSIBILITIES BY DIFFERENT STAKEHOLDERS IN THE FIELD OF AM AND O&M

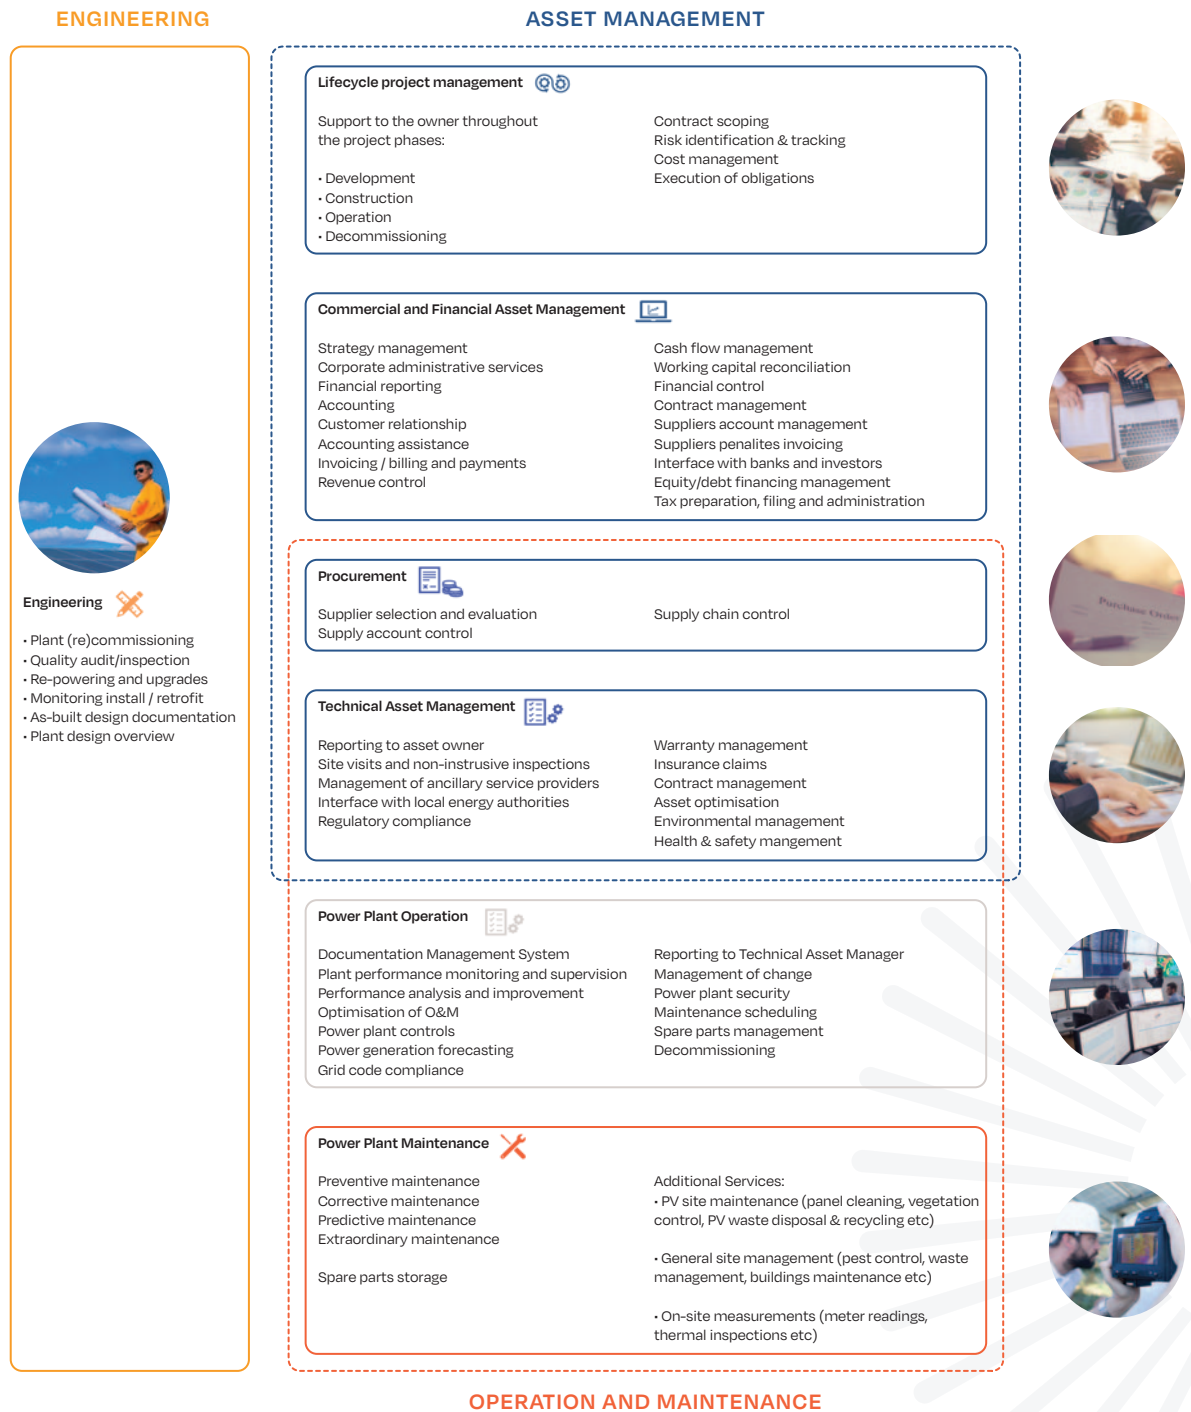

NOTE: The responsibilities of the Asset Manager and the O&M Contractor sometimes overlap, and Technical Asset Management and even some aspects of Procurement can be assumed by either the O&M Contractor or the Asset Manager.

© SOLARPOWER EUROPE 2019

1 Introduction / continued

1.2.2. Asset Management key targets

AM services should consider each solar power plant or Special Purpose Vehicle (SPV) as a stand-alone business, aimed at improving profitability by increasing revenues and reducing the levelised cost of solar electricity (LCOE).


At the strategic and risk management levels, an AM service provider should offer the site owner a clear plan to increase performance and reduce volatility, as shown in Figure 3. Solid data analytics is the basis of any performance enhancement effort. The result is not only increased production from the site, but also financial performance, which means improved cost control and reduced operating costs by holding tenders and leveraging economies of scale at portfolio level where possible.

At the tactical level, risk management is carried out within the boundaries of the contract and obligations

undertaken by each SPV, whilst the diligence of an AM service provider is critical to ensure that risks are kept up to date and are used to stabilise operation. Risk control is central to the operations of an Asset Management provider, as it is the basis for mitigation and contingency plans to be deployed on behalf of the owners.

A proactive Asset Manager will provide regular advice to the owner from both a technical and contractual perspective. This is one of the main aspects in which Asset Managers generate value jointly with the project developers and construction managers. Asset Managers can share their wealth of operational knowledge and hard data/statistics so that new projects can benefit from the lessons learned during the operational phase of existing sites. This support can range from considerations on contractual terms and operating cost assumptions to technical reports, effectively helping asset owners to validate their business cases.

FIGURE 3 STEPS TO AGREE STRATEGIC APPROACH TO INCREASED PROFITABILITY

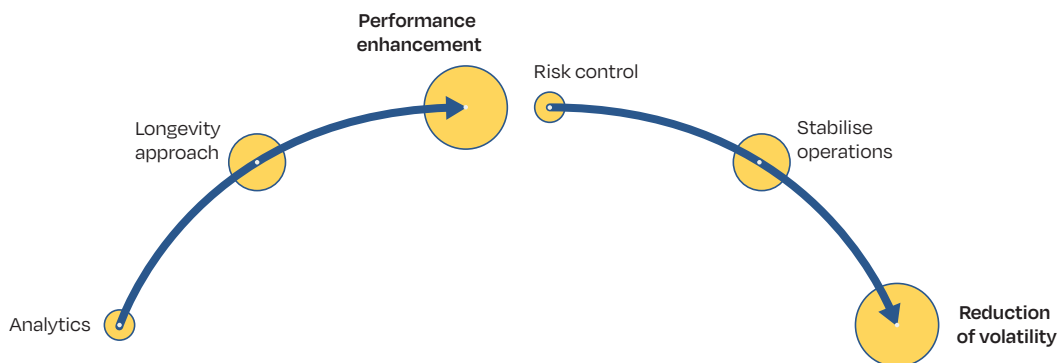

From an operational perspective, there are four pillars which should guide the work of an AM service provider in order to achieve the ultimate goal of increased profitability. These are presented in Figure 4. They apply to both technical and financial services equally, ensuring that sites are managed in a fully rounded manner.

- **Monitoring and Analysis:** focus on KPIs, inspection data and 'red flag' analysis, facilitating the identification of any specific site or portfolio-wide issues from a technical, commercial and contractual point of view;
- **Reporting and Communication:** as service providers, Asset Managers must produce tailored and timely reports to ensure that key stakeholders are informed and in control of their assets. Consistency and frequency in communication should be minimum standards set up by each AM service provider. Whilst it is widely accepted in the industry that Asset Managers provide regular monthly reports, emphasis must be given to ad hoc communications in case of emergencies, specific failures or claims;
- **Managing:** focus on problem solving of both technical failures and commercial claims;
- **Optimising:** focus on both technical improvements (whether trials of performance enhancer, repowering of key equipment) and financial improvements including tendering and re-financing.

1.2.3 Asset Management commitments and policies


AM service providers should ensure that their commitment toward stakeholders is clearly documented and reflected in both their customer and internal policies. The policies should be part of the induction and staff training to ensure they are properly understood and embraced in their current form as well as future revisions. As any other corporate policy, the Asset Management Policy should be intended as a living document, to be reviewed and updated regularly with contributions from employees, customers and other key stakeholders.

Compliance with both regulatory requirements and stakeholders' undertakings are at the heart of a successful delivery of services. Achieving this result should lead the AM service provider to set up an appropriate Asset Management System, intended as both a digitalised repository of key site information and a robust and documented set of processes and procedures to be reflected in suitably automated workflows.

This leads to a high level of standardisation and efficiency in the Asset Management services, aiming at minimising non-conformities and ultimately reducing operational risk while ensuring that stakeholder and customer requirements are met satisfactorily.

Continuous improvement programs to further increase the effectiveness of the Asset Management System should be undertaken across the organisation regularly and fed into the revision of the Asset Management Policy.

FIGURE 4 DRIVERS OF OPERATIONAL ASSET MANAGEMENT SERVICES

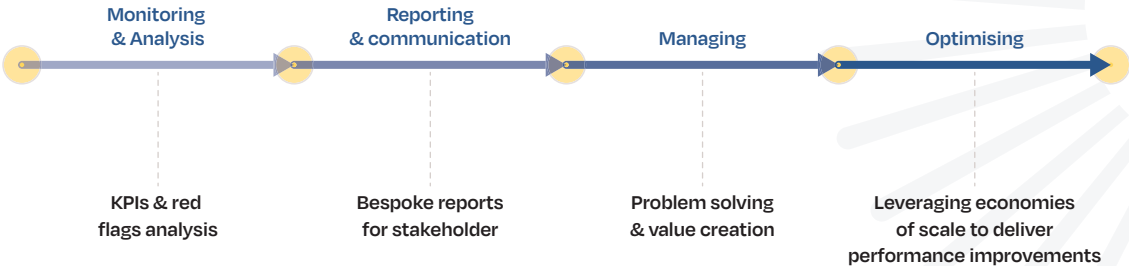

1 Introduction / continued

1.2.4 Value-added services

An asset manager, being the collector of all relevant technical and financial data and documentation related to solar plants and their SPVs, is uniquely positioned to support asset owners in their aim to maximise returns and mitigate risks in their PV portfolios.

As indicated in the following figure, in order to achieve this goal, an asset manager should adopt a holistic approach to performance optimisation. This means that it should be able to conduct an overall assessment of the various aspects that contribute to both generating cash flows and ensuring capital protection.


It is important also for the organisational structure to be designed in a way to facilitate the focus on value creation, for example by including Portfolio Managers (as also indicated in the Chapter 9. People & Skills) who have an integrated view of each portfolio and are able to work with specialist teams to identify synergies and implement the relevant actions.

Overview of the main value-added services

- **Revenue enhancement.** In relation to the revenue stream, an asset manager is able to have an impact by both contributing to maximise the plant production and obtain optimal conditions on the electricity sales price.

Plant production can be maximised by applying an accurate control on the activity of the O&M contractor and conducting data-analytics deriving from the daily monitoring as well from historical data assessment. Such analysis should allow the technical asset management team to identify interventions (e.g. inverter/modules revamping, improved layout, use of anti-soiling products, optimization of timing for grass cutting and module cleaning) aimed at improving the productivity of each plant.

FIGURE 5 INTEGRATED APPROACH TO MAXIMISE RISK-ADJUSTED RETURNS

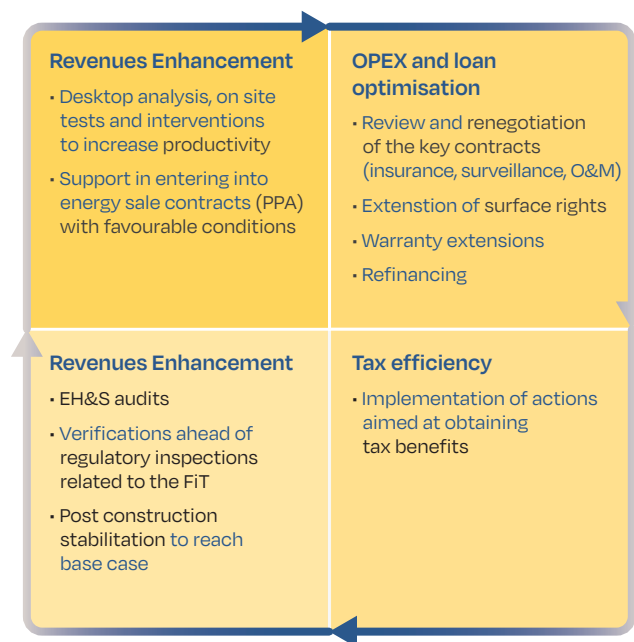

SOURCE: Relight Energy Services.

In relation to PPAs, a well structure procurement process (as also detailed in *Chapter 8. Procurement*) would allow an asset manager to ensure periodic review of the available options and run tenders in order to achieve the best economic conditions (in terms of both pricing and coverage of the unbalancing / system costs). The PPA strategy should clearly take into account the attitude towards risk of each investor as well as its knowledge of the electricity market when choosing between fixed or variable prices.

- **OPEX and Loan Optimisation.** In order for OPEX to be optimized, the same considerations applied as described in *Chapter 8. Procurement*. An asset manager should constantly monitor the market in order to keep track of average costs and apply a periodic “benchmarking” approach. The value add of the asset manager also consists in aggregating several portfolios and allows asset owners to benefit from a scale effect towards suppliers. It is important to note that OPEX reduction should be carefully assessed having in mind a trade-off with quality, when it comes to those services (O&M, tax advisory and even asset management itself) that can be considered as strategic and do not represent a commodity. In such case, a decision making process purely based on pricing reduction may not be the winning solution.

As asset manager should adopt a proactive approach also to loan management, by being constantly updated of the market conditions in the banking sector as well as on the changes in the portfolio of each investor in order to suggest the opportunity of a re-financing when it is more convenient. In many cases, even a “soft refinancing” (i.e. a renegotiation of the interest rates as well as the partial release of the Debt Service Reserve Account and other guarantees activated upon signature of the loan agreement) can be highly beneficial.

- **Tax Efficiency.** An asset manager should be aware of the relevant tax benefits available to renewable investors in each country and work closely with the tax advisor to verify eligibility and implement the relevant actions, if appropriate. With green energy being currently under the favour of the legislator, tax benefits may be a relevant contribution to the cash flow generated by solar power plants in the years ahead.

- **Risk Mitigation.** The main concern for investors that own solar power plants built under incentive schemes is to ensure the access to feed-in tariffs during the applicable time horizon. In many countries, the relevant regulatory authority (e.g. GSE in Italy, Ofgem in the UK) conduct inspections even several years after construction and providing minimum notice. As such, an asset manager should support asset owners in order for them to be comfortable about the availability and the completeness of the relevant documentation typically inspected. To this end, it is advisable to conduct pre-emptive verifications and allocate time to collect any missing documents that may not have been archived or transferred during the construction or the acquisition process.

Another relevant aspect of risk mitigation is the health & safety. An asset manager should support plant owners in ensuring the application of the relevant legal prescriptions by conducting audits on the main contractors (mainly O&M and monitoring companies), verifying that the relevant documentation is accurate and up to date and to ensure through dedicated periodic site visits that the on-site prescriptions are respected (i.e. presence of relevant signs, fire extinguishers).

In addition, a key value-added service of an asset manager consists of supporting investors during the post-construction or post-acquisition period, in order to ensure that they are effectively able to reach their base case business plan. Each item in the financial projections need to be properly monitored and it is important to strictly supervise the activity of the EPC/O&M contractors which should promptly fix any issue until the operation of the plants is stabilised. Even if a thorough due diligence is conducted, the post-construction/acquisition period can be very volatile and full of unforeseeable events and, as such, a constant on site assessment coupled with desktop analysis need to be performed by the asset manager.

Ideally, as also mentioned in *Chapter 3. Lifecycle project management*, an asset manager should be involved already during the construction/acquisition phase as it can bring its know-how and experience to optimise the technical features of the plants and anticipate issues that may become evident during the operational phase.

1 Introduction / continued

1.2.5 Stakeholders and roles

There are multiple stakeholders that interact during the operational phase of a solar PV plant lifecycle, each with different responsibilities and facing multiple possible overlapping areas, (i.e. O&M and AM providers). Some of the key roles can be summarised as follows:

- **Asset Owner:** The stakeholder that contributes to the financing of construction and operation of the PV power plant is normally the investor (or a group of investors), who can be classified as a group of private individuals, financing investors or investment funds, Independent Power Producers (IPPs), or utilities. Assets are generally owned by "Special Purpose Vehicles" (SPV), i.e. limited liability companies, specifically incorporated for building, owning and operating one or more PV plants. In some cases, when the SPV belongs to large asset owners, such as utilities or IPPs, some or all of the roles of Asset Owners, Asset Managers, Project developers, O&M providers and EPC providers may be done in-house.
 - **Project Developer:** The Project Developer is the entity that initiates the project and focuses on site selection, customer identification, conducting preliminary studies, application for permits, securing the financing and selection of the EPC provider. Project developers may own the project in the early development stages or even longer. The project developer may or may not be the same entity as the Asset Owner.
 - **EPC service provider:** The entity in charge of the engineering, procurement and construction of the solar power plant. The EPC contractor is in charge of delivering the full solar power plant to the asset owner from authorisation to commissioning and grid connection. Their role is very important in ensuring the procurement of quality components and quality installation, which have a large impact on the long-term performance of the solar power plant. Many EPC contractors offer O&M services for the solar power plants that they have developed. EPC Contractors often provide a 2-year performance warranty period after the Commercial Operation Date (COD) lasting until the Final Acceptance Certificate (FAC). In many cases it is after FAC that a third-party O&M Contractor is contracted to take over the O&M of the solar power plant. In certain mature markets the EPC role is increasingly split between different entities.
- For more information, see the EPC Best Practice Guidelines of SolarPower Europe (2020).
- **Asset Manager:** The service provider responsible for the overall management of the SPV, from a technical, financial and administrative point of view. The Asset Manager ensures that SPV and service providers fulfil their contractual obligations, and manages the site with the aim of ensuring optimal profitability of the PV power plant (or a portfolio of plants) by supervising energy sales, energy production, and O&M activities. Asset Managers also ensure the fulfilment of all administrative, fiscal, insurance and financial obligations of the SPVs. Asset Managers review the performance of the sites regularly and report to asset owners, and seeks to balance cost, risk and performance to maximise value for stakeholders. In some cases, when the SPV belongs to large asset owners, such as utilities or IPPs, the Asset Management activity is done in-house.
 - **O&M service provider:** The service provider in charge of O&M activities as defined in the O&M contract including Power Plant Operation and Power Plant Maintenance and, in some cases, Technical Asset Management. A comprehensive set of O&M activities (technical and non-technical) is presented in SolarPower Europe's O&M Best Practice Guidelines, which can be downloaded from www.solarpowereurope.org.
 - **Lender:** The lender or debt provider (financing bank) is not considered as an "Asset Owner" even if the loans are backed up by securities (collateral). In principle, the interests and performance expectations are different between the investor (equity provider) and the lender who normally measures the risk based on the debt service coverage ratio (DSCR). The role of the lender is becoming increasingly "smart" and less passive, with a focus on the requirements for the debt provision.
 - **Technical Advisors and Engineers:** Individuals or teams of experts that provide specialised services (e.g. detailed information, advice, technical consulting). Their role is important since they ensure that procedures and practices are robust and of high quality – according to standards and best practices – to maintain high performance levels of the PV plant. Technical advisors can represent different stakeholders (e.g. investors and lenders),

but often an Independent Engineer is employed, whose opinions on the technical aspects of the project are not biased in favour of any stakeholder.

- **Specialised suppliers:** Providers of specialised services (e.g. technical or operational systems consulting) or hardware (e.g. electricity generating components or security system).
- **Authorities:** Local (e.g. the municipality), regional (e.g. the provincial or regional authorities supervising environmental constraints), national (e.g. the national grid operator), or international (e.g. the authors of a European grid code).
- **Off-taker:** The entity that pays for the produced electricity. This role is still evolving and is often subdivided according to national renewable power support schemes:
 - State or national grid operator/electricity seller(s), or specific authorities for renewable energy (e.g. GSE in Italy) in a feed-in tariff (FIT) scheme.
 - Energy traders or direct sellers in a direct marketing scheme.
 - End customers in schemes that underline autonomy in energy supply.
- **Aggregator:** An entity that combines multiple customer loads or generated electricity for sale, for purchase or auction in any electricity market. From the asset owners, the Asset Managers and the O&M contractors' points of view the aggregator allows the distributed renewable energy production or storage assets to access various energy markets, such as the electricity markets, the balancing markets or other future flexibility markets. This enables direct marketing of the energy produced by distributed assets and can unlock new revenue streams from flexibility services.
- **Data-related service providers:** Providers of hardware and software solutions such as Monitoring Systems, Asset Management Platforms, Computerised Maintenance Management Systems (CMMS) or Enterprise Resource Planning Systems (ERP) or advanced data analysis providers that acquire data from the site and also analyse the data to calculate KPIs (analytical tools) and/or provide data repository for key site information whilst facilitating some administrative workflows. Site data is crucial to

ensure owners, and AM and O&M providers are aware of what is occurring on site and how the equipment is behaving throughout its lifetime. It is crucial to ensure that prompt action is taken once a fault is identified and to provide vital information on potential areas of underperformance. There is tendency in the industry to opt for solutions that integrate the functionalities of all above mentioned systems and platforms in one software, which has several advantages and can be considered a recommendation.

The boundaries between these stakeholders might be blurred depending on the specific risk attitude and business model of each player. For instance, certain owners and investors have reached scale, allowing them to develop their own in-house Asset Management practice; certain O&M service providers have strengthened their monitoring/performance/engineering teams to provide technical Asset Management services; certain off-takers have integrated vertically and become developers, owners and operators of their own assets; corporate off-takers- have shown increasing interest in owning and managing the operational data of the sites they purchase electricity from.

This constant evolution of roles further emphasises how a multidisciplinary approach to AM is necessary to provide successful service to owners and lenders.

1.3. How to benefit from this document

This report includes the main considerations for a successful and professional AM service provision. Although it has not been tailored for each stakeholder, the purpose of the document is similar for all: understanding the mandatory requirements and the necessity of professional AM services and incorporating the recommendations accordingly into the service package for more performant AM services. Any of the directly relevant stakeholders (as described above) can benefit from this work, tailor it to their needs without lowering the bar, and know what to ask for, offer or expect. The Guidelines are particularly useful for the Asset Owners to understand what the standard of a quality Asset Management service should be. Although the focus is European, most of the content can be used in other regions around the world. The requirements described in the Guidelines apply without changes in other regions and additional requirements or modifications can easily be made for other regions with unique characteristics.



This chapter introduces a basic set of definitions of important terms that are widely used in solar Asset Management, of which all stakeholders should have a common understanding.

Although there are standards in place that explain some of this terminology, in practice, it is still difficult to agree on the boundaries of certain terms and what exactly is expected under these terms or services (e.g. technical Asset Management).

Rather than reaching a conclusive list for the field of Asset Management, the aim of this section is to provide a short, non-exhaustive collection of terms (alphabetically ordered) that reflects the content of this guide. Normative references such as ISO 55001:2014, SolarPower Europe's Operation & Maintenance Best Practice Guidelines (Version 4.0), European Norm 13306, and PAS 55-1:2008 (3.9) were used as a basis.

Advanced Data Analysis	The autonomous or semi-autonomous analysis of data using specifically developed algorithms and techniques which delve deeper than standard monitoring capabilities allow to discover deeper insights, make predictions and generate recommendations.
Asset portfolio	Group of assets that are governed by the same regulations and obligations. A portfolio is typically established and assigned for managerial control purposes and is usually defined by country, monitoring provider, O&M contractor or another category.
Asset Management	Asset Managers are responsible for the commercial and financial management of a solar investment and the supervision and control of technical activities. They manage a company or a portfolio rather than a power plant, often across different geographies, dealing with a variety of regulatory frameworks and business models. Asset management is also defined as the coordinated activities of an organisation to generate value from its assets (ISO 55000).
Asset Management Platform	A software package or suite of tools that is used by the Asset Manager to store and manage technical and non-technical data and information collected from and relating to the solar asset, portfolio or SPV. It combines the abilities of a Computerised Maintenance Management System (CMMS) and an Enterprise Resource Planning System (ERP).
Cash management	Managing treasury activities and monitoring the cash available in every period for a PV plant or an SPV. Examples of these activities are adjusting payments according to predicted income dates, assuring liquidity to comply with debt service schedule, making repayments of loans (interest and principal), and distributions to the SPV shareholders.

Computerised Maintenance Management System (CMMS)	A software designed to measure and record various O&M KPIs (e.g. Acknowledgement Time, Intervention Time, Reaction Time, Resolution Time) and equipment performance (e.g. Mean Time Between Failures) and thus optimise maintenance activities.
Contract management	Building, developing and maintaining business relationships with counterparties of different contracts. This includes selecting service providers, holding negotiations with banks, landowners and operations providers, managing insurance and warranty claims, as well as ensuring compliance of the contractual obligations, such as notifying, filing and reporting.
Corrective maintenance	Actions and techniques (immediate or deferred) taken to correct failures, breakdowns, malfunctions, anomalies or damages detected during inspections, or through monitoring, alarming, reporting or any other source. These measures typically generate follow-up work orders, which are formal requests assigned to an authorised person so that a job or task can be carried out.
Degradation	Decrease in the efficiency of a solar plant with the passage of time. Usually, at least 80% of the original output is expected within a 20-year period.
Development (Project Development)	Development is the phase that precedes the EPC phase in the lifecycle of the project. It usually includes the initiation of the project, site selection, customer identification, conducting preliminary studies, application for permits, securing the financing and selection of the EPC contractor. Project developers may own the project in the early development stages or even longer (Note that "development" is sometimes used in a way that includes "Engineering" and "Procurement" also, however in the terminology of these Guidelines this is not the case).
Digital Twin	A digital incarnation of the entire solar plant which delivers both the geospatial and electrical context of individual components and allows the recording and display of data and files against these components.
Documentation Management System (DMS)	A management system that records, manages and stores documents required for O&M and AM, such as technical plant and equipment documentation and drawings, maintenance manuals, photos and reports, including the various versions that are being created by different users, reviews and approvals. Documentation management system also defines a proper format and use (information exchange). Due to the increasing complexity of documents and in order to enable advanced analytics, electronic DMS with the ability to handle meta-tags and searchable, editable documentation is becoming a best practice.
Distribution System Operator (DSO)	Entity responsible for distributing the electricity from the transmission grid to end users (households/businesses) and maintaining the distribution networks.
Engineering, Procurement, and Construction (EPC)	EPC refers to companies that deal with the Engineering, Procurement, Construction and Commissioning of solar systems. The EPC contractor is in charge of delivering the full solar power plant to the asset owner from authorisation to commissioning and grid connection. For more information, see the EPC Best Practice Guidelines of SolarPower Europe (2020).
Enterprise Resource Planning System (ERP)	A business management software that a company (such as an O&M contractor or an Asset Manager) can use to gather, store, manage and analyse all types of data relevant for their operations.
Environment, Health & Safety (EH&S)	EH&S indicates the policies and guidelines formulated to ensure environmental protection, occupational health, and safety at work and on site, applicable to staff and visitors according to European and national laws and regulations.

2 Definitions / continued

Event	An unplanned occurrence related to the SPV the PV plants it owns. The event can be a technical incident or an issue in business operations. Examples of events are component failures, vandalism, theft, grid outage, storm damage, and landscaping issues.
Feed-in tariff (FiT)	A policy mechanism (designed to accelerate investment in renewable energy technologies) which remunerates, through a long-term contract, a fixed electricity price to renewable energy producers for each unit of energy produced and injected into the electricity grid.
Final Acceptance Certificate (FAC)	The Provisional Acceptance is followed by a standard term of two years during which the EPC Contractor guarantees a minimum Performance Ratio (PR). At the end of this period, the Final Acceptance Certificate (FAC) is issued by the owner, which means that the PR measured over the two years has met the contractual obligations. After FAC, the owner takes over the full responsibility for the plant.
Generation forecasting	Estimation of the amount of energy a solar power plant will generate in the future in order to determine a project's financial risk. Commonly used estimates are P50, P75 and P90. P50 is essentially a statistical level of confidence suggesting that we expect, with 50% probability, that the predicted amount of generation may be exceeded.
Good industry practice	Good industry practice means those practices, methods, techniques, standards, codes, specifications, acts, skills and equipment generally applicable in the international solar power industry (including construction and installation of solar power facilities) and followed or used by good contractors that, in the exercise of prudent, proper and good judgment, in light of the facts known or that reasonably should have been known at the time a decision was made or an action taken or omitted, would have been expected to accomplish the desired result in a manner consistent with applicable laws and permits, are reliable and safe, protect the environment, are economically efficient and are done with the degree of skill, diligence and prudence that would ordinarily be expected. Whereas "good industry practice" is a legal term often used in contracts, "best practice" is a term used in these Guidelines as defined in section 1.1. Rationale, aim and scope.
Irradiation	The solar radiation incident on a solar panel over time, relative to its area. It is usually expressed in watt-hours per m ² . It plays an important role in the determination of the optimal inclination angle of PV modules and the profitability of a PV system.
Key Performance Indicators (KPIs)	Technical and financial parameters that help stakeholders to evaluate the operation and performance of an SPV and the PV plants the SPV owns. Solar KPIs include: Nameplate Capacity, Irradiation, Generation, Availability, Performance Ratio, Free Cash Flow and IRR.
Monitoring System	The digital platform used for the overall management of the PV plants or PV plant portfolio. It allows a centralized monitoring of the functioning, energy generation and reference data of the PV plant and its components. This is ideally performed through near-real-time monitoring module that retrieves data from the local SCADA systems. It also typically includes operational modules such as ticket dispatching, analytics and reporting. The monitoring operates 24 hours a day, all year, and is fed by in-plant data logging systems (or SCADA) as well as by irradiation and temperature measurements from particular sensors and other sources such as meteorological information.

Monitoring System	The digital platform used for the overall monitoring of the functioning, energy generation and reference data of the PV plant and its components, which is performed through real-time monitoring software. The monitoring operates 24 hours a day, all year, and is fed by in-plant data logging systems that collect data from different plants as well as by irradiation and temperature measurements from particular sensors and other sources such as meteorological information.
On-site consumption	The consumption of all or part of the energy from a PV plant at the same location where it is produced. If the energy is consumed by the person or entity that owns the PV plant, this is referred to as self-consumption or auto consumption. If the PV plant is owned by a different entity than the entity who consumes the energy, this is referred to as "third party ownership" and the consumption is typically governed by a PPA.
Operation and Maintenance (O&M)	O&M includes all the services that ensure maximum efficiency and maintenance for a PV plant. The services include monitoring and supervision; predictive, preventive and corrective maintenance; performance analysis and improvement; power generation forecasting and site security management.
Operating expenses	Operating expenses for a PV plant include rent, insurance, security, O&M service, Asset Management service, PV monitoring, utility fees, and bank fees.
Power Purchase Agreement (PPA)	Contract of electricity supply between a party generating and selling electricity, and a party purchasing electricity. The PPA defines the conditions of the agreement, such as the amount of electricity to be supplied, point of interconnection, applicable rate schedule, production guarantees and penalties for non-compliance.
Preventive Maintenance	Actions, testing or measurements to ensure optimal operating conditions of equipment and of the entire PV plant, hereby preventing defects and failures. Preventive maintenance takes place periodically, and according to a specific maintenance plan and maintenance schedules.
Project financing	PV projects are often financed by a combination of equity and debt. Loan agreements for project finance will rely on the project's cash flows for the repayment of principal and interest. The project's assets and asset rights are held as collateral by the financing institution.
Provisional Acceptance Certificate (PAC)	The Provisional Acceptance Certificate (PAC) is issued at end of the construction works after a short period of Performance Ratio (PR) test period and means that the PR meets the contractual obligations. Through the PAC, the Asset Owner gives conditional acceptance of the works, pending confirmation of the PV plant performance which needs to be proven, within a standard 2 year warranty period that starts with Provisional Acceptance.
PV Power Plant	An independent electricity generating entity (PV panels and Balance of System), which possesses its own set of operational and financial contracts.
Regulatory and statutory compliance	Compliance to any law, statute, directive, regulation, policy or rule issued by a competent public authority: either by the government (statutory) or by a regulatory agency (regulatory). The compliance is applicable in the country or in the corresponding administrative unit where the SPV and PV plant is based and/or where services are provided.

2 Definitions / continued

Reporting	Regular deliverables to various project stakeholders (investors, banks or management), detailing operational and financial performance of an asset portfolio, SP or individual PV plant, Reports usually include KPIs in graphical and tabular form, comparison of the KPIs against forecast, events, risks and a narrative detailing performance for the period.
Revenue Management	Set of practices and activities aimed at maximising the revenue from PV plant operations. This includes electricity invoicing, verifying settlements, day-ahead or intra-day generation forecasting, sale of certificates, efficient incident resolution and receivable management.
Risk	Risk is defined as the “effect of uncertainty on objectives”. The major categories of PV risks include, but are not limited to financial risks, country and regulatory risks, contractual risks, commercial risks, technical risks and reputational risk.
Risk management	The practice of identifying and analysing the risks to which solar power systems and operations are subjected and taking steps to mitigate them. The different risk management methods are risk avoidance, risk reduction, risk control, risk transfer. The risk that cannot be mitigated is called residual risk.
Spare parts management	Activities that ensure the availability of the right amount and type of components, equipment, and parts, either on site or in warehouses or in O&M service provider’s stocks, for prompt replacement in order to minimise the downtime of a PV plant.
Special Purpose Vehicle (SPV)	A company with its own rights, assets and liabilities, created for building, owning and operating one or more solar power plants. The SPV is also referred to as SPE (special purpose entity) or as a project company.
Supervisory Control and Data Acquisition (SCADA)	Supervisory Control and Data Acquisition (SCADA) is a data acquisition system that connects various hardware and software components in a given site and is used to monitor and control the solar power plant remotely. SCADA systems are typically employed to send data to a centralised Monitoring System for monitoring and analytical purposes (see definition for “Monitoring System”).
Technical Asset Management	Technical Asset Management includes monitoring the production and status of a number of PV assets, visiting PV plants to conduct field-based assessments, working with O&M contractors, and producing performance reports to internal and external stakeholders, as well as preparing any documentation needed for public and governing bodies.
Transmission System Operator (TSO)	Entity responsible for controlling and operating the transmission grid, which usually comprises the voltage levels of 220 kV and 380 kV in Europe. The operations include monitoring and controlling the current grid topology (position of breakers and switches within the grid), as well as the voltage, in all parts of the transmission grid. Any planned PV plant outages need to be communicated to the TSO.



Lifecycle project management

Asset Managers can be involved in all phases of the solar power plant's lifecycle, from development to decommissioning. Most of the content of the Guidelines focuses on Asset Management during the operational phase – the longest phase of the project lifecycle – but this chapter presents an overview of lifecycle Asset Management with roles and tasks in all project phases.

3.1. The key stages of a project

Over the lifetime of an asset, from inception to disposal, the generating plant and its operating company – typically a special purpose vehicle (SPV), which is the primary counterparty to the contracts and ownership documents that underpin the value of the plant – move through a number of definable stages.

These stages are typically marked by changes in contractual liability and obligation, and the transitions or 'stage-gates' between phases are usually marked by the execution of contractual documentation, such as contracts or 3rd party certification defined by the contracts and underpinned by appropriate supporting documentation.

An effective Asset Manager will ensure that at each of these 'stage-gates', risks are managed effectively through the transition and activities during the phases between the stage gates are well managed on behalf of the plant owner, from a financial, technical, as well as contractual perspective.

This activity may be described as 'lifecycle project management' and the characteristics of the stages on either side of the operational phase are outlined in this chapter. Asset Management activities covered throughout the rest of this document relate to the management of the plant and SPV during the operational phase.

3.2. Overview of the role of asset manager through the lifecycle of the project

Typically, an Asset Management team or function will draw upon, support and oversee the activities of other teams of specialists in each phase. In the case of the operational phase, this will typically mean the O&M contractor, with the Asset Manager acting in a supervisory role with responsibility for managing escalations and validating delivery.

At other stages, the Asset Manager will work with the key delivery partners shown in Table 1 to ensure that value is protected, risks managed, and contractual obligations are fulfilled.

3.3. Core competencies needed for lifecycle project management

Throughout the lifecycle of the plant and at each stage, the Asset Manager will manage six core competencies – listed below – across the technical, financial, and contractual functions of the role. In this section we focus on those competencies, which are particularly important to maintain throughout the stage-gates of the project lifecycle.

3 Lifecycle project management / continued

TABLE 1 KEY STAGES OF PROJECT LIFECYCLE

	STAGE (OR PHASE)	DURATION	STAGE-GATE(S)	PRIMARY FOCUS OF ASSET MANAGEMENT TEAM	KEY DELIVERY PARTNERS
1	Development, Engineering, Procurement	1-3 years	Pricing; Investment Committee; Financial Close;	Contract scoping; documentation & certification requirements; risk identification	Developer/ owner/investor
STAGE-GATE		Start of construction			
2	Construction	A few months	Construction milestones; connection; commissioning;	Cost management; milestone documentation; risk tracking; variance tracking	EPC Contractor
STAGE-GATE		Provisional Acceptance Certificate (PAC); Transition from Construction to Operation			
3	Operation under EPC warranty	Up to 3 years	Intermediate Acceptance (IAC)	Performance oversight; warranty maintenance; financial management	EPC Contractor
STAGE-GATE		Final Acceptance Certificate (FAC)			
4	Operation under ownership	30+ years	Handover; Onboarding; Repowering	Financial; technical; contractual management – as detailed throughout this document	O&M Contractor
STAGE-GATE		Start of decommissioning			
5	Decommissioning & disposal	A few months	Completion of decommissioning	Execution of obligations	O&M Contractor

Stage-gate management The Asset Manager should ensure, at each transition between stages and at milestones (such as construction milestones or interim acceptance testing), that the required documentation associated with risk management, value protection and performance is validated and stored.

Documentation management The Asset Manager should ensure that there is an index and dynamic mechanism for the storage, version control and retrieval of static and dynamic documents which underpin the value of the plant and relate to the technical, financial and contractual management of the plant. A best practice is to utilise software which provides ‘full text indexing’ and/or meta-data tagging when storing new or onboarding information.

Information management is something the Asset Manager will develop throughout the lifecycle of the plant, through an Asset Register. Operational data also needs to be considered utilising systems such as SCADA. Inspection and testing data is ideally stored

within a Digital Twin of the asset to enable the Technical Asset Manager to better understand the holistic view of asset health and performance.

Risk management The Asset Manager will have a mechanism for tracking key risks through each phase of the project lifecycle.

Ideally, this register is pre-loaded at the development phase of the project lifecycle, with key risks being identified as part of the owner’s decision to invest and through the due diligence activity of the legal and technical advisors.

It is recommended that Asset Managers consider requesting the certification of power plants through their life cycle to international standards via available international certification schemes or conformity assessment systems. See also *Chapter 4. Risk management in the operational phase* of the Asset Management Best Practice Guidelines and *Chapter 4. Risk management in the EPC phase* of the EPC Best Practice Guidelines (SolarPower Europe, 2020).

3.4. Activities at key stages

The best practice activities for the Asset Manager at each stage are outlined below. This is an addition to the core financial, legal and technical responsibilities detailed in the rest of this document.

Crucially, there is a key role to play within the Asset Manager's remit of tracking and managing risk throughout the lifecycle of the plant and the stage-gates between stages offer an opportunity for the Asset Manager to put in place controls.

Stage 1: Development, engineering and procurement (pre-construction)

This phase covers all the activity undertaken, up to the point where the project may be described as 'shovel-ready'. Usually, the activity at this stage is focused on the technical and financial development of the project, with a series of transactional milestones such as investment committee approval, EPC execution and financial close.

Typically, this activity is driven by the developer and the transaction team of the owner, supported by legal and technical advisors. However, it is at this stage that timely contributions from the Asset Manager serve most effectively to avoid problems later in the lifecycle of the project. Invariably the AM team will be the only group with long-term involvement in the project lifecycle. An experienced AM service provider will know the issues that can emerge later in the process as a result of ambiguous drafting of EPC terms.

This might be illustrated by the example of documentation requirements associated with the earthing of the plant. Typically, a subject of little interest to the deal team and therefore might be reflected under all-encompassing, but generic terms, such as "the contractor will provide all relevant documentation relating to the earthing of the plant" and "all relevant 'as-built' documentation". With timely involvement from the EPC contractor in collaboration with a sound technical advisor a full list of required documentation can be defined, making the job of the Technical Advisor at the point of post-construction acceptance much less liable to interpretation at a point where pressure to complete is high.

In addition, the Asset Manager should be involved at the transition between transaction and construction to ensure that immediate obligations can be met which might otherwise be missed as the legal teams construct and distribute the hard copy forms of the deal bible. For example, a construction bonus may have been agreed with the landowner and with lease agreement typically not requiring the landlord to issue an invoice, this type of payment can be missed during the period immediately after signing.

As a best practice, the AM provider should be able to undertake a review of all key documentation at point of signing and prior to construction starting:


- EPC documentation – requirements relating to milestone sign-off (see also the EPC Best Practice Guidelines (SolarPower Europe, 2020));
- An agreed form of project summary document including summary of key contracts in place (and t.b.d., such as insurance) and key obligations and timing therein;
- An agreed form of risk and variation register or RAID (Risks, Actions, Issues and Decisions) log (to ensure that 'orange' issues raised through legal, technical or commercial due diligence are flagged for monitoring as the project goes live, and any 'red' flagged items have suitable mitigation actions in place);
- Contract audit – to identify timing of key obligations and expiries (for example, energy import pricing may be on a temporary tariff throughout the construction period and revert to more expensive default tariff during the first year of operation);
- Documentation Management System to allow a smooth transition from legal 'Deal bible' to operational documentation management.

Stage 2: Construction

During the construction phase the Asset Manager will be focused on tracking adherence to planned milestones and ensuring that documentation at each stage of build, relating to components of the plant, is in order. In addition, variations to the plan should be captured. See also the EPC Best Practice Guidelines (SolarPower Europe, 2020).

3 Lifecycle project management / continued

FIGURE 6 EXAMPLE OF HANDOVER DOCUMENTATION AND PROCESS AT THE START OF THE CONSTRUCTION PHASE

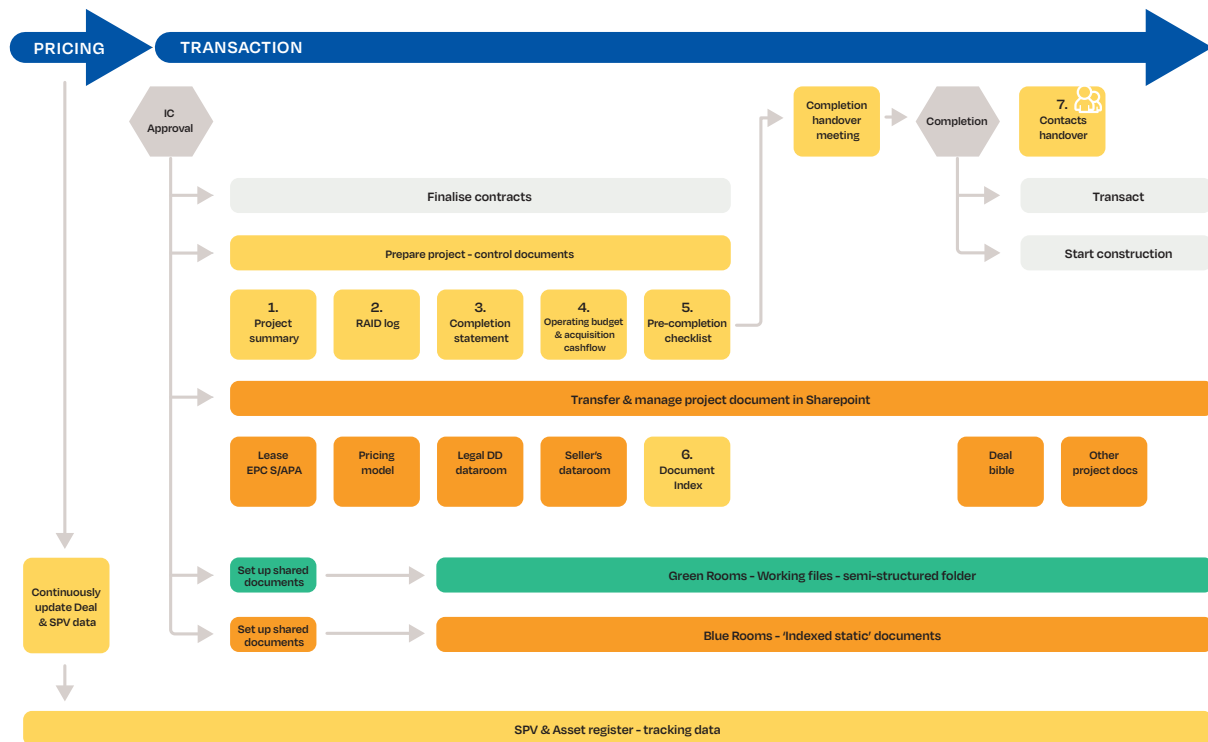

Stage-gate: Transition from construction to operations

Crucial is to ensure appropriate documentation is captured at the commissioning and testing stage. Working closely with the clients and Technical Advisor, the Asset Manager will be ensuring the comprehensive management of documentation relating to commissioning components and capturing issues emerging from audit to ensure effective triage and timely resolution.

Stage 3: Operation under EPC warranty

EPC Contractors usually provide a 2-year performance warranty period after the Commercial Operation Date (COD). During the warranty period, it is the responsibility of the Asset Manager to monitor, calculate, report and follow up the values of Performance Ratio and other KPIs guaranteed by the EPC Contractor.

Within this scope, it is the responsibility of the Asset Manager to:

- Manage the interventions done within the scope of the warranty in order to safeguard the performance commitments undertaken under the contract;
- Periodically inform the Asset Owner about the condition of the contracted performance indicators;
- Immediately alert the Asset Owner whenever the levels of the indicators have values or tendencies that could indicate a risk of failure.

As part of best practice, the Asset Manager should pre-empt issues of equipment life expectancy through the effective management of an asset register.

During the warranty period, issues can occur in the plant, which the EPC provider is liable for. The Asset Manager is in charge of resolving these issues in line with what is described in section 6.5. *Warranty management*.

Stage 4: Operation under ownership

The activities to be covered by the Asset Manager in the operational phase are described in chapters 6, 7 and 8 of these Guidelines.

Stage 5: Decommissioning & disposal

Once the solar asset reaches its end of life, the Asset Manager should provide the Asset Owner with recommendations of options to do the decommissioning & disposal in line with applicable legal requirements. It is a best practice for the AM service provider to create a matrix of obligations and actions and track its fulfilment.

3.5. Lifecycle lessons learnt and feedback loop

Projects that have reached the operational stages of the lifecycle represent a significant learning opportunity from a technical, contractual and financial perspective.

The experience and operational data available to AM service providers and Asset Owners can educate the stakeholders and improve their investment decision processes in two ways:

- Providing realistic, tested and proven assumptions (both from a technical-operational perspective and from a financial-commercial one); and
- Identifying areas of improvement impacting positively the overall investment return.

Carrying out lesson learnt from the operational phases is an ultimate driver of additional value to be extracted

from the PV plants. More specifically the feedback loop has proven effective in identifying added value opportunities such as:

- Re-assessment of yield assessment based on reliable site data and generally improving the overall production expectations;
- Fine tune contracting strategy (simplification of complex or redundant processes set forth in complex contracts, for instance the final acceptable processes);
- Re-definition of scope of work of main service providers rebalancing pricing and services wrap;
- Strengthen criteria for election of key component suppliers and manufacturers; and
- Increase sophistication and appropriateness of spare parts strategy on a site and portfolio basis.

To take full advantage of the knowledge created by the operational phases of the lifecycle, AM service providers and Owners must deploy a data driven and analytical approach from the very early stages of operation of the PV plants. This data is vital to establish and carry out a meaningful risk assessment and overall review of the PV plant as an investment. As described in the Introduction (see Figure 3), this risk driven approach is the foundation leading to stabilising operations and therefore reduce the overall volatility of the investment in the PV plants.

FIGURE 7 LESSONS LEARNT AND FEEDBACK LOOP PROCESS





This chapter focuses on the risks emerging from the commercial operation date (COD). Risks associated with the inception phase are discussed in the current version of SolarPower Europe’s EPC Best Practice Guidelines. In this context, particular attention might therefore be given when it comes to the handover of assets as discussed in Chapter 5. At that point, understanding the risk exposures from an EPC perspective is indispensable.

Furthermore, the risks discussed in this chapter can hardly be directly attributed to individual chapters, and therefore, it is highly recommended to appreciate the content in the following chapters and to relate them to the risks in this chapter as appropriate for the individual situation.

Whilst solar asset owners establish their specific risk framework, governance and guidelines based on their unique risk appetite and investment criteria, Asset Managers play a crucial role in managing such risks and deploy or recommend mitigants to the owners. Based on the risk management governance established by the Owner, the Asset Managers might be called to review risks and deploy lesson learnt at different pace; an annual risk review of the key risks highlighted below is recommended as minimum standard to establish between Owner and service provider.

4.1. Definition of risk and risk management

Risk is generally defined as exposure to the possibility and the probability of damage, injury, liability, loss, or any other negative occurrence that is caused by external or internal vulnerabilities, and that may be avoided through preemptive or other action. In an attempt to standardise the terms risk and risk management, the authors refer also to ISO guide 73 and to ISO 31000:2018. ISO guide 73 defines risk more simply as “effect of uncertainty on objectives”:

TABLE 2 DEFINITION OF RISK

Effect	Positive and negative deviations from the expected
Uncertainty	State – even partial – of deficiency of information related to, understanding or knowledge of, an event, its consequence, or likelihood.
Objective	<ul style="list-style-type: none"> • Different aspects: financial, health and safety, environmental etc. • Different levels: strategic, organization, project, product, and process

ISO 31000:2018 provides generic guidelines for the design, implementation and maintenance of risk management processes throughout an organisation, see Figure 8 below.

To effectively manage risks, it is mandatory to analyse the risk exposure. This involves the identification of the risks at play, the measurement, most importantly by assessing the impact and the likelihood in the case of occurrence, and to evaluate the risks as a result.


Managing risk on the other hand, involves a closed loop process: As a first consideration, risks can be systematically avoided or at least reduced by mode and setting of operational parameters. Unavoidable risks can be mitigated by controlling the risk and continuous process improvements, e. g. involving a failure mode and effect analysis. Risks can be

transferred by various measures, e. g. contractually by shifting the responsibility of certain processes to another party, by buying cover through an appropriate insurance, or by simply setting up a purpose specific limited liability company (so called "SPV"), to name a few. Finally, it is highly recommended to accept and to monitor and report residual risk to ensure that risk exposures remain within manageable limits.

4.2. Financial risk factors

Asset management actually starts from the very beginning of the project. The SolarPower Europe EPC best practice guidelines deal with risk management until commercial operation date (COD) while this chapter deals with risks starting with COD. A selected number of financial risk factors are explained in Table 3 on the following page.

FIGURE 8 RISK MANAGEMENT STRATEGY CHART

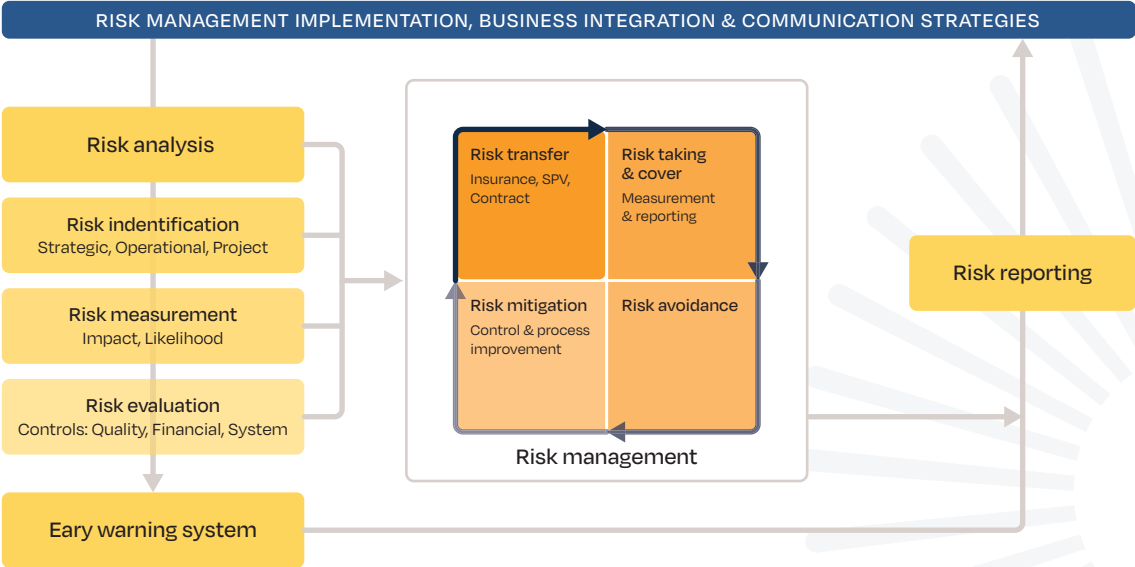

SOURCE: EXXERGY.

4 Risk management in the operational phase

/ continued

TABLE 3 FINANCIAL RISK FACTORS

Exchange rate	Exposure to different currencies might affect the financial performance of a solar PV plant primarily when purchasing spare parts or when the investment currency is different from the currency of the cash flow return on investment.
Power price fluctuation (merchant plant)	Since the market for solar PV generation has started to move towards so called merchant business models meaning that the power purchase price may be fixed based on fluctuating market conditions, the quality of financial returns are naturally influenced by such fluctuations. It is recommended to thoroughly analyze and weigh upsides and downsides carefully.
Refinancing	Refinancing risks are generally triggered by 2 factors, the inability to restructure the debts because of malperformance of the PV power plant or by the simple difference of refinancing conditions – including leverage rate and interest rates – at the time the refinancing becomes necessary.
Trading risks (cannibalization, negative pricing)	With the increased dispatch of renewable generation (and solar in particular) and fluctuation of demand for given time span, the risk of over generation and negative pricing is becoming a more likely risk that solar generators have to account for. Whilst cannibalization is not easy to predict and depends on each country energy mix, electricity use pattern, and electricity market regulations, it is critical for assets owners and AM service providers to consider mitigation measures such as e. g. enabling demand based power dispatch by securing storage capacities.
Solvency of off-taker	(see section 4.6. Commercial risks)

4.3. Regulatory and policy risk factors

This section provides a short overview of regulatory and policy risks. Regulatory risks are related to e. g. adjustments in government schemes that can possibly be imposed at any time during the lifetime of

a PV power plant project, sometimes even retroactively. Such risks typically materialize when a scheme is overstretched vs. the original intent or vs. the government budget capacity or when the political intentions of energy policy change generally. The following table shows some examples.

TABLE 4 REGULATORY RISK FACTORS

Regulatory changes (e. g. grid code change, (retroactive) change in off-take price)	Over the course of the past 10 years, the solar industry in Europe has faced number of significant changes in law that have affected not only development but also operation of solar PV sites. From changes (whether retroactive or otherwise) to the subsidy schemes to new requirements embedded in grid codes and distributions networks operations, solar PV plants have faced potential reduction of revenues (reduction of subsidies, increase in grid constrains) as well as the potential for increased operating costs to allow operation within new grid connection parameters or to comply with new tax regime imposed from time to time.
Political risks	Overall, renewables have enjoyed a general political support. Whilst has supported the growth of the industry with the introduction of subsidy schemes, it has also increased the dependency of the industry toward political decisions. These can range from local government change of attitude toward renewables as well as central governments needs to limit the costs associated to subsidies schemes.
Government imposed compliance assessment risks	Almost in every jurisdiction in which renewables have been sustained by subsidy schemes, governments and regulators have maintained a right to inspect and audit renewable plants to ensure that subsidy eligibility criteria are met. For a reasonably young industry, like solar, with limited benchmarking and track record, it has proven more challenging to ensure that all documentation is readily available for inspection.

4.4. Contractual risk factors

Contractual risk is defined as the probability of a loss arising from either one of the following two situations:

- The chance of facing losses as a result of the buyer not fulfilling the terms of a contract; note that if the buyer is incapable of paying this is another risk category.
- The chance of facing losses from the deal performing poorly. Sellers face the most danger in fixed-price contracts and the least in cost-type contracts.

Practically, not all risks can be addressed and assigned in contracts. To tone down contractual risks several steps can be taken to manage contractual risks, for example:

- Discuss with people from various departments of your organization to determine risks.

- Evaluate and estimate the likelihood and severity of the risk involved in the contract.
- Consider if any high-risk work is worth taking on. If not, reject the project as necessary.
- Evaluate your business partners re financial stability and actual business conduct.

These steps should function like clockwork within the organization. Otherwise, one may find oneself inundated with unforeseen issues. By that point, it will be far too late to apply measures to offset the damages.

4.5. Technical risk factors

Even if PV technology is in general rather simple, there are several risks due to the rapid evolution in this sector and the exposure of PV plants to environmental risks, see Table 5.

TABLE 5 TECHNICAL RISK FACTORS

Major module serial problem	Rapid evolution of photovoltaics means that module technology changes continuously and radical changes are common. Combined with the high dynamics of the PV market, this gives room for chances, but also for risk. This may not be neglected, because the PV module is one of the central elements of a PV system, and it is the most expensive to replace. Therefore, an asset should consist of solidly performing and low-cost maintenance components. Systems such as IECRE can support the evaluation.
Disposal/ Recycling	Disposal of plant components at end of operations represents a cost risk. This is especially true for PV modules and inverters, whereas disposal of most balance of system (BoS) components may be less challenging, because value of raw material tends to rise (support structure, cables) and the amount of other electronic waste is negligible.
Technical performance risks	During operations technical performance of the PV plant needs to be monitored in order to detect any faults, including serial faults, increased module degradation etc., inverter performance etc.
Operational risks	The PV power plant may experience important underperformance if the O&M contractor does not fulfill his contractual obligations. The problem is that this may not manifest itself at once as losses in production, and an asset manager may become aware of any deviations only at a later point in time. Therefore, asset managers should always stay in communication with O&M contractor and eventually inspect sites spontaneously or at times even unannounced.
Environmental risks	Among the environmental risks climatic change is a general topic. This may lead to higher irradiation, but also to higher wind speeds and a higher frequency of more impacting meteorological phenomena like violent thunderstorms, tornados, hail etc. Long periods of drought may increase risk of fire and reduce permeability of soil. Events of strong rain, eventually combined with an insufficient quality of the drainage system, may result in a high risk of flooding, increased erosion, or even more violent events like landslides. This risk may be even more important, if slope of terrain is high. Site-specific risks include also the risk of inherited pollution. In fact, developers are often encouraged to plan PV plants on industrial wasteland, in order to reduce the use of valuable agricultural land. Since the plant owner needs a real property right on the building site, he becomes also responsible for the site and the pollution on it. Hazards due to pollution, for example for ground water, may oblige him to rehabilitate the site, and this may result in high additional costs, which have not been considered in the business plan.

4 Risk management in the operational phase

/ continued

A lot of these technical risks result from improper practices during the inception phase of the project, therefore, it is recommended to refer to SolarPower Europe's EPC Best Practice Guidelines (2020).

4.6. Commercial risks

Commercial risks (contract interface risks) arise predominantly when individual contracts between adjacent stakeholders are not defined "back-to-back" meaning that the interfaces are seamlessly defined in the chain of contracts. Naturally, identifying any gaps and the resulting risks for an asset manager are essential. To illustrate the risks more practically, Table 6 outlines exemplary commercial risks:

4.7. Risk transfer

Risk transfer refers to a risk management technique in which risk is transferred to a third party. In other words, risk transfer involves a party assuming the liabilities of another party. There are two common practices to transfer risks as shown in Table 7.

Figure 9 provides an overview of insurance solutions commonly requested in the photovoltaic industry, based on a detailed insurance study and market analysis (EXXERGY, 2018).


TABLE 6 COMMERCIAL RISKS

Risk of concentration	Especially in the situation whereby the electricity produced by a PV power plant is sold on the merchant market (e. g. day-ahead market), an inherent selling price risk becomes evident as the concentration of power generation plant increases in a given geographic neighborhood. Proper price forecasting methodologies, hedging, futures and other financial mitigation measures can help mitigate this risk as well as securing power storage capacity.
Procurement risks	Once the commercial operation date, and more so when the FAC or the commissioning date has elapsed, procurement of spare parts or simply of services may turn out to pose significant risks, e.g. given by availability or costs of spare parts. Even with escalation formulas that are typically based on statistical indices, there is a remaining risk by way of such indices not reflecting the actual situation for the specific components or services to be purchased.
Change parties (e.g. O&M contractor)	Changing parties during the lifetime occurs under various circumstances: <ul style="list-style-type: none"> • Change in ownership of the PV power plant • Change in controlling party of one of the contractual partners in the chain • Change of the O&M service provider • Change of the asset manager • Insolvency of a contractual party • Dissolution / disappearance of a contractual party
Grid works	Occasionally, major maintenance work on the power lines within the power grid may occur, and as a consequence, in the event that there would be only one power connection point, the power sales collapses completely for this period of time resulting in significant loss of revenue. There are several risk prevention or mitigation measures, e. g. building 2 or more power access points that feed into different parts of the grid system, covering the risk by insurance, agreeing with the grid operator to be compensated for loss in revenue, or at least agreeing with the off-taker that such an event would be considered force majeure.
Theft	Even though the price of PV power plants has come down significantly over the last 20 years, theft of PV power plants is a severe issue in several geographies. Such risk is typically transferred.

TABLE 7 RISK TRANSFER

Insurance policy	As outlined above, purchasing insurance is a common method of transferring risk. When an individual or entity is purchasing insurance, they are shifting financial risks to the insurance company. Insurance companies typically charge a fee – an insurance premium – for accepting such risks. Purchasing insurance is a common example of transferring risk from an individual or entity to an
Indemnification clause in contracts	Contracts can also be used to help an individual or entity transfer risk. Contracts can include an indemnification clause – a clause that ensures potential losses will be compensated by the opposing party. In simplest terms, an indemnification clause is a clause in which the parties involved in the contract commit to compensating each other for any harm, liability, or loss arising out of the

FIGURE 9 INSURANCE SOLUTIONS FOR THE SOLAR PV INDUSTRY

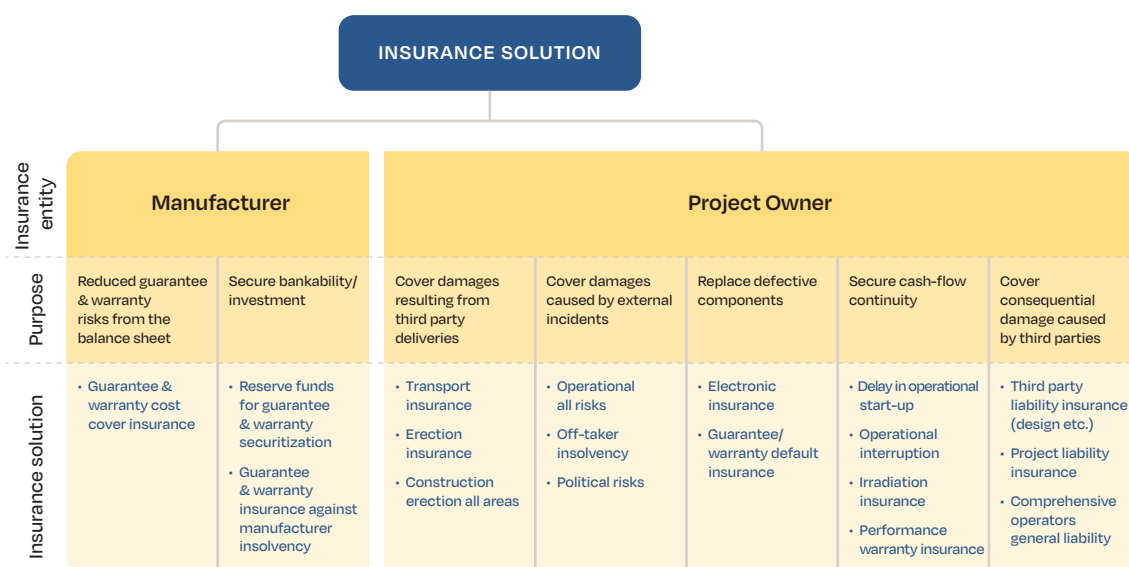

SOURCE: EXXERGY.

4.8. Sector reputational risks

As the share of solar power generation is moving towards 10%, 20% and more, the visibility of the PV market will continue to increase to the point where the performance of solar power plants will eventually become system critical. To avoid a loss of sector reputation, it is highly recommended that relevant stakeholders apply proper risk management strategies, including quality assurance procedures and conformity

assessments regularly throughout the lifetime of a PV power plant. Initiatives that support this objective include PVQAT as well as an international system under IEC defining international standards for conformity assessment, IECRE. A suite of internationally accepted operational documents for conformity assessment has been issued by IECRE already, and more are expected to be developed in the near future, including a rating system for PV power plants.



Caption to image. © SPE

The journey of an AM service provider starts with a handover (or on-boarding) process. Whether an asset has just completed its construction phase, as described in Chapter 3, or has been operational for some time, the handover process is critical to ensure the ongoing management of the asset. While the key steps and responsibilities of an AM service provider during the handover from construction is described in Chapter 3, this chapter will address the importance of the onboarding process when an operational asset is transferred from an Asset Manager to another or when an Asset Owner decides to internalise the AM services.

Handover processes are often cumbersome primarily due to the volume of documents and data involved and the need for the receiving AM to learn about asset's history, nuances and current health status to ensure appropriate and continuous management is provided. Depending on the number of assets being on-boarded, the process could last from a few weeks to a few months, it is therefore important that the receiving Asset Manager ensures that appropriate project management resources are dedicated to this process.

Whilst a significant part of the workload associated to the handover process lies with the receiving Asset Manager (whether third-party service provider or within the owner's organisation), it is critical that the receiving Asset Manager secure appropriate assistance from the incumbent AM to ensure appropriate flow of information and documents as well as a suitable transfer of the asset history and outstanding issues lists where applicable.

A thorough handover process is a key enabler for an AM service provider. As described more in detail in this document, the exchange of information and documentation is necessary to allow AM services being carried out appropriately. In this context, the on-boarding process is the cornerstone of the AM service. The key areas of any handover process are detailed below:

5.1. Site data and information

The aim of the Asset Manager is to collect and map the site static details as well as the dynamic information in an asset register (ideally in a dedicated database), effectively creating a "single source of truth" which provides continuity of management for the benefit of the Owner.

- **Static data:** This information comprises a full suite of site data ranging from contact details of the key contractual counterparty to identification numbers of the installation (for instance grid connection identification codes), key corporate information (from VAT numbers to company registration numbers and directorships), key equipment and components details as well as key contractual terms.
- **Dynamic information:** This includes information that provides the history of site. A collection of key events, incidents, inspections, tests and ad hoc studies (above characterised by a certain level of materiality) that have shaped the lifecycle of the site since commissioning as well as currently outstanding events that will require immediate action by the new AM. This type of information provides a story line and

history of the site which is incredibly relevant to the AM as it constitutes the basis of the understanding of the site technical and commercial behaviour and will educate management decisions in the next phases of the site lifecycle.

The table below summarises the key categories of site information and data that should be part of the on-boarding process.

5.2. Document acquisition and management

The solar PV market has developed complex contracting structures for solar PV sites, often driven by the requirements of investors, lenders and funders. Documentation and contracts management is therefore at the core of any AM service as it sets the boundaries and shapes the services to be provided. During the handover process two main tasks are carried out with regards to the documentation management:

- **Document checklist:** The Asset Manager should be able to advise a minimum and essential set of documents required to enable the normal carrying out of the services as well as a wider selection of documents which might be considered as additional. This does not comprise contracts only but also technical documents from construction and operations documentation. The outcome of this process will identify gaps and ensure that documentation is properly migrated in the document management system agreed between the owner and the Asset Manager.
- **Document checks:** The handover process should allow enough time for the Asset Manager to run through the essential documents to (i) collect static information that will feed in the asset register; (ii) understand and map the key milestones and process required by the different contracts; and (iii) learn the history of the site.

TABLE 8 KEY CATEGORIES OF SITE INFORMATION TO BE COLLECTED BY INCOMING ASSET MANAGER

CATEGORY	EXAMPLES OF SUB-CATEGORY INFORMATION FIELDS*
Real Estate & Planning	Site location and access. Lease and landlord details. Planning permits details
Technical and Design	Details of capacity for both grid connection and subsidies purposes; PV Plant technical layout project for revamping and repowering purposes. Full 'As built' CAD
Production	drawing set. Details of yield budget and forecasts; Should include the latest production yield model (PVSyst data or similar)
Construction and Accreditation	Commissioning dates and subsidies accreditation/registration milestones
Corporate	Special Purposes Vehicle details (registration offices and numbers, directorships)
Counterparties contacts	Main contractual counterparties contact details
Metering	Meters identification/serial number and contracts details
Comms and Monitoring	Communication and monitoring/SCADA systems access details and key features
Equipment & Warranties	For each key component should include manufacturer, serial number, product warranty details. This should include all factory EL and Flash reports for the modules
EPC (during warranty period)	EPC contractor details and key milestones dates and results. This could also include grid connection contractors should this part of the construction services be outside of the scope of the EPC
O&M Contract (post warranty period)	O&M contractor details, key contractual terms and obligations, historical performance information (if available)

*The list is not exhaustive and provides only some examples for each category.

5 Handover of solar assets / continued

The table below summarises some of the key documents to be collected and reviewed during the on-boarding process. These documents originate from the construction and operational phases:

5.3. System and tools

There are many software and data solution providers in the market and therefore, it is important to recognise that data might need to be migrated between systems during the on-boarding process; this activity should not be underestimated and will have a

TABLE 9 KEY DOCUMENTS TO BE COLLECTED AS PART OF A PROJECT HANDOVER

CATEGORY	DESCRIPTION	SOURCE	LIFECYCLE PHASE
O&M Manual	Full set of design and commission and O&M instructions. See details in O&M Best Practice Guidelines - Annex B	EPC Contractor	Construction
Land Lease	Details of the land lease and any associated access agreements	Developer	Construction
Planning Permission/ Permits	Details of the permissions and ongoing duties/requirements for the government approval for the construction and continuing operation of the plant. List of any amendment subsequently submitted and/or approved. Include environmental conditions necessary for the ongoing operation	Developer	Construction
Grid Connection Agreements	Agreement with the Electricity Network operator	Developer / EPC	Construction
Warranties	Warranties in place from installers and equipment manufacturers for the site and associated equipment	EPC (Some will be included in O&M Manual)/ Procurement agreements	Construction
Insurances	Insurances that may be in place for the asset	Developer/EPC/Owner	Construction
Contracts in place	All contracts currently active, including EPC, Equipment Supply Contracts, O&M providers, sub-contractors	Developer/EPC/Owner	Construction
PPA Contract	The agreement for the purchase of the electricity produced by the plant	Developer/Owner	Construction
FIT / Incentive Schemes	The certification and ongoing agreement for the payment of associated incentives (if applicable)	Developer/Owner	Construction
Planned Maintenance Records	Records of testing and inspections carried out since commissioning. To include as much information as possible from the last and all previous operational years. Should include any records from previous contracts/providers. Aim to have all records in PDF or the original digital format	O&M Contractor and/or Incumbent/off boarding Asset Manager	Operation
Reactive Maintenance Records	Records of reactive interventions carried out. Might be contained in monthly reports but ideally a full download/ record of the individual tickets/intervention reports	O&M Contractor and/or Incumbent/off boarding Asset Manager	Operation
Details of all Claims (In progress and Complete)	Log and associated correspondence of all claims initiated that are relevant to the plant. Details of any open claims should include all relevant records and correspondence to allow them to continue to be progressed	O&M Contractor and/or Incumbent/off boarding Asset Manager	Operation

TABLE 9 KEY DOCUMENTS TO BE COLLECTED AS PART OF A PROJECT HANDOVER - *Continued*

CATEGORY	DESCRIPTION	SOURCE	LIFECYCLE PHASE
Monitoring System Historic Data	Full set of collected plant information from the maximum number of measured devices. This may be less critical if the monitoring system is transferred to the new provider completely, but a full backup is advisable. Particular attention should be paid to the data from any legacy monitoring systems that may have operated at earlier stages of the plant	O&M Contractor and/or Incumbent/off boarding Asset Manager. Likely via Monitoring provider	Operation
Spares Inventory	Up to date list of all Spare equipment relating to the plant. This should include details of equipment, serial numbers, associated purchasing information, any expiry/recalibration dates and storage location	O&M Contractor and/or Incumbent/off boarding Asset Manager	Operation
Contractual Records	All contracts relating to the plant and SPV	Incumbent/Off boarding Asset Manager	Operation
Insurances	Insurances that may be in place for the asset and historic relevant insurance claims and events	Owner/O&M Contractor/Asset	Operation
Construction Contract Project Milestones	Details of Interim and Final Acceptance stages of the EPC contract and associated inspections, reports, contracts	Incumbent/Off boarding Asset Manager	Operation
Financial Records	All financial records related to the plant and SPV. Detailed historical and budget financial information, such as, financial model, business plan, balance sheet, P&L, cash-flow, accountant/bookkeeping registers, tax historical information and claims, financial audits reports, financing (debt or shareholder loans).	Incumbent/Off boarding Asset Manager	Operation
Monthly and Annual reports	A complete set of all monthly and annual reports produced under the O&M and Asset Management contracts	Incumbent/Off boarding Asset Manager	Operation
Ongoing/outstanding Issues lists	Brief memorandum for each site highlighting key historical events/incidents that affected the site and list of ongoing matters that require immediate attention	Incumbent/Off boarding Asset Manager	Operation

6

Technical asset management

Technical Asset Management (TAM) encompasses support activities to ensure the best operation of a solar power plant or a portfolio, i.e. to maximise energy production, minimise downtime and reduce costs. It comprises the activities presented in this chapter.

It is not easy to draw a sharp line between the high-level tasks of the operations team and the more technical responsibilities of the Asset Manager. A simple way to provide some clarity would be that Asset Managers are policing the activities of the O&M providers and reassure compliance and contractual conformity. In many cases, the O&M Contractor assumes some tasks related to Technical Asset Management such as KPI reporting. The below tasks can be regarded as Technical Asset Management and can be performed by the O&M Contractor or the Asset Manager. In line with this, this chapter is also featured in SolarPower Europe's O&M Best Practice Guidelines. In cases where the Technical Asset Manager and the O&M Contractor are separate entities, a close coordination and information sharing between the two entities is indispensable. This involves integral knowledge about how much a project should be producing for any given time, considering factors such as weather, seasons, or degradation of assets, and ensuring long-term energy infrastructure reliability. It represents the entire value chain from investors to Asset Managers and service providers.

6.1. Technical reporting

The Technical Asset Manager is responsible for preparing and providing regular reporting to the Asset Owner and other stakeholders defined in the agreement between the Asset Owner and the Technical Asset Manager.

The frequency of the reporting can be set daily, weekly, monthly, quarterly or annually (with monthly being the most common and considered a best practice), with specifically defined content for each of these reports. Generating a report for any specific time range in the past can also be possible. Detailed time-series data should also be reported or at least archived in the reporting system in order to improve the correct availability calculations. The spatial resolution of reports should be on the level of each inverter to better detect under-performing sections of the plants managed.

The following table includes some proposed quantitative and qualitative indicators which should be in reports as a minimum requirement, a best practice or a recommendation. For more details on the individual indicators, see Chapter 11. *Key Performance Indicators of SolarPower Europe's O&M Best Practice Guidelines*.

A new trend in the industry is to extend the reporting beyond the pure PV plant indicators and to incorporate reporting on the actual activities. This means that both the Asset Manager and the O&M Contractor can operate with a CMMS (Computerised Maintenance Management Systems) in order to measure various O&M KPIs (e.g. Acknowledgement Time, Intervention Time, Reaction Time, Resolution Time) and equipment performance (e.g. Mean Time Between Failures). The Technical Asset Manager should also report on Spare

Parts Management and in particular on spare parts stock levels, spare parts consumption, in particular PV modules on hand, spare parts under repair. With the emergence of Predictive Maintenance, the Technical Asset Manager can also report on the state of each individual equipment. Furthermore, the periodic reporting can include information on the status of the security and surveillance system. In this case, the security service provider is responsible for providing the relevant input to the Technical Asset Manager.

On top of the periodical standard reports (monthly, quarterly or yearly) where operations activities are reported by the Technical Asset Manager to the Asset Owner, it is a best practice for the Technical Asset Manager to provide an intermediate operation report when a fault is generating a major loss. A loss due to a fault is considered major when PR and availability are affected by more than a certain threshold throughout the ongoing monitoring (or reporting) period. A best practice is to set this threshold to 1% of Availability or 1% PR within

TABLE 10 PROPOSED INDICATORS/VALUES REQUIRED FOR THE REPORTING

TYPE OF DATA	PROPOSED INDICATOR	TYPE OF REQUIREMENT
Raw data measurements	Irradiation	Minimum Requirement
	Active Energy Produced	Minimum Requirement
	Active Energy Consumed	Best Practice
PV Power Plant KPIs	Reference Yield	Recommendation
	Specific Yield	Recommendation
	Performance Ratio	Minimum Requirement
	Temperature-corrected Performance Ratio	Best Practice
	Energy Performance Index	Best Practice
	Uptime	Best Practice
	Availability	Minimum Requirement
O&M Contractor KPIs	Energy-based Availability	Recommendation
	Acknowledgement time	Minimum Requirement
	Intervention time	Minimum Requirement
	Response time	Minimum Requirement
Equipment KPIs	Resolution time	Minimum Requirement
	Mean Time Between Failures (MTBF)	Recommendation
	Inverter Specific Energy Losses	Recommendation
	Inverter Specific Efficiency	Recommendation
Environmental KPIs	Module Soiling Losses	Recommendation
	Environmental and Biodiversity KPIs may vary depending on the geography, the micro-climate and the conditions of each site	Best Practice
Incident Reporting	Environmental and Biodiversity KPIs may vary depending on the geography, the micro-climate and the conditions of each site	Best Practice
	Main incidents and impact on production	Minimum Requirement
	Warranty issues	Best Practice
	EH&S issues	Best Practice
	Spare parts stock levels and status	Best Practice
	Physical and Cyber Security Issues	Minimum Requirements
Preventive Maintenance tasks performed	Best Practice	

6 Technical asset management / continued

a reporting period of one month. The report should be sent as soon as the fault is acknowledged or solved and should contain all the relevant details related to the fault together with recommendations for Extraordinary Maintenance when the necessary operations are not included in the maintenance contract.

- Typically, this maintenance report should contain: Relevant activity tracks (alarm timestamp, acknowledge time, comments, intervention time, operations on site description, pictures etc)
- The estimated production losses at the moment of writing the report
- The estimated production losses for the total duration of the period, counting on the estimated resolution time if the issue is not solved yet
- The device model, type and Serial Number when the fault is affecting a device
- The peak power of the strings connected to the device(s)
- The alarm and status log as provided by the device
- The resolution planning and suggestions. Eventual replacement needed
- Spare parts available
- Estimated cost for the extra-ordinary maintenance

6.2. Site visits and non-intrusive inspections

As a best practice, the Technical Asset Managers should undertake a bi-annual site visit in coordination with the O&M provider to perform a non-intrusive visual inspection, address current maintenance issues and plan out in cooperation with the O&M contractor and the ancillary service providers (if different) a maintenance improvement plan. It is becoming a best practice for Technical Asset Managers to commission aerial inspections, such as thermography. Using independent providers of these services can be a fast and low-cost way to assess O&M performance and general asset health.

6.3. Management of ancillary service providers

When the O&M Contractors do not have an all-inclusive contract, Technical Asset Managers may be

responsible for managing providers of ancillary (additional) services related to PV site maintenance such as panel cleaning and vegetation management; general site maintenance such as road management, site security; or on-site measurement such as meter readings and thermal inspections. For more information on additional services, please refer to SolarPower Europe's O&M Best Practice Guidelines Section 7.5. *Additional services*.

This requires managing a process which spans from tendering for those services all the way to assessing the deliverables and reassuring in coordination with the O&M compliance with environmental, health and safety policies.

6.4. Interface with local energy authorities & regulatory compliance

The Technical Asset Manager is responsible for ensuring that the operation of the PV plant is in compliance with the regulations. Several levels of regulation have to be considered:

- Many countries have a governing law for the operation of energy generating assets or renewable energy and PV plants in particular. This is something the O&M Contractor should be aware of in any case, even if the O&M Contractor and the Technical Asset Manager are separate entities.
- Power Purchase Agreements (PPA) and Interconnection Agreements must also to be known and respected by the Technical Asset Manager.
- Power generation license agreements need to be made available by the Asset Owner to the Technical Asset Manager so that the Technical Asset Manager can ensure compliance with the regulations of these licenses.
- Further to the regulatory compliance, Technical Asset Manager will be responsible to ensure corporate compliance especially on the new post-subsidy environment, which is dictated by corporate PPAs and stricter contractual obligations by the owner.
- Specific regulation for the site such as building permits, environmental permits and regulations can involve certain requirements and the need to cooperate with the local administration. Examples include restrictions to the vegetation management

and the disposal of green waste imposed by the environmental administration body, or building permits restricting working time on site or storage of utilities.

- It is the O&M Contractor's responsibility to ensure grid code compliance. See 6.7. *Grid code compliance* of the O&M Best Practice Guidelines. It is the responsibility of the Asset Manager to engage the DNO on discussions which will minimise outages and identify measures to safe-guard export capabilities.
- The Technical Asset Manager plays an important role in supporting the cooperation between the aggregator and the grid operator by informing the aggregator about plant production data, unavailable times, transferring network unavailability information from the grid operator, assuming discussions with the grid operator about the attachment to the balancing portfolio of the respective aggregator, and executing plant shutdown requests (in case of negative prices identified in the day-ahead market).
- Other issues requiring formal compliance include reporting of safety plans and incidents, historic/cultural resource protection, noise ordinances that may limit work at night, and any other regulations imposed by an authority having jurisdiction.

As a minimum requirement the agreement between the Technical Asset Manager and the Asset Owner should list all the relevant permits and regulations and specify that the Asset Owner makes relevant documents available to the Technical Asset Manager.

As a best practice, all regulations, permits and stipulations should be managed within the electronic document management system. This allows the Technical Asset Manager to track reporting and maintenance requirements automatically and report back to the Asset Owner or the administration bodies.

6.5. Warranty management

The Technical Asset Manager can act as the Asset Owner's representative for any warranty claims vis-à-vis the OEM manufacturers of PV plant components. The agreement between the Asset Owner and the Technical Asset Manager should specify warranty management responsibilities of the Technical Asset

Manager and the Asset Owner and set thresholds under which the Technical Asset Manager can act directly or seek the Asset Owner's consent. The Technical Asset Manager or the Operations team will then inform the Maintenance team to perform warranty related works on site. Usually the warranty management scope is limited by Endemic Failures (see definition below in this section). Execution of warranty is often separately billable.

For any warranty claims the formal procedure provided by the warranty provider should be followed. All communications and reports should be archived for compliance and traceability reasons.

Objectives of warranty management:

- Improve the efficiency in complaining processes
- Help to reduce the warranty period costs
- Receive and collect all the warranty complaints
- Support the complaint process
- Negotiate with manufacturers more efficient complaint procedures
- Study the behaviour of the installed equipment
- Analyse the costs incurred during the warranty period

Types of warranties on a PV plant:

- Warranty of Good Execution of Works
- Warranty of Equipment (Product Warranty)
- Performance Warranty

Warranty of good execution of works and equipment warranties

During the warranty period, anomalies can occur in the facility, which the EPC provider is liable for. The anomalies must be resolved according to their nature and classification, in accordance to what is described in the following sections.

The anomalies or malfunctions that might occur within the facility warranty period might be classified in the following way:

- **Pending Works**, in accordance to the List of Pending Works (or Punch List) agreed with the client during EPC phase;

6 Technical asset management / continued

- **Insufficiencies**, these being understood as any pathology in the facility resulting from supplies or construction, that although done according to the project execution approved by the client, has proven to be inadequate, unsatisfactory or insufficient;
- **Defects**, these being understood as any pathology resulting from supplies or construction executed in a different way from the one foreseen and specified in the project execution approved by the client;
- **Failure or malfunction of equipment**, being understood as any malfunction or pathology found in the equipment of the photovoltaic facility – Modules, Inverters, Power transformers or other equipment.

Anomalies handling

During the Warranty Period, all the Anomaly processing should, as a best practice, be centralised by the Technical Asset Manager/O&M Contractor, who is responsible for the first acknowledgment of the problem and its framework according to its type and is the main point of contact between the internal organisational structure and the client in accordance to the criteria defined below.

Pending works, insufficiencies and defects

In the case of anomalies of the type “Pending Works”, “Insufficiencies” or “Defects”, the Technical Asset Manager must communicate the occurrence to the EPC provider, who shall be responsible to assess the framework of the complaint in the scope of the EPC contract, determining the action to be taken.

Resolution of failures in the case of anomalies of the type “failures”

The Technical Asset Manager should present the claim to the equipment supplier and follow the claims process.

Endemic failures

Endemic failures are product failures at or above the expected failure rates resulting from defects in material, workmanship, manufacturing process and/or design deficiencies attributable to the manufacturer. Endemic failure is limited to product failures attributable to the same root cause.

Performance warranty

EPC Contractors usually provide a 2-year performance warranty period after the Commercial Operation Date (COD). During the warranty period, it is the

responsibility of the Technical Asset Manager to monitor, calculate, report and follow-up the values of Performance Ratio and other KPIs guaranteed by the EPC Contractor.

Within this scope, it is the responsibility of the Technical Asset Manager to:

- Manage the interventions done within the scope of the warranty in order to safeguard the performance commitments undertaken under the contract;
- Periodically inform the Asset Owner about the condition of the contracted performance indicators;

Immediately alert the Asset Owner whenever the levels of the indicators have values or tendencies that could indicate a risk of failure.

Warranty enforcement

A warranty may be voided by mishandling or not observing instructions or conditions of the warranty. For example, storing modules improperly onsite, such that the packaging is destroyed by rain, may void a warranty. In another case, partial shading of a thin-film module voids the warranty. Failure to provide adequate ventilation may void an inverter warranty. The manufacturer’s warranty might cover replacement but not labour to remove, ship, and re-install an underperforming module. A warranty often gives the manufacturer the option to “repair, replace, or supplement,” with “supplement” meaning to provide modules to make up the difference in lost power. For example, if a system has 10,000 modules that are underperforming by 5%, the guarantor could satisfy the performance warranty by providing 500 additional modules to make up for the lost power, rather than replacing the 10,000 modules. However, increasing the plant size by 500 modules to restore guaranteed power might not be possible due to lack of rack space or electrical infrastructure. Also, expanding the system “nameplate” capacity would generally trigger a new interconnect agreement and permitting. Manufacturers also often have the option of paying a cash-value equivalent to the lost capacity of under-performing modules, but as the price of modules declines, this might be less than originally paid for the modules. Given the complications described above, this option is often preferred by system owners unless there is a required level of performance that must be maintained.

6.6. Insurance claims

The agreement between the Technical Asset Manager and the Asset Owner should specify the insurance management responsibilities of the Asset Owner and the Technical Asset Manager. The Technical Asset Manager will at least be responsible for the coordination of site visits by an insurance provider's representative or technical or financial advisors in connection with the information collection and damage qualification, as well as for the drafting of technical notes to support the reimbursement procedure. The coordination of the insurance claim and the liaison with the insurers, brokers and loss adjusters, as well as finding the best insurance providers, is usually with the Commercial/Financial Asset Manager (see section 7.14. *Suppliers account management*).

For any insurance claims, the formal procedure presented by the insurance provider should be followed. All communications and reports should be archived for compliance and traceability reasons.

Types of insurance related to PV plant operations and maintenance include:

- Property insurance, hazard insurance: coverage commensurate with the value of equipment and other improvements to a property; may also cover against other risks if included or unless excluded.
- Commercial general liability insurance: in a form covering all actions by owner or contractors, written on an occurrence basis, including coverage for products and completed operations, independent contractors, premises and operations, personal injury, broad form property damage, and blanket contractual liability. Liability of a fire started by the PV system has increased required liability coverage levels for PV systems. A liability policy should cover negligence claims, settlements, and legal costs too.
- Inland insurance or marine insurance: insures against loss of equipment in shipping or not on the property premises. Inland insurance is often covered under property insurance policy.
- Workmen's compensation: covers costs for employee accidents.
- Professional liability insurance: insures against errors and omissions often required by board of directors.
- Commercial vehicle insurance: insurance for

owned and rented vehicles or personal vehicles used on company business

- Warranty insurance: equipment warranty issued by manufacturer but backed up by an insurance company in the event that the manufacturing company goes out of business. Many insurance companies do not offer warranty insurance but rather cover such risk under property insurance.
- Business interruption insurance covers lost revenue due to downtime caused by covered event – this can be important in PPAs where revenue is essential for debt service and O&M expenditures.
- Energy production insurance covers cases when energy production is less than previously specified, which can improve access to debt financing and reduce debt interest rate.

The procedure for making claims described in the insurance policy should be followed to the letter, keeping copies of all submittals and correspondence with the insurance company. The insurance company (claims adjuster) will need to have access to the site provided to them in order to assess damage and to collect the information needed to process the claim.

6.7. Contract management (operational contracts)

Contract management encompasses both technical and commercial/financial aspects. This section looks at contract management from a TAM point of view. Section 7.13. *Contract management (financial contracts)* takes the perspective of the Commercial/Financial Asset Manager.

The Technical Asset Manager is in charge of ensuring compliance with the operational contracts in place, such as contracts related to O&M services, land lease, insurance, site security, communications and in some cases ancillary (additional) services such as panel cleaning and vegetation control or component procurement. (For more information on procurement, please refer to chapter 8. *Procurement*.)

Indeed, the oversight of and coordination with the O&M Contractor is one of the key responsibilities of the Technical Asset Manager. Thus, the Technical Asset Manager is responsible for performance supervision too: proper oversight of O&M, detecting when systems are underproducing, and quickly and accurately diagnosing an under-performing plant.

6 Technical asset management / continued

The Technical Asset Manager oversees various contractual parameters, responsibilities and obligations of the Asset Owner and the contractual partners linked to the respective solar power plant. Contract management responsibilities depend largely on factors such as geographic location, project size, construction and offtaker arrangements.

As a minimum requirement, the initial step in this process is a comprehensive analysis of the contracts followed by a well-defined Division of Responsibility (DOR) matrix that clearly delineates which entity is responsible for which action on both the short and long term. Upon mutual agreement between the parties, the DOR can serve as the driving and tracking tool for term of life contractual oversight.

As a form of best practice, the Contract Manager's responsibilities often also extend to functioning as the initial contact for all external questions. This allows the Asset Owner optimal access to all areas of the service provider's organisation and adherence to the contractual responsibilities. The Contract Manager also assumes the responsibility for invoicing of the O&M fees to the Asset Owner.

For quality purposes, the Technical Asset Manager should also track their own compliance with the respective contract, either O&M contract or Asset Management contract, and report to the Asset Owner in full transparency.

6.8. Asset optimisation (technical)

Technical Asset Managers also start being responsible for providing data and information analysis on assets they manage, as well as to provide asset optimisation solutions, primarily based on the following key areas:

- Plant performance
- Operation cost reduction
- Technology adaptation and upgrades (e.g. Revamping and repowering²)
- Technical People management and training

It is the role of the Technical Asset Manager to initiate and coordinate discussions with both the Owners and the O&M Contractors to future-proof the assets and come up with a financial proposal based on data analysis which can assist the owners in making

informed decisions, aiming at enhancing production and revenues generation for each site.

Note that asset optimisation has commercial and financial aspects too, such as contract optimisation, presented in chapters 7. *Commercial and Financial Asset Management* and 8. *Procurement*.

6.9. Revamping & repowering

Revamping and repowering are considered market trend optimisation strategies due to their main drivers: component failure or underperformance; ageing of solar assets; unavailability of spare parts and support; technological improvements; higher efficiency production rates due technological evolution; decreasing prices and additional benefits (such as new warranty terms). The increased efficiency and declining component prices of solar technology translates in an opportunity to boost asset performance, optimise operation cost and increase the revenue stream.

For the Asset Manager and Asset Owner a revamping or repowering project needs to be considered as a commercial and financial re-investment case. Thus, a revamping or repowering case starts under at least one of the following conditions as defined in Table 11 on the following page.

In order to evaluate the business case, the Technical Asset Manager should perform a complete assessment of equipment preservation and correspondent performance levels (actual versus budget/expected).



The focus of revamping or repowering considerations is on PV modules and inverters when either all, or parts of these components get replaced. Other parts of the PV plant may undergo revamping as well, usually this is a by-product of the replacement of the main components.

The following dimensions need to be evaluated when considering plant repowering:

- a. Regulatory aspects
- b. Commercial viability
- c. Technical feasibility

² For detailed information about revamping and repowering, please refer to chapter 8. *Revamping and Repowering* of the O&M Best Practice Guidelines.

TABLE 11 DEFINITION OF REVAMPING AND REPOWERING

POWER PLANT UNDERPERFORMANCE	TECHNOLOGICAL EVOLUTION
<ul style="list-style-type: none"> • Obsolete equipment • Technical malfunctions due to worn-out equipment • Operational safety issues, such as withdrawing manufacturers leading to spare parts unavailability, warranty challenges • Without increasing power plant nominal performance 	<ul style="list-style-type: none"> • More efficient new equipment • Modules or inverters • Increasing power plant nominal performance • Offering a more attractive return on investment
 REVAMPING	 REPOWERING

There are implications from decisions made along one dimension to the other dimension, thus the commercial planning of a repowering projects is an iterative process.

a. Regulatory aspects

Regulatory aspects can only be covered very briefly in this context, as they are highly specific to the type of power plant and the jurisdiction it operates in. It is not unusual that a repowered power plant needs to fulfil current regulation whereas the existing power plant only needs to fulfil regulation as required at the time of commissioning. This may result in additional technical requirements with severe commercial implications, if omitted.

The following regulatory fields heavily influence the feasibility of a power plant repowering project:

Technical regulation

Many jurisdictions have tightened the technical requirements a power plant needs fulfil over time. The most important considerations are:

- Conformity with regulations regarding the power network. This may include technical quality parameters of the feed-in power, remote power control, protection equipment, among others
- Certification of the components used
- Emission control (EMV emission, acoustic emission)

Feed-in tariff regulation, off-take agreements

Power plants operated based on a feed-in tariff (or that are otherwise subsidized) need to take in account the details of the subsidy scheme the plant is intended to operate. Replacing major components risks losing the feed-in tariff as a worst-case scenario. This is especially important if the nominal power of the plant is changed. A detailed legal opinion is advisable if PV modules are replaced. Private off-take agreements need to be reviewed as well, to eliminate risk of contractual breach.

Building permits, municipal and environmental regulation

Building permits may include obligations to the plant operator that may impede or influence repowering projects. The operator should revisit the corresponding documentation in detail.

b. Commercial viability

Most repowering initiatives arrive from commercial ambitions, aiming at higher future revenues or offsetting production losses. Even in cases revamping or repowering is motivated by technical improvement, such as eliminating safety issues, the asset manager should search for opportunities of commercial improvement as side-effect.

Asset Managers target older PV plants, to perform revamping and repowering projects, as they have higher incentives and potential for higher IRRs (internal rate of return) associated with FIT (feed-in-tariff) subsidy regimes. These PV plants have a higher

6 Technical asset management / continued

probability of problems with components defects and plant underperformance, due component ageing and quality issues arising from the rush to meet FIT deadlines. Consequently, the opportunity for site optimization is higher in projects with more than ten years of age and FIT subsidy regimes. Hence, Asset Managers have a clear incentive to target this type of solar assets for site optimization.

It is the Asset Manager responsibility to build a solid business case to assess project viability. The analysis must contain historical asset performance, future performance, revenues, costs, extended life span, changes in maintenance requirements (O&M contract revision), changes in land lease requirements (contract revision) and changes in PV Plant technical layout in order to be able to forecast future income streams. Additionally, a risk assessment and sensibility analysis must be made.

The following commercial parameters should be considered in the calculations during the decision-making process:

- Investment cost
- Plant downtime and production loss during repowering project
- Yield improvement by increased component efficiency or increased nominal power
- Changes in expected operating downtime with improved equipment
- Changes in maintenance cost (preventive and reactive)
- Financing cost
- Cost of equity capital
- Forecast future revenues

In addition, following factors need to be included in the decision-making process. When quantification is not reliably possible, the commercial effect needs to be based on the judgement of the operator:

- Project risk (delay, excess cost)
- Operation risk (safety)
- Compatibility with existing processes of plant operation
- Changes in component warranty

c. Technical feasibility

See *Chapter 8. Revamping and repowering* of the O&M Best Practice Guidelines for considerations of technical feasibility (SolarPower Europe, 2020).

6.10. Environmental management

Depending on local and international environmental regulations, as well as on the Asset Owner's CSR and Environmental internal policies, the Asset Owner may have incentives to reduce or control negative environmental impacts.

An increasing body of scientific evidence indicates that well-designed and well-managed solar energy can support wildlife habitats and contribute significantly to national biodiversity targets. In fact, solar parks can have several additional advantages over other agricultural landscapes, in that they are secure sites with minimal human and technical disturbance from construction, require little or no use of chemical pesticides, herbicides or fertilizers, and typically incorporate ecological features such as drainage ponds and hedgerows, which can be designed to maximise the value of their habitat.

The approach to managing biodiversity will be different for every solar park, and it is recommended that a site-specific plan be devised in each case.

Therefore, the Asset Manager is obliged to assess the impact or limitations of environmental legislation on the supplier's existing contracts. Furthermore, the Asset Manager is required to develop an action plan to address existing problems and minimise their impact.

As an example, the Asset Manager must oversee the O&M provider's operational field work to ensure compliance with local environmental regulation (use of chemicals to control vegetation, use of diesel cutting machines, etc.); the security contract must be adapted, if possible, according to the wild life existing around the photovoltaic plant and the appropriate security equipment, such as loudspeakers, spotlights and fences, must also be adapted.

Long-term environmental requirements can also include water tank installation, tree clearing, installation of drainage systems, amphibian follow-up, edge plantation, and installation of reptile rock shelters. As a best practice, the Technical Asset Manager's (or the O&M Contractor's) environmental preservation activities should go beyond legal obligations.

6.11. Health & safety management

The Technical Asset Manager should oversee that the solar asset and the relevant suppliers comply with health & safety (H&S) requirements. If necessary, the Technical Asset Manager should hire an H&S expert to ensure compliance. For more information, see chapter 3. *Environment, Health & Safety* of the O&M Best Practice Guidelines.

6.12. Challenges of multi-jurisdictional and global portfolios

The principles of a robust technical management should be deployed consistently across markets, jurisdictions and territories to ensure efficiency and effectiveness of asset management activities. However, the key tasks carried out as part of the technical asset management may require adaptation to the peculiarities of different markets and jurisdictions. The approach to successfully managing assets across varied territories must start with centralized strategies which are underpinned by company policy and standards. The aim is to create economies of scale and consistency to approach which still allow the AM service to be adaptable to the nuances of the territory.

TABLE 12 TECHNICAL ASSET MANAGEMENT: CHALLENGES OF MULTI-JURISDICTIONAL AND GLOBAL PORTFOLIOS

TECHNICAL AM ACTIVITIES	MULTI-JURISDICTIONAL CHALLENGES
Technical reporting	For AM service providers with well established data management and reporting practice, the location of sites in multiple and different jurisdiction should be essentially neutral. Aggregation of sites and centralized data management must developed to assist the Owner preferred view of the international portfolio.
Site visits and non-intrusive inspections	Local presence will be required to ensure this service is carried out suitably. However, areas of focus during the visit, the assessment criteria and required evidence, remain quite consistent from jurisdiction to jurisdiction. Certain specific inspections (for instance drone inspections and subsequent analysis) can be carried out by the same specialist providers across multiple jurisdictions, greatly increasing the value of the larger international data set.
Management of ancillary service providers	Local knowledge of the market might be required to the extent the Owner and AM service providers have decided to appoint local contractors.
Interface with local energy authorities & regulatory compliance	This task requires specific local knowledge to be fulfilled appropriately. Regulatory requirements and electricity market requirements are very country specific (even though in general compliance with European legislation), therefore the AM services providers must invest in specific knowledge and skills to ensure suitable understanding of reporting deadlines and compliance requirements are adhered to.
Warranty management	This task and function can be centralized, together with the review of the spare parts strategy. Centralization generally allows to benefit of economies of scale and the deployment of best practices learnt in a jurisdiction to the rest of the portfolio. Legal enforcement of warranties will require dedicated legal advice depending on the jurisdiction of each warranty and the overarching supply/EPC/O&M contract.
Insurance claims	This task and function can be centralized to the extent the AM service provider can invest in insurance specialists. Operational portfolios spread over multiple jurisdictions tend to be aggregated in global insurance and risk management programs, whilst there might be specific insurance terms driven by specific jurisdictions, consistency of coverage is achievable for the benefit of the Owners.

6 Technical asset management / continued

TABLE 12 TECHNICAL ASSET MANAGEMENT: CHALLENGES OF MULTI-JURISDICTIONAL AND GLOBAL PORTFOLIOS - *Continued*

TECHNICAL AM ACTIVITIES	MULTI-JURISDICTIONAL CHALLENGES
Contract management (operational contracts)	<p>Local knowledge of the market might be required to the extent the Owner and AM service providers have decided to appoint local contractors. Centralization will however increase the level of efficiency and control to the extent the general risk allocation set forth by the contracts is relatively consistent across jurisdictions. This is particularly relevant if the Owner has deployed an international EPC/O&M contract strategy, with a selected number of international contractors.</p> <p>Legal enforcement of contracts will require dedicated legal advice depending on the jurisdiction of each warranty and the overarching supply/EPC/O&M contract.</p>
Asset optimisation (technical)	<p>This task and function can be centralized, together with the lesson learnt and feedback loop process, described in Chapter 3. This will allow deployment of best practices learnt in a jurisdiction to the rest of the portfolio and ensure effective PV sites peer to peer comparison.</p>
Environmental management	<p>Similar implications as to the local authorities and regulatory compliance. Local knowledge of climate, flora and fauna can be vital in how an asset is managed with in a particular setting. However, experience with successful environmental management plans in different territories can provide useful opportunity to enhance biodiversity in other jurisdictions, facilitation international deployment of best practices.</p>
Health & safety management	<p>Similar implications as to the local authorities and regulatory compliance.</p>



Commercial and financial asset management

Commercial and Financial Asset Management encompasses *support activities for the best operation of a business*. By definition, the scope of Commercial and Financial Asset Management goes from the contact with external entities on behalf of the Asset Owner until the conversion of operational data into useful and understandable financial information. It comprises the activities presented in this chapter.

7.1. Financial reporting

In addition to technical reporting (see section 6.1. *Technical Reporting*), financial information is incorporated into the individual monthly report that is usually centred in a cost structure analysis. The individual report should also include information regarding relevant operational incidents, corrective maintenance interventions and security incidents statuses (when provided by the O&M and security supplier).

An additional consolidated report may be produced. This document should include the information disclosed in the individual monthly reports (operational and financial), as well as a set of consolidated financial information with the purpose of providing an integrated portfolio vision. The following financial information should be included in the consolidated report:

- Consolidated financial statements (income statement: balance sheet and cash flow).
- Capital structure analysis.
- Detailed OPEX items or net financial expenses breaking down analysis by type of expense, comparing with previous homologous period (when

available), and highlighting material contributions per cost figure.

- Profitability analysis.
- Cash flow overview (on a backward and forward-looking perspective).
- Debt compliance and follow-up – loan administration, including settlements supervision, supervision of interest rates fixing and remuneration of current accounts.

The focus of the Asset Manager is to monitor the business and provide recommendations for improvement of overall status and performance of the photovoltaic plant. By providing specialized management based on reporting individual and consolidated figures of the Asset Owner's portfolio (portfolio perspective) and breaking down the contribution of each SPV to compare it with the financial model assumptions and historical years (whenever available), the Asset Manager is able to differentiate their service and add value to the Asset Owner. Such analysis will comprise a concise financial interpretation and understanding of the results, and such a periodic report may be fine-tuned in accordance with the Asset Owner's needs.

The role of the Asset Manager includes the capability of contributing to the development of new indicators and of innovative reporting solutions. The Asset Manager may contribute significantly to the improvement of the performance of the photovoltaic plant by managing all the activities which have an impact and should be reported in the periodic financial reporting.

7 Commercial and financial asset management

/ continued

Furthermore, the Asset Manager is in charge of coordinating a set of corporate financial services that are essential to assess the economic and financial performance of the plant. These actions are relevant for the periodic financial reporting and should be previously agreed upon with the Asset Owner.

7.2. Strategy management

The business should develop and implement a strategic framework for all its Asset Management activities. It should be based upon the business strategy, future demand patterns, stakeholder concerns and asset-related risks. The output is an AM policy or future statement of intent, an AM strategy to achieve it, various AM plans and a scorecard of AM KPIs with improvement targets. This framework should be implemented with the required change management process and monitored through regular audits and management reviews.

7.3. Management of unsubsidised projects


The solar PV industry is now at the dawn of subsidised market in multiple countries. The progressive reduction of subsidies and tariffs has naturally led asset owners to deploy more sophisticated revenues streams. We are therefore experiencing a substantial growth in the corporate PPA market, being these contracts physical (with private wire arrangements), virtual, sleeving and hedges. These comparatively new

commercial arrangements vary the risk profile of the PV plants from a counterparty and merchant risk exposure perspective, therefore it is vital to successful management of these contracts that Owners and AM service providers have developed and established data management tools and practices as described in Chapter 10 of these Guidelines.

If compared to a subsidy regime or a plain vanilla utility PPA, the corporate PPAs typically require an enhanced level of information undertakings from the part of the SPV and often a minimum level of operational and production reliability, leading to stricter requirements for response time and re-establishment of PV plant availability.

The introduction of contractually binding reliability requirements (such as a minimum production or volume (MWh) guarantee) and the exposure to merchant risk, represent a substantial shift in risk allocation toward the Owners. This therefore leads Owners and AM service providers to the necessity of new skills focused on electricity price market knowledge to facilitate forecasting, whilst reinforcing operational processes particularly with maintenance providers to ensure a low medium time to repair, and key components reliability to minimize mean time between failures. This is particularly affecting distributed generation, whilst larger scale sites which can afford to be regularly manned, seem to have a higher level of operational reliability due the higher response time to failures and downtime.

FIGURE 10 NEW REQUIREMENTS DRIVEN BY NEW RISK ALLOCATION AND CRITICAL IMPORTANCE OF DATA MANAGEMENT

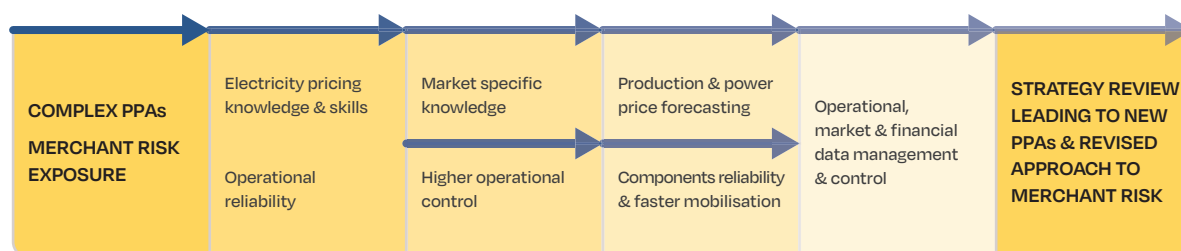

As the risk paradigm associated to the operation of the PV plants shifts toward the SPV and Owners, AM service providers must prepare and equip with the new skills set forth above also considering that these might have to be specific for each market they are providing services in. Given the high impact and frequency of these risks it is also expected that a number of Owners would explore the opportunity of internalising the strategic management of these contracts.

7.4. Corporate administrative services

The Asset Manager is usually in charge of providing corporate administrative services for the managed SPV, including coordination of the board of directors' meetings, and general management services, including domiciliation of the company, operation of the bank accounts etc.

7.5. Accounting

Accounting is the support area responsible for meeting local and international legal, regulatory and tax requirements as the reporting of financial transactions pertaining to business.

In Accounting, one must ensure that the local and international accounting standards (IAS) are met and align with the international financial reporting standards (IFRS) in order to produce financial information that is in a common global language for business affairs. This way, the accounts of a company are understandable and comparable across international boundaries.

Therefore, Accounting means processing all the financial information of a business and converting it into standardized outputs that are universally understood and comparable financial statements.

The Accounting service can be included in the Asset Management contract as a provided service regardless of whether it is an internalised (Asset Manager's responsibility) or externalised (outsourced) service. The main activities under the scope of Accounting Services are detailed in section 7.7. *Accounting assistance.*

7.6. Customer relationship

The main customer of the Asset Manager is the Asset Owner. Consequently, all the third-party relationship management carried out by the Asset Manager must align with the Asset Owner's work ethic, company culture, expectations and needs.

The Asset Manager is responsible for acting on behalf of the Asset Owner in all contact and relations with external entities (third-party) in accordance with the predefined Asset Management contract. The Asset Manager should source solutions, make negotiations and present all the collected information and its critical analysis to the Asset Owner for examination and for final decision-making.

The key customer of the SPV is the final recipient of the electricity generated by the photovoltaic plant, whether it is a local utility or a final consumer. The Asset Manager must: ensure compliance with the power purchase agreement, fulfil the contract requirements and deliverables, and verify if the settled tariff is being paid correctly. Furthermore, the Asset Manager is responsible for sourcing alternatives or renegotiating, when needed, the energy sale contract.

Thus, it is the Asset Manager's responsibility to make the bridge between the Asset Owner and the SPV (Asset/photovoltaic plant) customers.

This requires a high level of responsibility, so the Asset Manager must be able to act promptly and effectively in the best interest of the Asset Owner at every instance.

Moreover, the Asset Manager should hold periodic meetings in order to inform the Asset Owner of the status of ongoing negotiations and other relevant events. The meeting and its agenda should be proposed by the Asset Manager.

Therefore, in order to streamline all relevant processes and to avoid any undesirable delays or missed deadlines, the Asset Manager is responsible for informing the Asset Owner of important correspondence, assuring maximum control of relevant external communications (local tax authorities, banks, suppliers and others).

Although the Asset Owner's role is not to perform operational management activities, their awareness of relevant events happening inside the plant or in its immediate vicinity is of higher importance for their decision-making process.

7 Commercial and financial asset management

/ continued

In this respect, it is advised that the Asset Manager follows up relevant events with the help of a "Follow-up Report". This document will assist in monitoring occurrences that may arise in the day-to-day operation of the project, as well as in tracking serious issues and establishing action plans and priorities.

7.7. Accounting assistance

The Accounting Service is obliged to comply with local and international legal, regulatory and tax requirements in accordance with the IAS and IFRS, as mentioned in section 7.1. *Financial reporting*, 7.5. *Accounting* and 7.6. *Customer relationship*. Therefore, establishing processes and procedures in order to have a complete understanding of the local legal, regulatory and tax requirements applicable to the reporting of financial transactions pertaining business should be done accordingly. Consequently, the Asset Manager should be supported by an Accounting Service that is knowledgeable in local market practices.

The Asset Manager ensures that the Accounting Service meets its obligations of Book-keeping and Administration as well as Accounting Procedures. Monthly and annual activities of the Accounting Service are stated below.

Bookkeeping and administration

- Registration of book-keeping entries for the project company's operations.
- Keeping the project company's accounting books (general ledger, VAT registers, inventory book and depreciable assets book).
- Calculation and entering of the corresponding amortisation allowances into the project company's books and keeping a complete record of all fixed asset balances.
- Calculation and entering of remittances, where applicable, into the project company's books.
- Registration of the project company's financial operations.
- Registration of time period adjustments (accruals and prepayments, including interest accruals) in the project company's accounting books.
- Management of the project company's correspondence.

Accounting procedures

- Establishment of Accounting and Administrative procedures.
- Preparation and assistance during tax audits.
- Preparation of monthly financial statements (balance sheet and income statement) of the project company.
- Advise on financial and accounting matters in the daily operations and matters that may impact the accounting operation of the project company.
- Elaboration of the project company's statutory annual accounts.

Furthermore, the main outputs of the Accounting Service include the elaboration of the SPV's (asset/PV plant) statutory annual accounts, general ledger listings, accurate financial statements (balance sheet and income statement), and the design of an appropriate chart of accounts or analytical accounting issues namely, with regards to a portfolio, to ensure the correct allocation of income and expenses across the PV plant(s).

7.8. Invoicing/billing and payments

An invoice is a commercial document that itemises a transaction between a buyer and a seller. If goods or services were purchased on credit, the invoice usually specifies the terms of the deal, and provides information on the available methods of payment. An invoice is also known as a bill or sales invoice.

Therefore, the invoice is the most important document for the Asset Manager to control the revenue. It allows the Asset Manager to verify if the invoiced amount is in accordance with the produced energy amount. This is the first step to control the SPV's income. As a note, the invoice is a key document to control costs. The Asset Manager must ensure that all suppliers' invoices are consistent with what was agreed in the service providers' contracts.

One can consider that the biggest challenge of the Asset Manager is the control of revenues and expenses through rigorous invoicing monitoring.

7.9. Revenue control

The Asset Manager is responsible for confirming the reading of the meters based on the information collected on site by the O&M Team, and for validating and comparing it with the billing issued by the electricity purchaser. These activities are called Revenue Control and include:

- Calculation of revenue corresponding to energy generation using the production data downloaded from the production meters.
- Verification of the production data read and registered as well as the issuance of relevant invoices and self-billing invoices, if applicable.
- In case differences occur between the actual energy produced and the energy registered, processing of the corresponding claims and following up until the claims are completely resolved.
- If incidences that arose affected the reading of production meters, coordination of necessary actions to guarantee the accurate invoicing of the energy fed into the grid.

7.10. Cash flow management

The Asset Manager is responsible for managing the treasury activities and for monitoring the cash available in every period. Cash management is crucial for the expenditures' decision-making process. The Asset Manager is accountable for ensuring the proper balance between income and expenses plus revenue and cost.

Adequate treasury operation allows the Asset Manager to manage and adjust payment dates in accordance with the predicted income dates. This way, the expenses can be incurred at a more appropriate timing.

Moreover, the cash flow management gains importance when one considers the variability of the revenues of a PV plant. The latter depends on:

1. Weather conditions.
2. Equipment status and performance.
3. Tariff nature (fixed vs. variable).
4. Local tariff legislation and contract in place (FiT, PPA, Pool Price).

The cost structure of a solar power plant has the opposite behaviour, which is relatively stable throughout the lifetime of the project. The highest costs are associated with operational contracts, such as Operation and Maintenance, Land Lease agreement, Asset Management and Debt Financing. These contracts are not usually negotiated by the Asset Manager as they are typically long-term, entered by the Asset Owner and sometimes tied to Project Finance terms. However, for lighter costs, such as insurance policies, communications, independent audits and security, the Asset Manager is in a position to negotiate and should strive for continuous improvement and optimisation, not only in terms of cost, but also in terms of quality of services.

The opposite behaviour of revenues and costs highlights the complexity of ensuring a stable monthly balance between them. For instance, if the monthly revenue is far below the forecast due to a decrease in the monthly irradiation levels, it may represent a risk of a decrease in liquidity for the SPV (photovoltaic plant), especially if significant expenses are required in this specific month.

An additional challenge to cash management is the few degrees of freedom the Asset Manager has to influence cash flows: Inflow of cash is dependent on external or random events as described above, whereas outflows are mostly fixed in long-term contracts. The single most powerful lever for ensuring liquidity is determining the appropriate level of investor dividends. In most cases the amount of cash paid out in an annual dividend payment model directly determines the level of cash available for the next 12 months.

Imminent to the nature of a PV plant is a 12-month cycle in cash flows, with shorter cycles of cash balance minima at times, when low production periods coincide with debt repayment (typically around March/April in the Northern Hemisphere). To continuously ensure sufficient cash balance, the Asset Manager needs a rolling cash flow model at least for the following 12 months. Extending the rolling forecast period to 18 months provides additional security and comfort to the Asset Owner.

Dividend calculation therefore should not only take into account the constraints posed on cash flow management by financing schemes (covenants) and investor expectations, but also the expected cash balance of the liquidity planning cycle.

7 Commercial and financial asset management

/ continued

Concluding, cash management is a crucial part of the scope of work of the Asset Manager.

From a cash management perspective, the Asset Manager is responsible for:

- Managing accounts payable/receivable (providing notice to the Asset Owner for authorisation of payments).
- Repayments of shareholder loans (interest and principal) and any other distributions to SPV's shareholders.
- Cash flow statement (forecast vs. actual).
- Payments under SPV's contracts (O&M, surveillance, land lease, security, monitoring and others).
- Repayments of shareholder loans (interest and principal) and within other financing schemes, as well as any other distributions of the SPV's shareholders.
- Validation (of interest and other bank charges).

7.11. Working capital reconciliation

The revenue stream of a solar power plant is variable due to the indexation of electricity production that is mainly dependent on the weather. However, the cost structure is relatively stable. Taking that into consideration, the need for close monitoring of accounts payable and accounts receivable assumes a higher importance.

Therefore, the Asset Manager should manage accounts payable and accounts receivable through rigorous client and supplier contract negotiation, ensures that the days payable outstanding are convenient to the SPV, according to the days receivable outstanding. The days receivable outstanding should be lower than the days payable outstanding in order to ensure that the accumulated revenue generated is enough to meet the supplier's payment (to guarantee proper availability of the cash short-term). Furthermore, in order to stabilise the revenue stream when unpredictable events happen (for example, machinery breakdown) resulting in downtime, the Asset Manager must ensure that response times of the O&M contract are being respected. Hence, it is the Asset Manager's responsibility to guarantee a close monitoring of revenue stream, working capital and cash flow variations.

7.12. Financial control

Financial control is the set of processes, policies and procedures which enable the analysis of a company's actual activities from different perspectives at different times, compared to its short, medium- and long-term objectives and business plan. This analysis requires control and adjustment to ensure compliance with the business plan and in the event of anomalies, irregularities or unforeseen changes. The Asset Manager is responsible for conducting such analysis in order to achieve the company's performance optimisation and the company's financial goals.

Financial control processes, policies and procedures must be defined according with local and international legal, regulatory and tax requirements, the Asset Managers' experience and shareholders' remuneration. There are different types of financial control processes and procedures, such as accounting standards, financial statements (balance sheet, income statement, cash-flow statement, statement of changes in equity), budgets, business plans, operating metrics (such as profit margins, KPIs), and external financial audits, as well as different types of policies regarding general ledger, chart of accounts, recognition of revenue, reconciliations, invoicing, payment processing, inventory, among others. The job of the Asset Manager is to ensure the SPV compliance with the defined financial control processes, policies and procedures through coordination with the teams involved (Accounting Department, Treasury Department, Tax Consultant).

The Asset Manager oversees the preparation of the annual budget forecast and updates it with actual data, analysing the deviation between the forecast and actual data. The budget forecast should be validated by the Asset Owner and used as a comparison (to the actual data) in the corresponding periodic financial reporting.

The annual budget forecast includes:

- Monthly estimation of OPEX
- Monthly estimation of production and revenues, according to the technical data or project finance
- Financial expenses
- Taxes
- Tangible fixed assets depreciation costs.

Adequate interpretation of the current year's activity will allow the Asset Manager to adopt higher levels of certainty when elaborating the budget forecast for the following year, thus being more accurate in terms of predicting the financial efficiency of the project.

In order to complement the micro-level analysis for the upcoming year (budget), the Asset Manager should analyse the SPV's Business Plan in order to understand if the business' actual data is aligned with assumptions considered in the Business Plan or if there are any deviations. Should deviations happen, the Asset Manager must propose and define a strategy, along with the Asset Owner, to overcome them. The business plan is often elaborated by the Asset Owner or by the Asset Owner's Financial Consultants.

As a final step to ensure proper financial control, the Asset Manager should advise the Asset Owner on the need to contract an external auditor to certify the accounts and to approve the annual accounts and report. The Asset Manager should assist the auditing team.

7.13. Contract management (financial contracts)

Contract management encompasses both technical and commercial/financial aspects. This section looks at contract management from a commercial/financial AM point of view. Section 6.7. *Contract management (operational contracts)* takes the perspective of the Technical Asset Manager.

The Commercial/Financial Asset Manager is responsible for the sourcing of service providers, contract optimisation, supervising contract compliance, relationship management, liaising with suppliers in case of non-compliance or claims, as well as coordinating with other entities.

Also, contracts not managed by the Technical Asset Management, such as FiT and PPAs, and any other support scheme reporting and accounting are managed directly by the Commercial/Financial Asset Manager due to their financial requirements and contract deliverables.

The Asset Manager must regularly conduct a comprehensive review of all contracts concluded and record them in a relevant document or software: the start and end date of the contracts, actions and deliverables (what, when and how) that must take place in order to ensure contract compliance, prices

indexation and updates, the type of payment and payment dates, requirements for notification of termination of the contract, indexation to other contracts, services provided, breaches of the contract, and useful information. This will provide the Asset Manager with the proper information to manage, negotiate and comply with the contracts and their requirements. It is imperative to ensure that the contract requirements and periodic deliverables are met in a timely manner to avoid contractual penalties and therefore unforeseen expenses.

Whenever necessary and possible, the Asset Manager should actively identify and solicit alternative service providers to guarantee contract optimisation in terms of conditions, price, service and quality. (For more information, see also chapter 8. *Procurement*.)

When it comes to PPA management, the Asset Manager should always consider the financial soundness of the counterparty, the transparency, and bankability of the contract by relying on rating reports, financial statements and warranties provided.

Contract management is a very time-consuming element of business and automation of the contract management system is an efficient tool to save time and costs allowing the allocation of resources to other pending matters.

7.14. Suppliers account management

In sections 6.7. and 7.13. on *Contract management* we explore the Asset Manager's role in operational and financial contract management, contractual requirements compliance, contract monitoring and contract optimisation and negotiation. In the present topic we will emphasise the importance of regular activities performed by the Asset Manager such as: monitoring of the operational contract execution, relationship management, event accessing, decision-making and administrative management (for instance, following up an insurance claim), and evaluating financial impacts (for instance, extracontractual O&M activities).

The Asset Manager is responsible for sourcing, evaluating the financial impact, negotiating, managing and ensuring the execution of all supplier contracts. Moreover, in the occurrence of an abnormal event, it is the Asset Manager's obligation to assess whether this event is or is not extracontractual, estimate

7 Commercial and financial asset management

/ continued

damages and financial impact, find the adequate solution and perform the necessary administrative tasks in order to quickly establish normality in the business. Lastly, throughout the process, the Asset Manager should report to the Asset Owner.

The Asset Manager is a key player in suppliers relationship management. By having a 360° perspective of the operational business, financial performance and the supplier's contracts in place, the Asset Manager can add value by deeply understanding the project's needs and by trying to get individual contracts in order to ensure maximum business optimisation. It is hard to assess business improvements achieved by an experienced Asset Manager, as they go far beyond easily measured quantitative financial improvements. For more details on supplier categories and selection, see chapter 8. *Procurement*.

In order to clarify what the Asset Manager's role in supplier account management is, please refer below to the most important suppliers.

O&M suppliers

Throughout the operation phase, the main task of the Asset Manager is to supervise the O&M supplier in terms of compliance with contractual obligations such as O&M Team response times. In addition, the Asset Manager is also responsible for validating the compliance of the contracted O&M preventive maintenance plan and coordinate corrective maintenance activities.

Furthermore, depending on the type of activities assigned to the O&M Service contract, the Asset Manager may also supervise the contractual compliance related to warranties and processing of necessary claims, if applicable.

Another important role of the Asset Manager is to monitor the additional O&M services not included in the O&M contract and therefore representing additional cost for the Asset Owner and affecting the project cash flow. From this perspective, the Asset Manager is responsible for assessing the operational impact reported by the O&M provider and for evaluating the suitability and necessity of the activities.

In some cases, when specific extra works are frequently executed, representing a high weight on total OPEX costs, this may be a good opportunity to

assess the O&M contract and propose to the Asset Owner a revision of the O&M contract to include the referred works under the scope of the contract.

Landowners

The land lease agreement is a long-term contract and it is one of the most important contracts in the solar power generation business. This agreement ensures that the PV Plant can be installed and can be in operation during the asset lifetime (30+ years) on the chosen land. Usually the land lease agreement is negotiated and secured by the development team before the construction phase and can be a contract signed with more than one landowner (if the chosen place to install the PV plant belongs to more than one landowner).

Therefore, the Asset Manager is responsible for managing the land lease contract made between the SPV (special purpose vehicle) and the Asset Owner. This means that the Asset Manager is responsible for:

- Managing a key long-term relationship ensuring good relations between the landowner and the Asset Owner.
- Assessing the land lease's annual price indexation.
- Solving land lease agreement problems: for instance vegetation control issues (for instance disputes with neighbours in case of shared vegetation), manage PV plant access, inform land owner of alterations needed in the PV plant (for instance, DNO access to alter type communications), among others.
- Comply with local legislation with regards to land alterations (planning permit).
- Renegotiate contract extension if needed.

Such efforts shall comprise the procurement of technical and economical solutions and the contractual arrangements and subsequent implementation of the solution previously agreed upon with the Asset Owner.

Insurance

The Asset Manager is responsible for managing the insurance contracts made between the Asset Owner and the Insurance Company.

This means that the Asset Manager is responsible not only for the annual assessment of insured capitals and coverages depending on the evolution of market prices, but also for coordinating insurance claims and the subsequent review of claims with parties involved (Broker, Loss Adjuster, O&M supplier, security company and others).

In case of damages to the Asset which could be covered by the insurance policy, the Asset Manager will work with all parties involved to:

- Ensure the necessary contacts with insurance companies/brokers to guarantee that the operation is restored as soon as possible.
- Ensure adequate indemnities are paid in accordance with the policy conditions.
- Assist the Asset Owner with the execution of insurance contracts and their compliance with the established requirements.
- Ensure that the information required to file the claim (including material damages, business interruption and machinery breakdown) is gathered and submitted to the insurance broker and loss adjusters.

Such efforts shall comprise the procurement of technical and economical solutions and the contractual arrangements and subsequent implementation of the solution previously agreed upon with the Asset Owner.

Security services and surveillance system management

On the one hand, the Asset Manager acts on behalf of the Asset Owner on the procurement and contracting of specialised security services, including, amongst other things, daily interaction with customers, as well as with specialised suppliers (e.g. remote CCTV/alarm filtering and monitoring agreements, mobile response and on-site presence handling) in order to advise on the most suitable solutions available in the market.

On the other hand, the Asset Manager provides clear communication and dispatching protocol in accordance with the terms and conditions set forth by the Asset Manager and gathers business intelligence data on incidents and abnormal operating conditions from a security management perspective. Security information is also included in the Asset Management periodic financial reporting.

Technical consultancy

The Asset Manager acts as the interface and support for external organisations on behalf of the Asset Owner (e.g. operational assessment and technical risk analysis), available on demand, according to the rates agreed upon, as an additional service.

Throughout the operation phase, the Asset Manager may make regular periodic visits to the plants. Depending on the performance, operations, maintenance or insurance claims that may take place related to the plant, the Asset Manager may carry out additional site visits, in order to investigate specific circumstances at the request of the Asset Owner.

The Asset Manager is expected to provide recommendations on the best certified suppliers and specialised technical inspections and consultancy services.

At this level, the Asset Manager develops an integrated approach to risk management, including the development of initiatives for risk mitigation.

Legal consultancy

The Asset Manager will be an interface with the Asset Owner's legal advisors, focused on providing effective and timely assistance and on setting forth a thorough description and understanding of requirements or feedback from legal support.

This role is very challenging and can only be met by wide knowledge of the best legal players and practices in the renewable energy sector (e.g. lawyers and consultants), as well as a deep understanding of the Asset Owner's approach, needs, industry and market.

Whenever the complexity of any legal matter requires external, specialised advice, the Asset Manager will discuss this in advance with the Asset Owner.

Audit and consultant services

Whenever necessary, the Asset Manager assists the Asset Owner's financial auditors and other advisors, especially in conducting annual financial audits, including the processing of 'Prepared by Client' lists, assisting the auditors in working meetings, collecting information from the Client and updating the audit progress.

7 Commercial and financial asset management

/ continued

The following activities are considered as an example of the relationship and interdependency between the Asset Manager and the external auditors:

- Monitoring and supporting of financial statements (Local GAAP and/or IFRS) and submission of all tax returns.
- Advice on financial and accounting matters in the daily operations and situations that may have an impact on the accounting situation of the SPV.
- Management of the relationship with the project company's external auditors (if applicable), using best efforts so that the project companies receive audited financial statements within the established deadline: the year following the reference fiscal year.

Finally, the Asset Manager should advise the Asset Owner on the need to hire an external auditor for certifying the accounts and approving the annual accounts and report.

Electricity providers

Throughout the operational phase, the PV plant needs electricity to power auxiliary services and/or ancillary services. Auxiliary services are the services that affect production (e.g. inverters) and ancillary services are the services that are not directly linked with solar power production (e.g. CCTV system, monitoring system, illumination, among others). Electricity provision can be achieved in two ways: having an electricity supplier or using the electricity generated from the PV plant. The latter option is not always achievable due to size constraints of the PV plant.

It is important to secure a good electricity supplier since it can affect the PV plant's core business, electricity generation. Moreover, solar power plants with storage, which will be increasingly common in the future, will need a higher stable energy stream to function properly.

The Asset Manager is responsible for negotiating and managing the electricity supplier's contract established between the SPV and the supplier. This means that the Asset Manager is responsible for:

- Managing the long-term relationship between the Asset Owner and the service provider;

- Assessing and negotiating the annual price indexation;
- Renegotiating contract extension if needed.

7.15. Supplier penalties invoicing

It is not uncommon for EPC and O&M contracts to include penalty clauses linked to specific KPIs to protect the asset owner's interests.

EPC contracts typically include penalty clauses for the first few years of asset operation. Underlying KPIs are highly individual and may include plant PR, plant availability, grid connection date and deadlines for completing punch list items, among others. The responsibility for tracking these KPIs and managing corresponding payments may be transferred to the Asset Manager. In this case, detailed knowledge of the EPC contract and information on any funds withheld by the SPV is crucial.

Likewise, O&M contracts may include bonus or penalty mechanisms linked to KPIs such as PR, plant availability and reaction times, among others. In case of bonus payments, the Asset Manager needs to make suitable provisions in the financial planning. In case of penalties, the Asset Manager needs to calculate and invoice the penalty amounts to the O&M provider.

7.16. Interface with banks and investors

A photovoltaic plant is considered an infrastructure investment, thus one that requires high capital volume during the construction phase and low capital volume during the operation phase. Project finance is the most common source of financing for infrastructure projects. Project finance creates value by reducing the costs of funding, maintaining the sponsors' financial flexibility, increasing the leverage ratios, avoiding contamination risk, reducing corporate taxes, improving risk management, and reducing the costs associated with market imperfections. Therefore, project financing is a loan structure that relies primarily on the project's cash flow for repayment, with the project's assets, rights, and interests held as secondary collateral. Project finance is especially attractive to the private sector because companies can fund major projects off balance sheet. Usually the sponsors are bank consortia. A PV plant is only rarely financed by a regular commercial bank loan.

Nevertheless, project finance is a very demanding type of financing and entails a long list of requirements and periodic deliverables that usually come with a heavy set of penalties when not complied with.

The Asset Manager is responsible for having a comprehensive understanding of the financing contract in order to ensure that the periodic deliverables and requirements are met meaning that the Asset Manager assures the elaboration of all the documentation needed to comply with the financing contract requirements. Thus, the Asset Manager is responsible for the elaboration of bank periodic reporting, financial statements, coverage ratio monitoring, escrow accounts monitoring and business plan updates, among other requirements. Additionally, the Asset Manager is responsible for monitoring the non-financing contracts that are indexed to and locked by the project finance (usually land lease, Operation and Maintenance, security).

Although this generally represents a high workload for the Asset Manager, it is their responsibility to avoid penalties raised by contract non-compliance.

7.17. Equity/debt financing management

With regards to funding an infrastructure investment, an alternative to project finance is equity investing (investment funds, private equity firms, private investors and SPV's holding company equity, among others). Usually, a project is not entirely equity financed; in reality, the Asset Owner can opt for a mix between equity and debt.

The Asset Manager is responsible for having a comprehensive understanding of the equity agreement and the bank loan requirements in order to work for the SPV's maximum optimisation and profitability, maximising shareholder remuneration and complying with debt service. As stated in section 7.10. *Cash flow management* assumes an important role to ensure liquidity to comply with debt service schedule. Therefore, the Asset Manager is responsible for loan administration (including settlements and contracted interest rates supervision, debt service coverage, and compliance with requirements and deliverables, among other administrative tasks).

This type of funding is less demanding and has less deliverables, as its periodic reporting is usually less rigorous and aligned with the Asset Management monthly reporting.

Solar PV assets are increasingly re-financed during the operational phase, allowing the owners to benefit from more stabilised operations and a lower operational risk profile, leading to better lending terms. In these circumstances, the Asset Manager can provide additional services and support to the owners by feeding the refinancing due diligence process facilitating the collection of site information and documentation, as well as lead the discussion with technical and other advisors.

7.18. Tax preparation, filing and administration

The Tax Management Service includes tax preparation, filing and administration and can be included in the Asset Management contract.

The Tax Management Service is obliged to comply with local and international legal, regulatory and tax requirements. Therefore, a comprehensive understanding of these requirements is indispensable.

The Asset Manager is responsible for coordinating the work between the Accounting and Tax Service, complying with local tax authorities, providing simple tax support and ensuring payment of taxes, and checking if the deliverables required by the local tax authority are met. Moreover, the Asset Manager is accountable for reporting all regular and relevant information to the Asset Owner. Besides management support, the added value provided by the Asset Manager is a deep knowledge of the solar industry together with a critical analysis of the local tax authority's requests, given the financial environment. This could result in distinctive tax legislation interpretations which could have tax exemption as an outcome. Consequently, a positive effect on the SPV's profitability is generated.

Therefore, the Asset Manager conducts regular tax activities such as the preparation and filling of relevant tax returns (CIT, VAT, Stamp Duty, withholding taxes, among others) as well as the handling of tax authorities' correspondence and requests. However, whenever in the presence of unconventional or irregular situations, the Asset Manager should delegate the responsibility to an external local Tax Consultant, as specific expertise and a certified worker are both required. The Asset Manager becomes responsible for providing the Tax Consultant with all the necessary SPV documentation.

7 Commercial and financial asset management

/ continued

A short reference of the tax management activities is presented below.

Tax management

- Regulatory compliance oversight related to tax obligations
- Calculation and filing of the project companies' tax declarations
 - Handling Corporate Tax
 - VAT (registering, periodic filing and refund requests)
 - Handling Property Tax
 - Handling Withholding Tax

- Processing of tax payments
- Control of tax refunds
- Direct relationship with Tax Authorities.

7.19. Challenges of multi-jurisdictional and global portfolios


The principles of a sound Commercial and Financial Asset management are constant and should be deployed consistently across markets and jurisdiction to ensure efficiency and effectiveness of management as well as facilitate operational control and consolidation. However, the key tasks carried out as part of the Commercial and Financial Asset management require partial adaptation to the peculiarities of different markets and jurisdictions.

TABLE 13 COMMERCIAL AND FINANCIAL ASSET MANAGEMENT: CHALLENGES OF MULTI-JURISDICTIONAL AND GLOBAL PORTFOLIOS

TECHNICAL AM ACTIVITIES	MULTI-JURISDICTIONAL CHALLENGES
Financial reporting	For AM service providers with well-established data management and reporting practice (e.g. standardised budget codes), the location of sites in multiple and different jurisdiction should be essentially neutral. Aggregation of sites and data might be developed to assist the Owner preferred view of the international portfolio, but adjustments will need to be made for local currencies. Adjustments may also need to be made for different accounting standards.
Strategy management	A global strategy will need to be adapted to local laws and regulations.
Management of unsubsidised projects	More sophisticated Corporate PPA's and sales on electricity markets can be coordinated globally but require local expertise and management. Standardised invoicing tools and Energy Trading Risk Management Systems (ETRM) may be global to allow some harmonization for a global portfolio but local electricity market rules and regulations will require local solutions as well.
Corporate administrative services	This requires strong support from the legal function and depends on local Company law rules (articles of association etc). Shareholder Agreements may equally specify different obligations depending on what has been agreed.
Accounting	A key challenge is ensuring harmonization with local and international (IFRS) accounting standards).
Customer relationship	Asset Owners globally may have different ethics, cultures expectations and needs so a global portfolio with many different Asset Owners will need to adapt to this.
Accounting assistance	Harmonisation is key and standardised budget / accounting codes is critical for this purpose.
Invoicing/billing and payments	Driven by the contractual terms for each contract whether it be a revenue or cost for the SPV. Global IT solutions (Asset Management software, Enterprise Resource Management System) can support a global approach and allow easier aggregation of data for reporting purposes.

TABLE 13 COMMERCIAL AND FINANCIAL ASSET MANAGEMENT: CHALLENGES OF MULTI-JURISDICTIONAL AND GLOBAL PORTFOLIOS - *Continued*

TECHNICAL AM ACTIVITIES	MULTI-JURISDICTIONAL CHALLENGES
Revenue control	Can be very local depending on the electricity market rules in the country or region concerned. The Asset Manager may not always have access to the electricity meter directly and may be reliant on the grid operator to send the information for billing. Global IT solutions can again support revenue control and allow better checks of the data provided by a grid operator.
Cash flow management	A global Enterprise Resource Management System can support a global portfolio as well as global treasury software solutions for making payments.
Working capital reconciliation	As above.
Financial control	Good procedures and tools can help ensure the effective financial control of a global portfolio of assets.
Contract management (financial contracts)	This will depend on the content of the contracts but it is important to have a global database of key terms and obligations.
Suppliers account management	As above.
Suppliers penalties invoicing	A global asset supervision tool can ensure a global approach – good quality base data is key for these calculations which can often be set up directly in the supervision tool to avoid errors and ensure consistency of the calculation.
Interface with banks and investors	Infrastructure investors and banks are often present in multiple jurisdictions and require a single harmonized approach to reporting and communication.
Equity/debt financing management	This will depend on the content of the contracts but it is important to have a global database of key terms and obligations.
Tax preparation, filing and administration	A key challenge is local tax rules and regulations but principles may be similar.

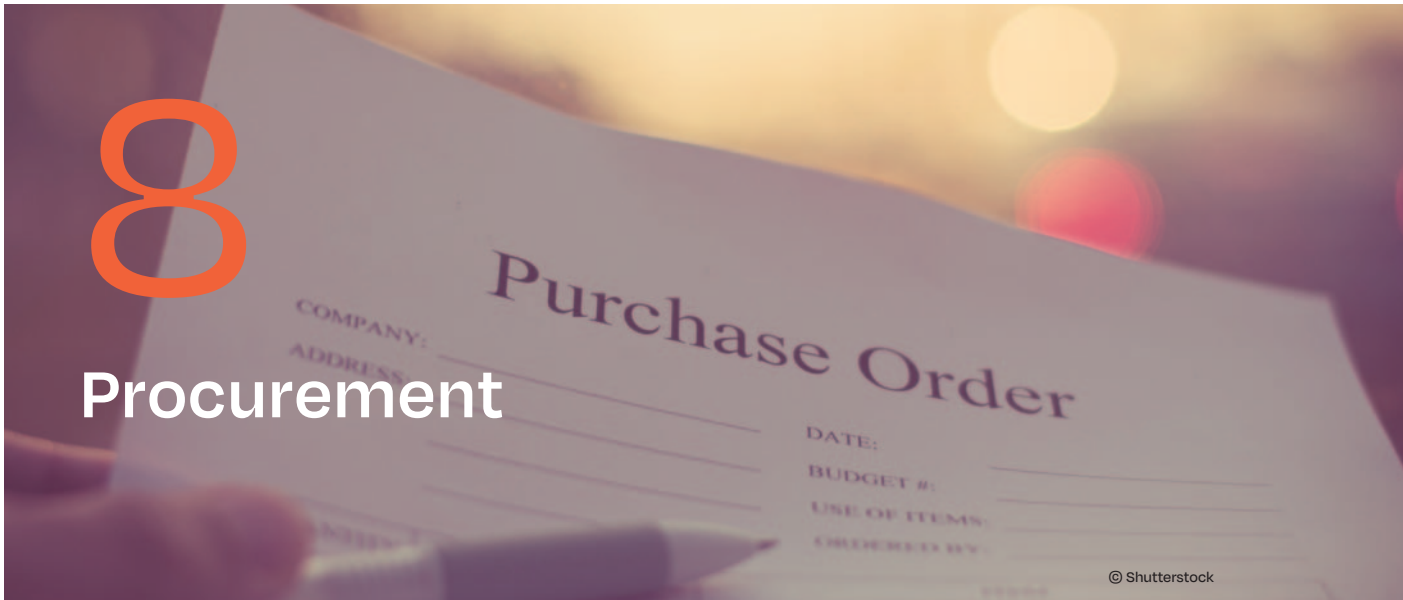


The role of the Asset Manager in the solar sector is crucial in order to identify, select and properly manage the key suppliers involved in the operation of the SPVs and the plants. (On the latter, see section 7.14. *Suppliers account management*.) In particular, the Asset Manager should leverage their know-how and network of contacts in order to both identify the right trade-off between price, quality of services and key contractual terms, and constantly adapt all of them to market conditions.

In line with the procurement best practices, before deciding the optimal procurement strategy, the suppliers should be classified based on two key criteria:

- **Strategic relevance:** in terms of value-added, overall costs in the supply chain and impact on profitability and quality.
- **Complexity of the supplier market,** in terms of number of suppliers, features of the supply (scarcity).

Taking these criteria into account, the main suppliers involved in solar power plant operation can be allocated in the following matrix seen in Figure 11.

FIGURE 11 KRALJIC MATRIX OF MAIN SUPPLIERS INVOLVED IN SOLAR POWER PLANT OPERATION

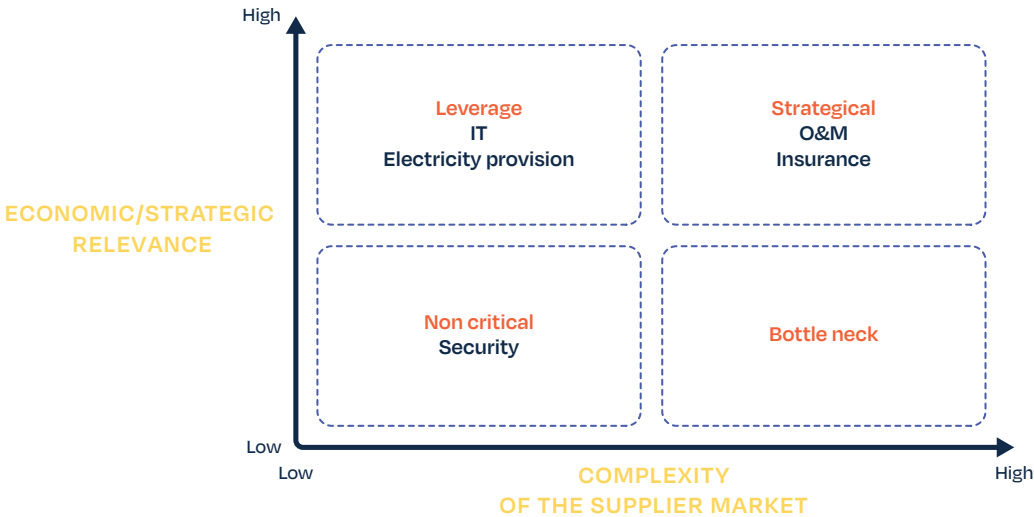

The position in the matrix drives the optimal approach to manage a supplier. In particular, the following approaches are recommended:

- **IT (connectivity), electricity suppliers** represent the so called “leverage” services. The impact on the business is very high: good connectivity allows efficient and continued plant monitoring while robust insurance coverage allows CAPEX and OPEX to be reduced in case of damages and thefts. The supply market for all these services is typically abundant. As a consequence, the advisable approach consists of standardising the need, concentrating large volumes of plants wherever possible (to achieve better terms), and involving a large number of qualified suppliers.
- **Security** represents, in most cases, a non-critical service³: the impact on the profitability of PV plants is limited (considering that direct and indirect damages are covered by the insurance policies) and the supply market is abundant. The recommended approach in this case consists of co-sourcing and standardisation of needs and volume bundling (possibly involving surveillance companies with a national presence in order to have the same counterparty in various regions, as also detailed in the following section).
- **The O&M contractors and insurance companies (for all risks policies)** represent a strategic supplier. The quality and effectiveness of the O&M activity have a relevant impact on the revenues as well as on maintenance costs related to the plants. Although the supply is characterised by a large number of operators, the recent trend in mature solar markets consists of an aggregation of operators (hence reducing the number of potential candidates). In addition, the number of O&M contractors with robust and local structures is very limited. This results in the selection process being particularly complex. It is advisable in this case to apply a collaborative approach and supply base redesign (information sharing, long-term agreements, supplier audit focused on managerial skills) and a value-based (rather than price-based) approach.

- **Insurance companies** have strategic relevance in the operation of PV plants, as with a solid all-risks policy in place, plant owners receive a relevant mitigation of risks in relation to both direct and indirect damages in case of thefts, fires, equipment failures and cybersecurity attacks. The procurement of insurance policies for renewable energy plants in the last few years has become increasingly complex due to a lower number of suppliers available. This is because several insurance companies left the market due to an actual level of risk being higher than initially expected. The presence of professional Asset Managers and more robust security equipment/clearer component warranties should give comfort to the suppliers in the future and result in more accessible procurement.

8.1. Main supplier requirements

- **IT (connectivity)**: Should provide coverage that is as broad as possible and, in particular, also reach remote areas where PV plants are typically located.
- **Insurance**: Should cover key operational risks (including cybersecurity for the reasons explained in Chapter 10. *Data management and high-level monitoring*). The role of the Asset Manager in the procurement process is key in order to ensure that the security equipment installed on each site is aligned with the requirements set out in the policies, as such requirements typically represent condition precedent and any inconsistency would result in the coverage being ineffective.
- **Security**: Should provide a professional service with an effective alarm management process and being able to prove the implementation of the agreed services (e.g. with punching).
- **O&M services**: Should have a strong technical know-how, a robust organisation structure to manage local interventions and spare parts, and to be able to fix plant unavailability as quickly as possible.
- **Ancillary services (electricity provision)**: Should provide high-quality customer services to support in administrative matters (i.e. bill payments).

³ This is not true for ground-mounted plants (particularly affected by thefts) in some particular geographical areas. In such cases, this service becomes “leverage” and requires the same approach described above for IT and insurance coverage.

8 Procurement / continued

8.2. Supplier selection and evaluation

The recommended methodology for an Asset Manager to select a supplier is the Analytical Hierarchy Process (AHP). As illustrated in the following figure, the AHP considers a set of potential suppliers. Each supplier receives a "rating" based on a set of evaluation criteria which are assessed based on specific indicators. It is important to note that since some of the criteria could be contrasting, it is generally untrue that the best option is the supplier that

optimises each single criterion, but rather the one that achieves the most suitable trade-off among the different criteria.

The AHP is very lean and in the selection process it allows not only quantitative but also qualitative elements to be taken into account. It also enables a different weight to be attributed to the different indicators and selection criteria, and hence, to attribute rational importance to the various aspects of the decision-making process.

FIGURE 12 OVERVIEW OF THE ANALYTICAL HIERARCHY PROCESS METHODOLOGY – ANALYSIS PRODUCED FOR EACH SUPPLIER

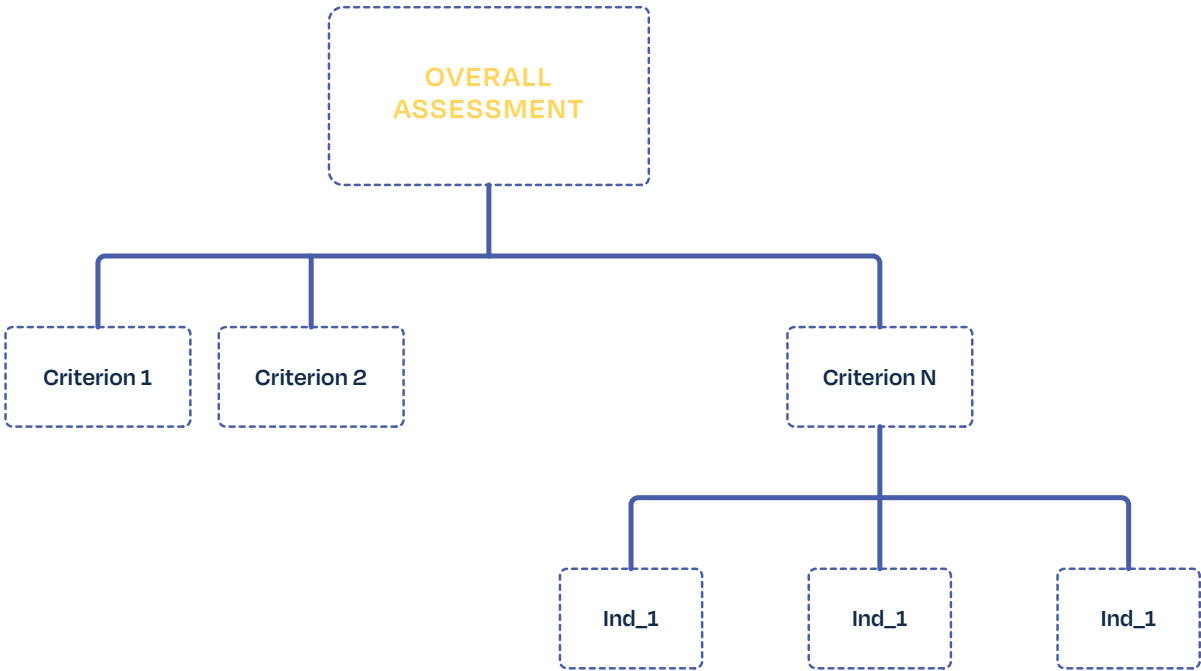


TABLE 14 KEY CRITERIA FOR THE SELECTION OF THE VARIOUS SUPPLIERS

SUPPLIER	CRITERIA	SOURCE OF INFORMATION
O&M ⁴	<ul style="list-style-type: none"> • Organisation structure • Track record • Pricing taking into account the scope of work and service level • Financial soundness • Bankability 	<ul style="list-style-type: none"> • Visit to control room • Q&A • Certifications • References • Internal data collected by the Asset Manager
Insurance policies	<ul style="list-style-type: none"> • Financial soundness of the insurance company • Effectiveness of the claim management process 	<ul style="list-style-type: none"> • Rating report • Track record provided by the insurance companies / the brokers • References provided by other clients
IT	<ul style="list-style-type: none"> • Reliability • Geographical reach 	<ul style="list-style-type: none"> • Track record
Security	<ul style="list-style-type: none"> • Reliability • Local presence (with direct personnel) • Effective management process • Relevant certifications in place 	<ul style="list-style-type: none"> • Track record (including references from other clients) • Visit to control rooms
Electricity provision	<ul style="list-style-type: none"> • Reliability • Customer service 	<ul style="list-style-type: none"> • Track record

8.3. Further considerations to be taken into account in the selection process

Consideration related to portfolios under management and scale effects

The Asset Manager can add value in the procurement process, not only by leveraging its proprietary know-how (based in particular on its direct observations and historical evidence of the activity of the various suppliers) and network of contacts, but also by allowing its clients to benefit from a scale effect, aggregating, for the purpose of running a tender process, the various portfolios, similar in terms of features, geographic location and client requirements.

Sourcing strategy

As the O&M activity represents a strategic service, if the solar portfolio has sufficient scale, it is advisable to avoid a single sourcing (i.e. allocating 100% of the activity to the same contractor). Instead, either a second sourcing (by identifying a main contractor which would manage the majority of the plants and a

second contractor with a more limited exposure) or parallel sourcing (with two or three contractors which manage similar percentages of the portfolios) is recommended. Both these strategies (to be applied based on the features of the portfolios and of the O&M contractor market) have the advantage of a collaborative approach between O&M contractors involved while at the same time leaving the possibility of benchmarking, better peak management and a pre-identified backup operator leading to a smooth switch in case it is needed.

In addition, in the sourcing strategy of the O&M contractor, an Asset Manager/Asset Owner should consider the relevance of its contracts in relation to the activity of each selected contractor. In particular, for large portfolios assigned to relatively smaller operators, since it is very likely that there is a situation of high dependency (i.e. high percentage of the contractors turnover represented by the plant owner),

4 To evaluate O&M contractors, it is recommended to use SolarPower Europe's O&M Best Practices Checklist which is based on the O&M Best Practices Guidelines and can be downloaded from www.solarbestpractices.com.

8 Procurement / continued

it is advisable to apply either a partnership approach or “responsible supplier management” by making a long-term commitment in order to allow the contractor to organise their resources and make the relevant investments to reach a high-quality delivery.

The role of financing institutions in the selection process

In case of portfolios with bank financing in place, the process to select the strategic contractors (mainly O&M, insurance companies and PPA counterparties and negotiate the mandate with them) should take the prescriptions of the loan agreement into account, which in some cases may contain a template of the agreement to be entered into. In addition, the selected supplier should be approved by the financing institution following a qualification process.


Health & safety considerations

An Asset Manager should also ensure that the O&M contractors and the surveillance companies respect the right H&S requirements by conducting a so called “technical professional verification”, i.e. by verifying the compliance with training programs and medical requirements, as well as by reviewing the existing risk rating document.

8.4. Supply account control

The role of the Asset Manager is crucial in order to ensure that each supplier delivers a high-quality service according to market best practice and contractual obligations. In order to monitor the supply account, the Asset Manager should identify some indicators, periodically monitor them, and take appropriate and timely actions in case of situations not aligned with expectations. The most common KPIs are summarised in the table below.

FIGURE 13 MANAGEMENT OF CONCENTRATION RISKS

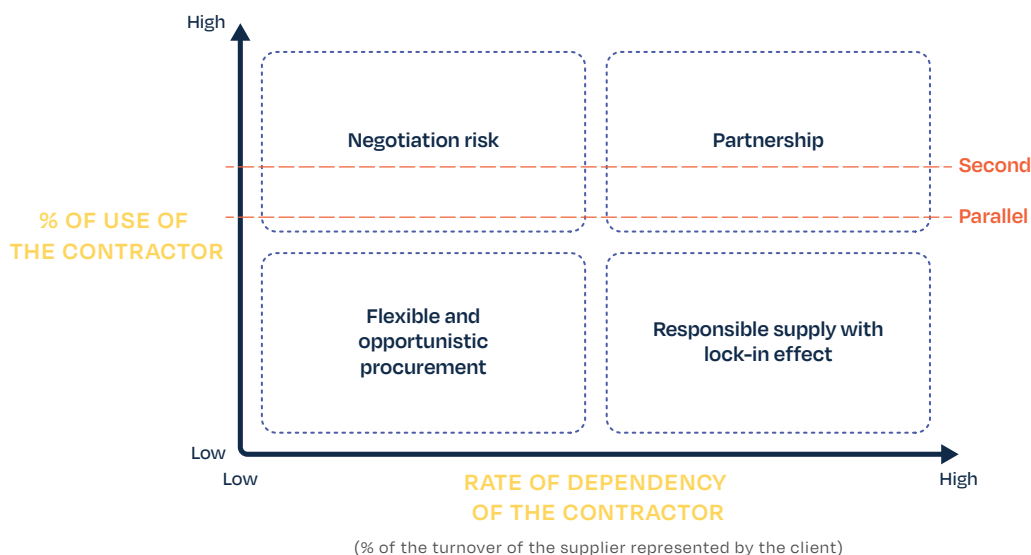

SOURCE: Procurement, SDA Bocconi.

TABLE 15 KEY PERFORMANCE INDICATORS FOR RELEVANT SUPPLIERS

SUPPLIER	KPI	FREQUENCY OF VERIFICATIONS
O&M	<ul style="list-style-type: none"> Track record of contractual KPI guarantees (Availability, Response times)⁵ 	<ul style="list-style-type: none"> Monthly
Insurance policies	<ul style="list-style-type: none"> Respect of the requirements during the life of the contract Monitor through the broker the financial soundness of the counterparty Ensure a smooth and quick process to manage claims 	<ul style="list-style-type: none"> Continuous
IT	<ul style="list-style-type: none"> Days of availability of the services 	<ul style="list-style-type: none"> Continuous
Security	<ul style="list-style-type: none"> Number of thefts that occurred in the plants Reaction time in case of thefts Evidence of the activities (e.g. patrols) conducted 	<ul style="list-style-type: none"> Monthly / in case of events
Electricity provision	<ul style="list-style-type: none"> Response time of the customer service in case of issues 	<ul style="list-style-type: none"> In case of events

8.5. Supply chain control

It is important for each provider to identify and mitigate the risks related to the supply chain, i.e. to avoid the risk of poor service or lack of delivery which may have negative effects on the overall risk-adjusted returns of renewable energy assets.

To this end, the Asset Manager should keep strict control not only on the supply side (through a combination of appropriate controls during the selection phase and ongoing monitoring, and pre-identify back-up plans) but also on the demand side by ensuring smooth interaction and timely communication with the suppliers.

Another important factor to take into consideration is the possible verification of extraordinary events (as recently demonstrated by the impact of the coronavirus pandemic) that may affect the delivery capability of key suppliers. In order to ensure business continuity, it is important to adapt a combination of risk mitigation practices: avoid concentration risk (and have a “backup” suppliers, even with a lower allocation of activities but ready to step in), outsource to organization with a local presence and to ensure that the suppliers have a safe data storage with backup systems accessible remotely.

Supply side

Table 16 on the following page presents the main supply side risks and suggested mitigation measures.

⁵ For details, see chapters 11. Key Performance Indicators and 12. Contractual Framework of the O&M Best Practice Guidelines.

TABLE 16 SUPPLY CHAIN RISKS AND MITIGATION MEASURES

SUPPLY CHAIN RISK	RELEVANT SUPPLIER	MITIGATION MEASURES
Poor quality of services	O&M, surveillance	<ul style="list-style-type: none"> • Ensure the proper KPI as described above and take immediate actions in case of alarming indicators • Avoid single supplier in case of portfolios with critical mass
Unavailability of services due to technical issues or extraordinary events	Ancillary services, IT, O&M, surveillance	<ul style="list-style-type: none"> • Constant supervision and immediate alert of the Asset Manager • Pre-identified alternative suppliers to involve in case of persistent issues
Inflexibility of supply source	O&M, surveillance	<ul style="list-style-type: none"> • Parallel, Second sourcing
Subcontractor risks	O&M, surveillance	<ul style="list-style-type: none"> • Verification of the contractor supply chain during the selection
Bankruptcy of the suppliers/suppliers exiting the relevant market	All suppliers	<ul style="list-style-type: none"> • Multiple providers (if allowed by critical mass), although this requires a higher management effort – all providers • Request of insurances (e.g. bonds for PPA)
Lack of relevant renewal of legal and H&S certifications	O&M, surveillance	<ul style="list-style-type: none"> • Constant supervision by the Asset Manager • Parallel/second sourcing to allow a smooth and rapid switch in case of persistent non-compliance

Demand side

As mentioned above, the Asset Manager should also both directly and by providing guidance to its clients, help the suppliers in properly executing their activities. The supply chain can be positively affected by proactive actions on the demand side in the following circumstances:

- **Accurate planning:** In case of predictable peaks (e.g. in case of a planned relevant revamping interventions or with relevant upcoming plant acquisitions) it is crucial for the Asset Manager to inform the relevant suppliers involved in order to allow them to properly arrange the delivery and avoid resource bottlenecks and be able to serve the client needs in due course.
- **Accurate information shared with the suppliers:** Both during the handover phase to a new supplier and the ongoing activity, there should be a constant and constructive sharing of information in order for the Asset Manager to be aware of critical aspects and proactively solve them.



9 People and skills

A skilled workforce is key for the solar industry to work. This is especially the case for service providers such as Asset Managers, who rely on their personnel's skills to a large extent to deliver quality services to their clients. It is essential that AM providers have human resources with the relevant qualifications to perform the tasks detailed in this document in an efficient and responsible manner. This report includes a useful skills matrix for Asset Managers, see *Annex a*.

It is not easy to determine the exact skills and profile that an Asset Manager should have. However, two major groups of skills are required:

The first group is technical skills. In this group there are two different types of employees. Those who have academic studies in Electrical and Mechanical Engineering and those who have practical field experience and relevant electrical and technical qualifications.

Key technical skills are:

- Management and policing the effective service provision of O&M providers
- Familiarity with faults/alerts and necessary action
- Ability to interpret events into meaningful information for Asset Owners
- Ability to provide reports and present options to Asset Owners
- Knowledge of EH&S and familiarity with on-site for inspections.

Therefore, ideally, the Technical Asset Managers will have previous experience in the EPC or O&M of solar assets. However, with the right training programme, Asset Managers can develop the skill set needed.

The second group is commercial and financial skills. This group requires people qualified in financial management and accounting through academic studies and those who have acquired their qualifications by actively working in the sector.

9 People and skills / continued

Key commercial and financial skills are:

- Management of incoming and outgoing accounting flows
- Monitoring income and cost streams and comparing them to a baseline scenario (i.e. P50, P90, etc.)
- Forecasting the financial impact of specific technical interventions (preventive or corrective) on the assets
- Financial management and reporting
- Loan management
- Knowledge of legislative and regulatory changes that might have a financial impact on the client.

Therefore, previous experience in investment accounting and financial management are useful.

It is important to note that different countries and markets have distinct requirements for the qualifications and skills necessary for Asset Managers in both key groups to operate. It is important that Asset Managers map those requirements with the help of experts and consider them in their HR hiring requirements.

As the industry develops, technology is advancing rapidly, which requires Asset Managers to be trained regularly on new best practices. Such new best practices are increasingly related to the digitalisation of AM. As data and digital systems become more critical for effective AM, it is expected that Asset Managers will soon need to employ specialised personnel with skill sets and academic background that combine knowledge of energy data and information systems.

Considerations about the organisation structure

The asset management team is typically multi-disciplinary, since it has to cover both financial administrative and technical activities.

In light of this, the organisation structure of an Asset Manager should be designed to allow specialists to be involved on each task while at the same time ensuring constant interaction among the various team members. This avoids “grey areas” in the scope of work of the various divisions and applies an integrated approach to asset management.

In particular, when structuring the team, it is advisable to:

- Introduce the role of Portfolio Manager, i.e. professionals with a 360-degree view of the portfolio under management and the ability to facilitate team interaction, identify synergies, and ensure the adoption of a holistic approach to asset operation and optimization;
- Avoid the presence of multiple sub-teams, as this can result in difficult internal communication and confusion about the allocation of responsibilities;
- Introduce the role of a cross-country Chief Operating Officer in the event that the Asset Manager operates in several jurisdictions, making it possible to achieve standardization, coordination, and knowledge sharing wherever possible.

In addition, taking into account the importance of digitalization and the continued evolution of the asset management activity, the organization structure should also mirror the “software structure” as well as allow innovation to happen (either by dedicating some team members to innovation or by identifying “champions” on each team that drive and manage relevant changes).

10

Data management and high-level monitoring

© Shutterstock

Asset Managers have the responsibility of monitoring and overseeing the activities performed by the O&M service providers as well as managing the ongoing obligations of the plant to ensure its longevity and profitability, as detailed in the previous chapters.

All different positions borne by the Asset Manager can benefit from new digital instruments, which allow for more efficient data management and ensure the best, most cost-effective power plant operation. These instruments include plant performance advanced data analysis and management, O&M site activity supervision, contract management, administrative follow-up and optimisation. Ideally, an Asset Manager should make use of an Asset Management Platform that can undertake all of the digital aspects or can link to external specific digital tools to consolidate all relevant information. There is tendency in a maturing industry to opt for solutions that integrate the functionalities of Monitoring Systems, Computerised Maintenance Management Systems (CMMS), Digital Twins and Enterprise Resource Planning Systems (ERP) in one software. Such integrated solutions allow Asset Managers (and O&M Contractors) to analyse all parameters including plant technical data, maintenance activities related information (including all costs associated to it) and contractual data in one central platform. Such integrated solutions can be considered a recommendation.

Advanced data analysis services come in many forms, with the most sophisticated using special algorithms including machine learning for exploring big data to surface value and enable predictive analytics. Service providers with experience and knowledge in the solar industry can combine this with digital analytics to transform data into intelligence and thus develop decision support systems. Hidden problematic areas in a solar asset can be identified and concrete actions for performance maximisation provided. In addition, strategies for reducing O&M costs, based on comprehensive plant data, can be devised. Another aspect which is increasingly being offered to make operations more efficient is the automation of monitoring, also possible in combination with, and as a side benefit of, advanced data analysis. The latter also simplifies the overall reporting documentation side for Asset Managers. Many suppliers offer web-based dashboards to simplify integration and allow for Results-as-a-Service. There is also a further trend towards the use of autonomous platforms providing advanced data analysis to allowing the Asset Manager to integrate this as a product as opposed to a consulting service. The remote nature of the service also means that it can be integrated into a Monitoring System & Asset Management Platform and no hardware or software installations are necessary.

10 Data management and high-level monitoring

/ continued

Additionally, the Asset Managers must have access to all data that the O&M service providers have at their disposal and the technical and operational data generated from the O&M service providers' activities. Asset Managers are further responsible for capturing all data related to their various activities, such as cost and financial data, commercial data, compliance data, contractual & regulatory data as well third-party data, necessary for the Asset Owners. Asset Managers are required to provide regular status reports to Asset Owners and require access to data provided by the O&M service provider relating to the monitoring of the plant, O&M service repair activities, and all data related to necessary compliance processes.

A reliable and fast internet connection is key to enable the above. 5G is the next wireless standard for Internet connectivity. It is presented as an opportunity to enable the energy transition by facilitating the management of distributed, variable and unpredictable energy generation such as solar PV. The reason for this lies in 5G properties, amongst which increased data flow capacity and lower latency of signals are key for an efficient distributed energy generation. The increased data flow capacity will enable the communication from, to and between the large number of devices and sensors that are needed to master the operations of smart grids in a robust and reliable way, especially with respect to self-consumption and storage technologies management. This is relevant for example to determine the best cycling of batteries for their life improvement or to ensure that critical load appliances power supply is always made available with the highest priority. In an effort to avoid congestion to the grids that might be caused by unpredictable renewable energy generators, the low-latency capability of 5G is crucial. It is said to be in the order of 20ms for remote sites, which can be considered a nearly real-time signal capability. This is also made available by dedicating some bandwidth, the so-called "network slicing" to specific crucial activities such as commanding power plants to turn off or derating their power generations within the shortest, near-real-time delay.

Asset Managers should comply with the following guidelines regarding data and data management to ensure the most efficient operation of their power plants. To be able to achieve this, the Asset Managers should use an Asset Management Platform.

10.1. Asset management platform functionalities

An Asset Management Platform is a software package or suite of tools that is used by the Asset Manager to store and manage technical and non-technical data and information collected from and relating to the solar asset, portfolio or SPV. It combines the abilities of a Computerised Maintenance Management System (CMMS) and an Enterprise Resource Planning System (ERP) into an Enterprise Service Management System.

It is the Asset Management Platform that makes it possible for the solar industry to transition to an asset-centric, information-based management approach, which addresses three key challenges: (1) loss of generation and income, (2) loss of time, and (3) lack of transparency. This is in contrast to the traditional linear Asset Management approach, where information flows from the asset through the O&M Contractor to the Asset Manager and ultimately to the Asset Owner. This linear approach means that the Asset Owner does not have direct access to data from the solar power plant and, rather, information is filtered before reaching the asset owner, creating a lack of transparency and mistrust between the three key stakeholders.


This section presents how Asset Management Platforms support the Asset Managers in their roles and responsibilities.

10.1.1. Reporting

The Asset Manager should collect and share with their clients all key data/deadlines to demonstrate compliance with the expected deliverables set out in the Asset Management contracts. In some cases, based on a client's requests and SLA, delays or failures associated with the fulfilment of such obligations may result in the Asset Management company having to pay penalties (consider referring to the chapter on contractual framework).

The key data/deadlines should be identified based on the client's priorities and agreed scope of work. However, some typical areas are identified and summarised in Table 17 on the following page.

FIGURE 14 TRADITIONAL LINEAR ASSET MANAGEMENT APPROACH AND ASSET-CENTRIC INFORMATION-BASED APPROACH WITH THREE KEY STAKEHOLDERS OF ASSET MANAGEMENT

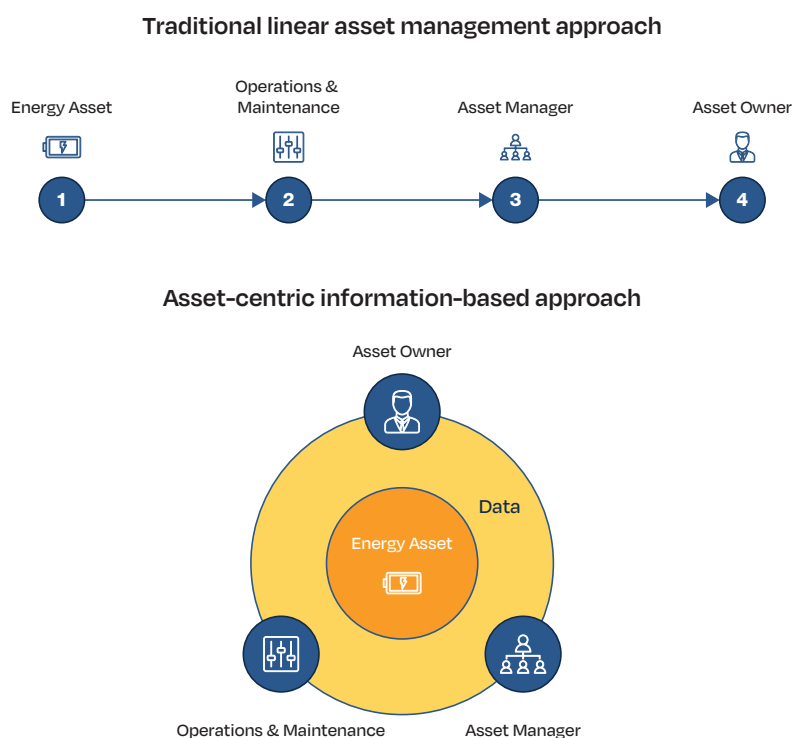

SOURCE: Greensolver.

© SOLARPOWER EUROPE 2019

TABLE 17 FREQUENCY OF KEY DATA PROVISION

DESCRIPTION	FREQUENCY
Date of delivery of AM reports	Based on client requirements (typically monthly)
Date of delivery of annual budget	Annually
Technical KPIs verified	Monthly
Revenue data	Monthly
Cash balance and reforecast	Monthly
Key contractual deadlines	Quarterly
Plant incidents (open, pending and closed)	Monthly
Financial reports (Balance Sheet, P&L, CASH FLOW), also on a consolidated basis	Quarterly
Reports for state or local agencies and authorities	Annually or as per country requirement

10 Data management and high-level monitoring

/ continued

Once identified, these requirements and activities must be calendarised in the Asset Management Platform. Apart from simple calendar entries, the platform should also include escalation features, for example for overdue items, to ensure that important tasks are not neglected. Such escalation should ideally involve multiple team members, depending on their role and position in the hierarchy.

10.1.2. Site construction due diligence

The Asset Manager should perform due diligence on the knowledge and expertise of the EPC contractor. All documentation and certification should be digitalised in the Asset Management Platform's Documentation Management System (DMS). Re-certifications and training schedules should be calendarised. It is essential that the Asset Manager sources impartial and independent testing, inspection and oversight during the key milestone reviews.

10.1.3. Optimisation of energy production

Power plant KPIs and O&M Contractor KPIs, as defined in chapter 11. *Key Performance Indicators* of the O&M Best Practice Guidelines, should be calculated automatically by the monitoring platforms and should be integrated in the Asset Management Platform and used as a reference for contract compliance. It is important that these KPI calculations take various contractual clauses (exclusions) into consideration, for example in periods of force majeure events.

10.1.4. Regular updates and software reliability

Asset managers should be involved and interested in further developing the capabilities of the Asset Management Platform they utilise. This can be done through typical feedback mechanisms with the chosen software vendors utilised, but this can also mean using broader parts of the Platform to further digitalise operations as the Asset Manager evolves with functionalities.

The implementation of an Asset Management Platform can often serve as a great opportunity to continuously review internal activities and processes to ensure that Asset Managers are focusing on value added activities rather than data entry.


The Asset Management Platform must be updated continuously and during every update performed, it must be able to continue collecting the technical data from the monitoring systems within which it is integrated.

Asset Managers should also take steps to ensure the reliability and bankability of their software vendors as this may impact data continuity in their operations. See section 10.7. *Data Portability, Backup and Disaster Recovery* below.

10.1.5. Lifecycle data collection

To ensure investment durability, it is recommended that the Asset Manager is involved in the project from the development and construction phases, collecting and managing all related data at each phase for easy and comprehensive reporting. This task can be streamlined

FIGURE 15 TYPES OF DATA COLLECTED ALONG THE LIFECYCLE OF THE PROJECT

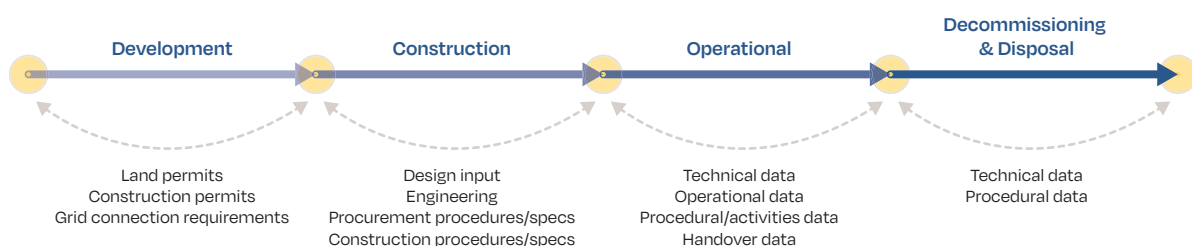

through collaborations, incorporating advanced digital twins and data analysis into the traditional AM structure – something that is increasing in popularity. Moreover, the AM should, as a best practice, utilise data and lessons learnt across project portfolios.

10.1.6. Operational risk management

The Asset Management Platform should collect and monitor relevant data in order to mitigate the major risks which may arise during the life of the assets, in particular:

- Keep track of serial numbers of components replaced to ensure the required communications to relevant authorities have been submitted (to avoid risks related to the authorisations in place)
- Monitor and record all relevant maintenance interventions, including cost data, conducted in order to ensure that the plants are kept in an efficient status. It is becoming more common for Asset Managers to commission annual aerial thermographic inspections to better understand the overall health of an asset.
- Ensure key terms of insurance policies (e.g. deductibles, maximum reimbursable amounts) are consistent with the existing level of risks
- Calculate and monitor relevant covenants (D/E, DSCR, LCCR) related to the financing in place (if any).

10.1.7. Procurement process management

The Asset Management Platform should enable the activities explained in chapter 8. Procurement by collecting relevant data to properly manage the procurement process in relation to key suppliers (i.e. number of plants with similar features to benefit from scale effects, contractual deadlines, warranty termination dates).

10.1.8. Deadlines management

In order to be fully compliant with regulatory requirements, an Asset Management Platform should support the Asset Manager in tracking and keeping under control the relevant deadlines for the required communications and collect the information that needs to be provided (e.g. annual production data requested by municipalities).

10.1.9. Health & safety records

The Asset Manager must ensure that adequate records are kept in the Asset Management Platform to ensure and demonstrate that relevant H&S standards and requirements are set and maintained. It is expected that a set of metrics will be agreed between parties to allow the reporting of events on site and encourage and judge adherence to standards and incremental improvements to the systems and associated standards.

10.1.10. Incidents records

To manage incidents and dysfunctions, the Asset Manager needs to record and have access to all data related to the solar asset, portfolio or SPV. Such data includes technical, operational, financial and market data.

10.2. Types of data collected through the Asset Management Platform

To ensure a full picture of the performance of a project, Asset Managers rely on several sources of data or information. Typical data sources include:

- Monitoring service providers
- Inverter data providers
- Data acquisition solutions
- Meter operators
- Aerial inspection data providers
- Satellite data providers
- Weather forecast data providers
- Energy exchanges
- CMMS solutions
- Exchange rate data providers
- Accounting solutions and ERP systems

For each source, it is important what data the Asset Managers are collecting, at what frequency and when. Beyond this, it is also important to understand the necessity and relevance of collecting and aggregating such data. Data is analysed and collected to enable good decision-making. To do so consistently requires good quality and reliable data. Data reliability can be enhanced through a data cleansing and data quality checking process via external data analysis services, should this not be possible or covered in the O&M scope.

10 Data management and high-level monitoring

/ continued

It is important that the Asset Management Platform can generate consolidated reports with much of the data listed below. There are reports, for example technical reports, that are needed on Plant level, but some high-level reports, like financial statements, are needed both on Plant as well as Portfolio level. Here are some key types of data that an Asset Management Platform should have access to:

10.2.1. Technical data

Refers mostly to PV power plant data as referenced in chapter 11. *Key Performance Indicators* of the O&M Best Practice Guidelines:

1. Raw data measurements: data obtained directly from the PV plant and used for performance calculation.
2. PV power plant KPIs using the raw data from the PV plant to give a more balanced overview of the operation of the PV plant.

10.2.2. Operational data

Operational data goes beyond the technical data to encompass other relevant interpretations of the technical data as well as activities performed or logged by the O&M contractor:

1. Alerts driven or identified by the monitoring systems.
2. Decisions made by Technical Asset Managers based on alerts or technical data, including the overall timeliness of such a decision or response.
3. "On- or Off-site" actions taken by the O&M contractor, including:
 - a. The overall timeliness of such decision or response (see 11.2. O&M Contractor KPIs of the O&M Best Practice Guidelines).
 - b. Warranty & Insurance information (if needed).
 - c. Spare parts used.
4. Updated forecasts or performance projections. Its important that the Asset Manager understands and has confidence in the asset Yield and PR calculations.
5. Records of maintenance, repairs and updates to the system.
6. Compliance with technical permits or agreements (interconnection, water, environmental).

10.2.3. Financial & commercial data

Also, financial and commercial data should be integrated into the Asset Management Platform and be linked to technical and operational data when possible (e.g. costs of a specific maintenance intervention, cost of an insurance claim) and seen holistically should include, at the very least, budgeted and actual figures on:

- Revenue (including any incentive programs)
 - Billings, payments & collections
- Expenses (including financing costs, with a focus on planned vs. unplanned expenses)
- Financing information and expectations (debt, equity, etc.)
- Financial statements (balance sheet, profit & loss, and cash flow statements)
- SPV administration (signatories, authorisations, structures, requirements)
- Tax status, filing timings, etc.
- Insurance (status, conditions, claims, etc.)
- Documentation (requirements, key documents, etc.)
- Compliance records

10.2.4. Contractual & regulatory data

Solar projects are usually constrained by several agreements and regulations. Asset Managers need to have all relevant information at their fingertips to be effective and efficient, as they are often responsible for the contractual administration and regulatory compliance of their projects.

Data related to contract management:

- Amendments
- Updates
- Renewals

This goes beyond simple contract administration and management to include:

- Legal compliance
- PPA administration with all that they entail (calculations, frequency, escalators, terms & conditions, etc.)
- Power Generation License

- Building & environmental permits
- Stakeholder engagement requirements
- And any other contractual requirements

10.2.5. Third-party data

Asset Managers not only need to understand and aggregate data that come from their projects and their operations, but also, more and more Asset Managers need to understand how to deal with and manage data and information coming from third parties.

Market data

With more and more solar projects starting to have exposure to market conditions and trading opportunities, electricity market information is becoming increasingly important. This can include nodal prices, spot prices, future prices, price forecasts, etc. Ultimately, the structure of the agreement surrounding the market dispositions of a project will clearly dictate what to monitor, log and watch. This can be grid measurements, rates, schedules, etc.

Weather data

This is often lumped in with technical data through an on-site pyranometer or weather station, but more and more third parties offer reliable data feeds that can be incorporated into an Asset Manager's overview or simply as a validation point for on-site equipment.

Other data

Additional types of data sources can be accessed. The important point is to understand why these sources matter and the business objective behind them.

10.3. Data format

The data format of the recorded data files must respect standards such as IEC 61724 and must be clearly documented. Data loggers should collect all inverter alarms in accordance with the original manufacturer's format, to ensure all available information is obtained.

To improve data quality, standardisation of data sources would help avoiding any need for manual data processing of normalisation and reformatting before

any aggregation. In this way, data exchange – before or after aggregation – between stakeholders will happen with increased transparency and reduced time.

This is especially important for PV plant metadata (e.g. location, number of components, nominal power, electrical drawings, position of components in the field, etc) which is of fundamental importance for the creation of a PV digital twin and for the calculation of metrics needed in decision support systems.

A best practice is that all data are stored in the same database before any processing.

10.4. Aggregating data

Data collected from the site shall follow a rigorous normalisation and aggregation process where the most accurate site data model is taken into account. The data model shall be shared between AM and O&M in such a way that the same rules of data processing are applied. As an example, a thorough data cleaning, the process of recognizing and interpreting wrong signals, is the basis for a correct data aggregation in the small scale before aggregating at larger time and object levels. Using the same photovoltaic model including loss computations and performance formula will result in an increased transparency and an easier communication between parties and in general will allow smoother and cost-effective reporting and communication processes.

Often the information gleaned from any data source is of relevance at the individual asset level; however, it can increase in value across multiple projects. At an aggregate level, looking at trends or precursors, we can see the compounding effect of variances and quantify/identify systematic risks that would not be as visible on a single project. A definitive best practice is the ability to view and interact with different types of data at the portfolio and asset level. Third-party data analysis providers are being increasingly integrated into the traditional Asset Manager/O&M structure for exactly this purpose in the case of larger portfolios with disparate O&M providers.

Often enough different data types will have different taxonomies, definitions and formats. And in a similar fashion they may "live" in different systems. Thereby the best practice of aggregating this information is in a primary Asset Management system.

10 Data management and high-level monitoring

/ continued

10.5. Interoperability

A central asset management platform should gather together all information available from several digital tools and hardware and provide a centralized working interface accessible to any stakeholder internal and external to the asset management company. The asset manager shall be able to attribute to any user an access with restricted data and functionality visibility depending on the degree of confidentiality and the function of the stakeholder.

This way, the same set of data can be easily accessed from different angles allowing the best efficiency, quality and transparency of information exchange.

A versatile asset management platform shall be able to embrace information coming from any existing and future digital service by supporting all protocols listed in the table below and having a flexible model that could easily interpret a new set of parameters and KPI that could appear to be relevant for the business.

As a best practice, the system should ensure open data accessibility, to enable an easy transition to Asset Management Platforms. The table below shows some examples of data integration options. Due to the lack of unifying standards, this is normally not the case and every Monitoring System provider has their own method to store and retrieve data. Best practice systems have the possibility to retrieve data by using open APIs such as RESTfull, providing interoperability between different systems.

10.6. Cybersecurity

In order to enhance cybersecurity, the Asset Manager typically performs also periodic audits on the main suppliers (the O&M contractors in particular) who have access to relevant data and connectivity of the plants. The audit mainly aimed at ensuring that the personnel is properly trained in relation to procedures for data protection (e.g. policies related to passwords, protection of access to relevant devices) and can detect and avoid possible cyber-attacks.

TABLE 18 EXAMPLES OF DATA INTEGRATION OPTIONS

METHOD	ADVANTAGES	DISADVANTAGES
FTP Push or FTP Pull	<ul style="list-style-type: none"> • Easy to implement • No need for additional hardware 	<ul style="list-style-type: none"> • Not secure unless: <ul style="list-style-type: none"> • proper VPN is set up, • using sFTP or FTPs encryption method, • FTP access control methods implemented. • Limited control of data flow to the FTP server.
Modbus/TCP (with additional logger on site)	<ul style="list-style-type: none"> • Reliable and secure • Best control of data flow 	<ul style="list-style-type: none"> • Additional cost for additional hardware. • More time-consuming implementation. • Relies on the existing monitoring system hardware, hence two hardware vendors involved.
API (or similar) in the cloud	<ul style="list-style-type: none"> • Fast and easy to implement • No need for additional hardware • Reliable depending on providers' conditions and communication conditions 	<ul style="list-style-type: none"> • Small time lag from data collection to final destination (data pull technology requires automated back-filling technology in case of data gaps or communications issues). • Relies on the existing monitoring system vendor, double fees for monitoring. • (No control over data). • API may face data quality issues and limits – data granularity, data depth, availability, correctness, currentness, completeness – depending on the provider's terms conditions (SLAs) and technical abilities.

In addition (as clarified in chapter 8. *Procurement*), as part of the risk mitigation activity, the asset managers support plant owners in identifying and activating insurance policies that also cover the risks of indirect damages (i.e. missed productions) deriving from cyber-attacks. Since such attacks, in some extreme circumstances, can even determine plant outages that may require a long period of time before being solved, an insurance coverage is particularly relevant to avoid the exposure to significant revenues losses.

Ultimately the role of the Asset Manager is often to raise awareness about the importance of cybersecurity as it relates to the management of the plants.

Since PV plants will at least include inverters and power plant controllers (and monitoring systems) and these are expected to be accessible from (i.e. connected to) the internet to enable surveillance and remote instructions by operators, they have significant exposure to cybersecurity risks.

Cybersecurity comprises technologies, processes and controls that are designed to protect systems, networks and data from cyber-attacks. Effective cyber security reduces the risk of cyber-attacks and protects organisations and individuals from the unauthorised exploitation of systems, networks and technologies.⁶

Cybersecurity is a vast area and multiple measures are imaginable. The following hints may help as a starting point:

- Keep it simple: If possible, the number of network devices should be reduced to a minimum.
- As a recommendation, traffic of the network devices may be monitored in order to detect abnormally high use of bandwidth.
- Physical access to the network devices should be secured and a secure password policy should be implemented. The use of standard passwords should be especially avoided, and all factory setting passwords should be changed.
- Access from the Internet should be controlled via strict firewall rules:
 - Port forwarding should not be used because this is a big security gap. Only router ports that are necessary should be opened.

- Remote access should be limited to the necessary use cases.
- The use of VPNs (Virtual Private Networks – a secure connection built up from the inside of the private network) is necessary.
- VPN access to the site from outside is a minimum requirement.
- A VPN server or VPN service which works without requiring a public IP on-site should be preferred.
- Each PV plant should have different passwords.
- Documentation should be kept up to date to be sure that no device was forgotten.
- Different roles should be used to the extent possible (e.g. read only user, administration access).
- Professional (industrial grade) hardware should be used; only such hardware provides the security and administration functions plants need to be secure.
- Vulnerability management should be implemented (i.e. identifying and remediating or mitigating vulnerabilities, especially in software and firmware) by:
 - Improving insecure software configurations.
 - Keeping the firmware and software of devices up to date.
 - Using anti-virus software if possible and keeping it up to date.
 - Avoiding wireless access if it is not necessary.
 - Auditing the network with the help of external experts (penetration tests).
- Keeping companies safe:
 - Passwords should not be stored in plain text format, password managers should be used (e.g. 1Password, KeePass etc).
 - Employees should be trained on IT security awareness.

⁶ Definition: <https://www.itgovernance.co.uk/what-is-cybersecurity>.

10 Data management and high-level monitoring

/ continued

- Not all employees should have access to all plants. Only those should have access who need it. This way damage can be prevented in case one employee is hacked.
- Management of leaving and moving employees: in case a plant overseeing employees changes positions or leaves the company, the respective plants' passwords should be changed.

It is therefore best practice that installations undertake a cyber security analysis, starting from a risk assessment (including analysis at the level of the system architecture) and implement a cybersecurity management system (CSMS) that incorporates a plan-do-check-act cycle. The CSMS should start from a cybersecurity policy, and definition of formal cybersecurity roles and responsibilities, and proceed to map this onto the system architecture in terms of detailed countermeasures applied at identified points (e.g. via analysis of the system in terms of zones and conduits). These detailed countermeasures will include the use of technical countermeasures such as firewalls, encrypted interfaces, authorisation and access controls, and audit/detection tools. But they will also include physical and procedural controls, for example, to restrict access to system components and to maintain awareness of new vulnerabilities affecting the system components.

As minimum requirements, loggers should not be accessible directly from the internet or should at least be protected via a firewall. Secure and restrictive connection to the data server is also important.

The manufacturer of the datalogger and the monitoring platform should provide information on penetration tests for their servers, any command protocol activation channels and security audits for their products. Command functions should be sent using a secure VPN connection to the control device (best practice). Double authentication would be an even more secure option.

For further information, beyond the scope of this document, please look at the EU Cybersecurity Act (EC, 2019) and the European Parliament's study "Cyber Security Strategy for the Energy Sector" (EP, 2016).

10.7. Data portability, backup and disaster recovery

The data from the Asset Management Platform, or component systems, should always be legally owned by, and be accessible to, the Asset Owner (SPV). Stakeholders such as the O&M Contractor, the Asset Manager or auditors, during due diligence phases, that need the data to perform their duties should be able to be granted access.

Depending on whether you rely on an in-house built platform or rely on external vendors, these specific considerations should be key requirements that are passed on and included as part of the scope of the Asset Management Platform.

Consideration should be given to how the data contained within the Monitoring Systems, Asset Management Platform, and that is generally collected by the Asset Manager, is protected to ensure the long-term availability in the case of change of provider either through:

- Managed change of Asset Manager, O&M provider or Monitoring System/Asset Management Platform.
- Unexpected change of Asset Manager, O&M provider or Platform (e.g. insolvency).
- Transfer of ownership of the SPV.

Key to the above is a full understanding of the data being collected at all levels and having agreements in place to make it accessible and ensure it is continuously backed up.

An important consideration in these matters is to understand what underlying system is the "system of record" for any given type of information as it will inform the backup strategy required for each initial "source" of data. It is recommended that the Asset Management Platform should keep a copy and log of all data saved if other systems feeding information into the Platform encounter problems.

The Asset Manager should endeavour to make sure that all data contained within the Asset Management Platform is correct and up to date, to the extent possible. The Asset Manager's ability to properly maintain the Platform should be evaluated regularly. It is expected that the Asset Manager's staff and any other users of the Platform should be appropriately trained in how to use it.

TABLE 19 DATA BACKUP MINIMUM REQUIREMENTS AND BEST PRACTICES

CATEGORY	MINIMUM STANDARD	BEST PRACTICE
Technical data	Plant production monitoring with data collected at least once every 24 hours	Plant monitoring data collected in 15-minute intervals
Financial & commercial data	Yearly presentation of balance sheet, profit & loss, and cash flow statements	Monthly presentation of balance sheet, profit & loss, and cash flow statements
Contractual data	Yearly extension/renewal of contractual data and reporting	Yearly extension/renewal of contractual data and monthly reporting on all contractual related activities (i.e. O&M service provider's activities)
Legal data	Yearly extension/renewal of legal responsibilities	Monthly reporting on legal responsibilities

As a best practice, software vendors should be able to offer a variety of failsafe and backup options to Asset Managers. They should have as per the Information Systems Audit and Control Association (ISACA):

1. Developed a comprehensive backup plan – How and at what frequency are backups done and what are the possibilities for rollback and data recovery?
2. Perform effective backup management – Are they hosting their own servers or relying on cloud service providers?
3. Perform periodic databases restore testing – Have they performed restores of their backups?
4. Have backup and recovery Service Level Agreements (SLAs) drafted and communicated to all stakeholders – What are the severity levels, what are the guarantees, what are their remedies? What business interruption clauses exist?
5. Have the disaster recovery plan (DRP) database portion drafted and documented. Has this all been documented by the vendor?

Asset Managers, as customers of these software companies, can further increase their security by asking for:

1. Specific SLAs that refer to their own backup strategy.
2. Dedicated instances of the application.
3. Code Escrow agreements to secure against bankruptcy.

Ultimately, data portability, security and recovery are everyone's prerogatives and should be discussed with all technology providers.

They should also test the ease of data export/API connectors of their software vendors for more commercial reasons.

10.8. Handover of data and documents

For detailed information on the handover of data and documents, please refer to chapter 5. *Handover of solar assets.*



The baseline of the Asset Manager's work is confidence. The Asset Owner trusts the Asset Manager to manage their asset, assuring the best operational performance and financial optimisation. For that, the Asset Manager should outline effective, rigorous and well-defined processes and procedures according to each geography's needs. This will ensure that the Asset Manager complies with the best guidelines and working practices for daily customer-oriented work.

Close monitoring of Asset Management procedures is required to ensure the effectiveness and efficiency of AM service provision. This can be achieved through the definition of clear and objective KPIs which need to be continuously assessed.

The benefit of using solid and high-standard KPIs to assess performance is assuring the quality and stability of the Asset Manager work. This enables the Asset Manager to monitor their work and learn through experience in order to evolve continuously, which translates into providing a high-quality service for the Asset Owner.

The following sections present the most important KPIs to measure the performance of Asset Managers. (Note that the KPIs used by the Asset Manager to evaluate suppliers are presented in chapter 8. *Procurement*.)

11.1. Asset Manager experience

The Asset Manager's track record and experience can be very important to enable the identification of critical subjects or situations lacking intervention – which translates into work efficiency, based on organising and prioritising the most urgent subjects. Additionally, the return of experience has an important role in the creation and/or redefinition of Asset Management procedures. The Asset Manager's experience can be quantified by indicators such as the number of tender processes managed, OPEX reduction achieved and historical KPI of the key suppliers.

11.2. Quality of service based on periodic asset owner surveys

It is important to obtain Asset Owner's feedback to understand if the Asset Manager's work is aligned with the Asset Owner's needs. This can be achieved through the elaboration of periodic surveys. This helps the Asset Manager to identify critical areas of the Asset Management's process and to define different operating strategies, in accordance with market trends or technological innovations, to be more effective.

11.3. Reports Compliance Rate (RCR)

This KPI is intended to measure the capability of delivering the periodic reports to the Asset Owner on time. Periodic reporting is the most important responsibility of the Asset Manager's work, because it is the most comprehensive way to deliver the operational and financial position of the PV Plant or Portfolio to the Asset Owner on time.

Therefore, it is imperative to monitor this indicator closely and continuously.

Reports Compliance Rate:

$$RCR = \frac{\sum \text{number of reports delivered on time}}{\sum \text{all reports delivered}}$$

Frequency: Monthly (Continuous)

11.4. Invoicing Compliance Rate (ICR)

This KPI is intended to measure the capability of issuing the invoices to the Asset Owner on time.

Invoicing Compliance Rate:

$$ICR = \frac{\sum \text{number of invoices issued on time}}{\sum \text{all invoices issued}}$$

Frequency: Monthly (Continuous)

11.5. Contracts Optimisation Rate (COR)

This indicator is relevant to assess the Asset Management work of optimising the asset's cost structure and quality of service. COR KPI measures contracts' optimisations.

However, this indicator should be analysed carefully depending on the assumptions considered by the Asset Manager. This means that it is necessary to understand the computation of this indicator in order to make assertive/valid conclusions.

There are contracts that cannot be renegotiated by the Asset Manager either because they are locked by project finance requirements or they are initially negotiated for long periods based on an annual fixed fee and indexed to annual CPI. Usually, these contracts represent about 70 – 80% of the OPEX costs – predicted in the KPI's denominator. For example, Land Lease, Asset Management and O&M.

Although the number of renegotiable contracts has a residual weight in the OPEX structure, they should be reviewed annually to achieve global contract optimisation.

Nevertheless, from the Asset Owner's perspective, the most important thing is to achieve a COR > 0%, meaning that the Asset Manager was able to optimise one or more contracts (which is always positive) no matter how small the saving(s) was(were).

Contracts Optimisation Rate:

$$COR = \frac{\sum \text{number of contracts renegotiated successfully}}{\sum \text{all contracts in force (excl. non-renegotiable)}}$$

Frequency: Annual

11.6. Requests treated

RT indicator is intended to assess the Asset Manager's efficiency during a specific period.

This KPI is to assess Asset Manager performance level, based on the number of replied requests. Additionally, it allows the Asset Manager to identify which requests were not followed-up.

Requests Treated:

$$RT = \frac{\sum \text{number of requests treated}}{\sum \text{all requests received}}$$

Frequency: Annual

11 Key performance indicators / continued

11.7. Timely Response Rate (TRR)


Response Time is useful to monitor the compliance of contractual deadlines. As mentioned above, periodic reporting is one of the most important deliverables under the scope of the AM contract.

This indicator is useful to identify weaknesses and strengths in the Asset Management procedures.

Timely Response Rate:

$$TRR = \frac{\sum \text{number of requests responded on}}{\sum \text{all requests}}$$

Frequency: Annual

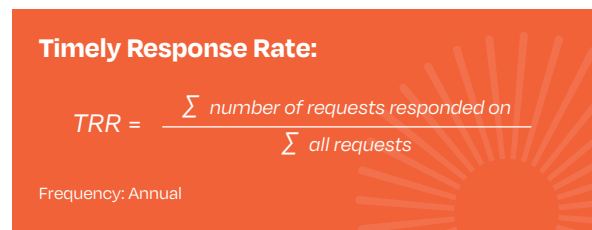

11.8. Quality of the tender process

The quality of the tender process is a KPI related to the procurement capabilities of the Asset Manager, which is reflected in the clarity and comprehensiveness of the requests of proposals, as well as in the number of potential suppliers invited to the organisation of the data-room/Q&A process with the potential buyers.

11.9. O&M contractor compliance

The extent to which O&M Contractors managed by the Asset Manager comply with their contractual obligations is also a KPI that measures AM service quality.

12

Contractual framework

© Lipik Stock Media

This section contains a set of considerations for the contractual framework of AM services to be executed with respect to commercial, industrial and utility-scale systems. As a complement to the technical specifications detailed in the previous chapters, the contractual framework described in this chapter is considered as a best practice.

12.1. Scope of the Asset Management contract

The services provided by an Asset Manager will include the tasks shown in Figure 16 and detailed in this document.

12.2. Asset Management contract fee

As a best practice, AM services should be provided on a fixed annual fee. The Asset Management fees could also be calculated according to a formula which takes into account the capacity of the power plant:

Asset Management contract fee:

$$Fee = Lumpsum \times MW$$

Where:

Fee = Euro [to be agreed]

In addition to the annual fees, the Asset Manager may usually charge the client any out-of-pocket expenses within the annual maximum amount agreed between the parties.

Moreover, the parties may agree upon additional services to be executed at a predetermined price indicated under the contract.

12.3. Contractual guarantees

No contractual guarantees are generally provided under AM agreements.

12.4. Service standards

The Asset Manager will provide the services in accordance with all laws, authorisations, good industry practice and current market standard.

The services to be performed under the AM agreement and the action of the Manager shall be conducted honestly, in good faith, and in the best interest of the client.


With respect to the accounting services, the Asset Manager will keep the books and the relevant records in a proper manner and in conformity with all the required accounting principles and the applicable laws.

Reference to compliance with other project contracts' obligations may be negotiated separately and agreed between the parties to ensure that the SPV/Asset Owner is not in breach of any other relevant obligations undertaken under major contracts.

12.5. Limitation on authority

The Asset Manager shall not be entitled to sell, lease, pledge, mortgage, encumber any client's asset or grant any right or licence over the client's assets.

FIGURE 16 SCOPE OF THE ASSET MANAGEMENT CONTRACT

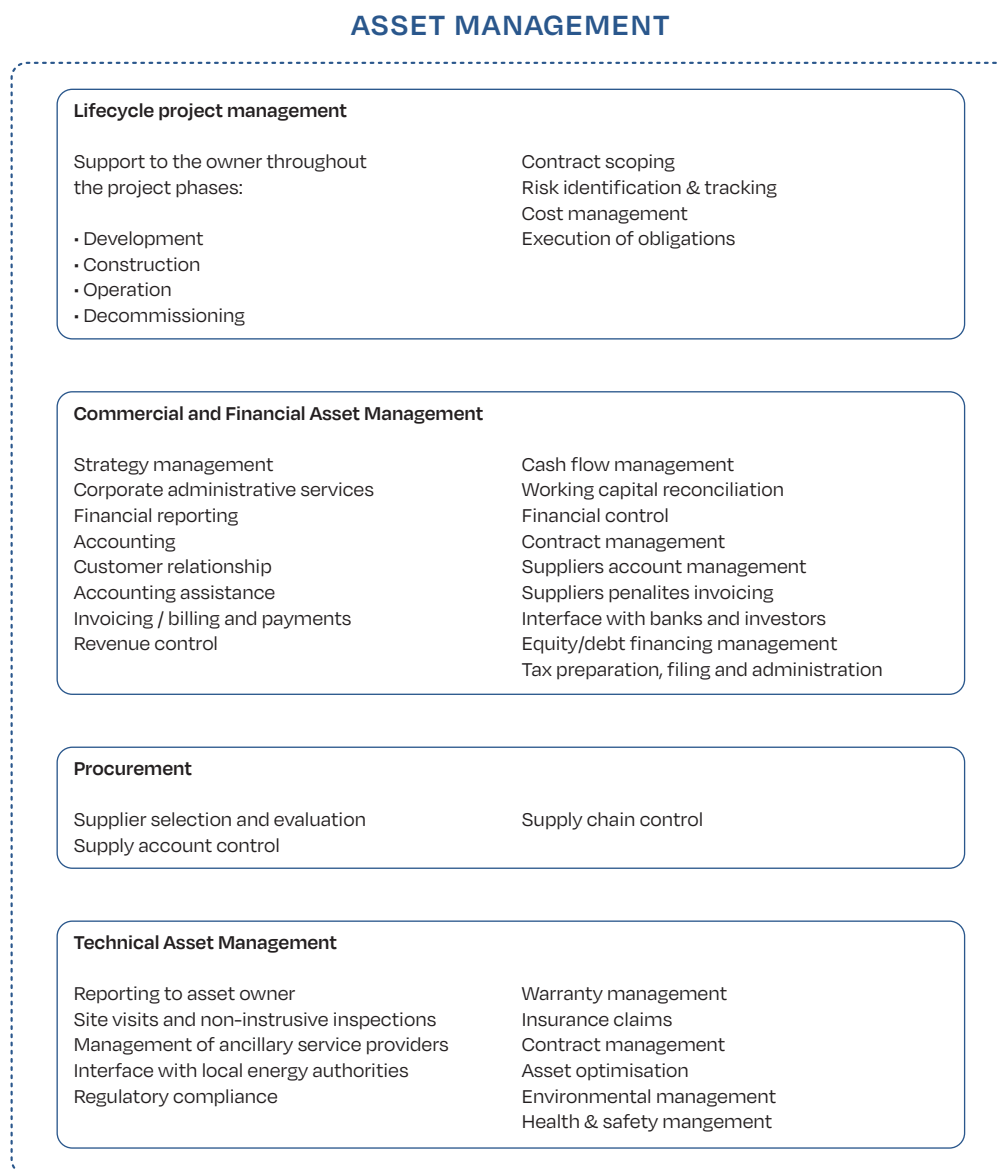

© SOLARPOWER EUROPE 2019

The Asset Manager shall perform the services in compliance with the annual business plan provided by the client.

In addition to the above, the parties may agree that the Asset Manager will not be entitled to enter into any contract having a value higher than the maximum amount identified in the AM agreement.

Moreover, with respect to any litigation that may arise between the SPV/Asset Owner and any third party, the

Asset Manager will not have the power to settle any such claim or to submit to a court or an arbitration panel any such dispute.

12.6. Responsibility and accountability

The Asset Manager shall be liable towards the Asset Owner for every contractual breach or violation of any specific obligation set out under the Asset Management Agreement, including the confidentiality undertakings.

Parties may agree on a maximum liability threshold for the Asset Manager, which is usually equal to the payable annual fee.

12.7. Subcontracting

The Asset Manager could be authorised to subcontract part of the activities to be carried out under the Asset Management Agreement, provided that the subcontractor is a reputable and experienced entity or person capable of fulfilling all the subcontracted obligations and will comply with all the standards and requirements set out under the AM agreement. It is advisable to have a joint liability between the Asset Manager and the subcontractor so that the Asset Manager will remain liable for the subcontracted activities.

12.8. Reporting

Reporting should be done periodically if contractually agreed between the Asset Manager, the O&M Contractor and the Asset Owner. Should the client execute commercial agreements that require daily management and reporting, the AM agreement will also include such specifics. Please note that such activity is generally an additional service.

12.9. Continuity of operation and termination

In the event of termination or withdrawal from the AM agreement, the Asset Manager shall, if required by the client, continue to operate the assets for a specified period (i.e. 60 days) until the replacement of the manager. In such a period, the Asset Manager shall continue to act in accordance with all the provisions set forth under the AM agreement as if the agreement had not been terminated.

Termination is usually provided for general breaches of contract and obligations. Specific breaches leading to immediate termination are generally not included under this type of contract. Grounds for termination may vary a lot. They could go from a minimum of 15 days to a maximum of 90 days.

Termination for convenience may be negotiated between the parties as well as a relevant termination fee.

12.10. Force Majeure

In case of force majeure, the Asset Manager should mitigate the impact of the force majeure event on the

performance of the services to be carried out under the AM agreement. The Asset Manager's obligation also includes minimising the timeframe of a suspension of services, understanding that the services must be restarted in the shortest possible time. During the suspension of services, the Asset Owner (or the lender, if a direct agreement has been executed) may have the right to step in in order to cure any default. Whether the suspension of services is forecastable or not, the Asset Manager should do its best to minimise to the extent possible the damage to the Asset Owner. The Asset Manager also has to inform the Asset Owner of the forecastable restart and the measures to be adopted for minimising the suspension. As a general remark, it should be underlined that in case of a breach of the Asset Manager's duty of care, the Asset Owner may have the right to request full compensation for the damages suffered; to this extent, compensation for indirect losses is generally excluded. Regarding the services suspension regime, it is market standard that the Asset Manager is relieved from the performance of such services as long as the force majeure event lasts. Therefore, each party may have the right to withdraw from the AM agreement upon the expiration of an agreed term or in case the force majeure event jeopardises the entire execution of the Asset Management Agreement.

12.11. Direct agreement

Should the PV plants be financed on a project finance basis, the Asset Manager, the Asset Owner and the lenders may execute a direct agreement in order to regulate lenders' step-in right in case of any default in the Asset Manager's obligation occurs.

Moreover, regarding lenders' security, lenders may require the Asset Manager to deliver any form of agreed collateral guarantee in order to secure the performance of the AM services under the AM agreement.

12.12. Personnel

The Asset Manager should engage and deploy an adequate number of competent, suitably qualified and experienced personnel in order to perform their obligations under the AM agreement. The personnel allocated for the performance of the services should remain allocated to such activities for the entire term of the AM agreement. In case of misconduct or any other incapability in the performance of the services, the Asset Manager should remove and replace the affected personnel with a suitable and qualified replacement. The same provision should also apply to the subcontractor.

References

- European Norm DIN EN 13306. Maintenance - Maintenance terminology; Trilingual version EN 13306:2010.
- European Commission. 2019. "Cybersecurity Act". Web: <https://ec.europa.eu/digital-single-market/en/news/cybersecurity-act-strengthens-europes-cybersecurity>
- European Parliament. 2016. Cyber Security Strategy for the Energy Sector (IP/A/ITRE/2016-04 PE587.333).
- IEC 61724-1:2017. Photovoltaic system performance - Part 1: Monitoring. International Electrical Commission.
- IEC TS 62446-3 Ed.1: Photovoltaic (PV) systems - Requirements for testing, documentation and maintenance - Part 3: Photovoltaic modules and plants - Outdoor infrared thermography" 2017.
- International Standards Organisation (2014a). BS ISO 55000:2014 Asset Management. Overview, principles and terminology. The British Standards Institution.
- International Standards Organisation (2014b). BS ISO 55001:2014 Asset management. Management systems. Requirements. The British Standards Institution.
- International Standards Organisation (2014c). BS ISO 55002:2014 Asset management. Management systems. Guidelines for the application of ISO 55001. The British Standards Institution.
- British Standards Institution (2008a). PAS 55-1:2008, AM, Part 1: Specification for the optimized management of physical assets. British Standards Institution, London.
- British Standards Institution (2008b). PAS 55-2:2008, AM, Part 2: Guidelines for the application of PAS 55-1. British Standards Institution, London.
- GFMAM (2011). The Asset Management landscape. Tech. Rep., Global Forum on Maintenance and Asset Management.
- Institute of Asset Management (IAM) [Online] (2014). Institute of Asset Management - what is ISO 55000? Available at: <https://theiam.org/knowledge/What-ISO-55000>, [accessed 10 July 2015].
- IAM (2015). Asset management maturity scale and guidance. Tech. Rep., The Institute of Asset Management.
- Saunders, C.C., 2016. Development of an ISO 55000 compliant central management framework for asset care plans within a multi-technology portfolio of renewable energy power plants in the South African energy sector (Masters dissertation, Stellenbosch: Stellenbosch University).
- SolarPower Europe (2019), Operation & Maintenance (O&M) Best Practice Guidelines, Version 4.0. SolarPower Europe. Download from www.solarpowereurope.org
- SolarPower Europe (2020), Engineering, Procurement and Construction (EPC) Best Practice Guidelines, Version 1.0. Download from www.solarpowereurope.org





SolarPower Europe - Leading the Energy Transition
Rue d'Arlon 69-71, 1040 Brussels, Belgium
T +32 2 709 55 20 / F +32 2 725 32 50
info@solarpowereurope.org / www.solarpowereurope.org



ISBN NUMBER 9789464073423